

Hamilton-Waikato Metropolitan Area

Southern Metro Wastewater

Detailed Business Case
Mai a Para Wai ki a Para Kore



Contents

Whakatauki	1
Mihimihi/Foreword	2
Acknowledgement	3
Document Control	4
Glossary of Terms	5
Disclaimer	6
Letters of Endorsement	7
Participants	7
Subject Matter Experts	9
Consultants	9
Strategic Case	10
Economic Case	79
Commercial Case	139
Financial Case	174
Management Case	204

Appendices

Strategic Case

Appendix A	Previous Investigations
Appendix B	Relevant policies, regulations and plans
Appendix C	Case for change

Economic Case

Appendix D	Long List Options Report
Appendix E	Short List Options Report
Appendix F	Preferred Option Report
Appendix G	Wastewater Baseline and Future Nutrient Loads for Waikato Southern Metro Wastewater DBC

Commercial Case

Appendix H	Advantages and disadvantages of the contracting options
Appendix I	MCA scoring of Shortlisted contracting options for plants work package
Appendix J	MCA analysis of short-listing packaging options

Financial Case

Appendix K	Full Long-list assessment of funding options
Appendix L	Full Long-list assessment of financing options

Management Case

Appendix M	Benefits Realisation Plan
Appendix N	HCC Risk Management Framework
Appendix O	Waipa DC Risk Management Framework
Appendix P	Risk Register

Other

Appendix Q	Independant Peer Review
------------	-------------------------

Whakatauki

Following the unjust confiscation of over one million acres of Waikato-Tainui land and resources that spanned from Taamaki Makaurau through to the Waikato, Kiingi Tawhiao composed this maimai aroha. It retells his longing and adoration of the taonga and natural resources of his lost homeland.

<p>Ka maatakitaki iho au ki te riu o Waikato Anoo nei hei kapo kau ake maaku ki te kapu o taku ringa, Ka whakamiri noa i toona aratau E tia nei he tupu kua hou.</p>	<p>I look down on the valley of Waikato, as though to hold it in the hollow of my hand and caress its beauty, like some tender verdant thing.</p>
<p>Kia hiwa ake au i te tihi o Pirongia, Inaa, hei toronga whakaruruhau moona ki tooku tauawhirotanga.</p>	<p>I reach out from the top of Pirongia, as though to cover and protect its substance with my own.</p>
<p>Anaa! Te ngoto o toona ngawhaa i ngoona uma kiihai i aarikirika a Maungatautari, a Maungakawa, ooku puke maunga, ngaa taonga tuku iho. Hoki ake nei au ki tooku awa koiora me ngoona pikonga He kura tangihia o te maataamuri.</p>	<p>See how it bursts through the full bosoms of Maungatautari and Maungakawa, hills of my inheritance: The river of life, each curve more beautiful than the last.</p>
<p>E whakawhiti atu ai i te koopuu maania o Kirikiriroa, Me ngoona maara kai, te ngawhaa whakatupu ake o te whenua moomona, Hei kawe ki Ngaaruawaahia, te huinga o te tangata.</p>	<p>Across the smooth belly of Kirikiriroa, its gardens bursting with the fullness of good things, Towards the meeting place at Ngaaruawaahia.</p>
<p>Araa, te pae haumako, hei okiokinga moo taku Upoko, Hei tirohanga atu maa raro i ngaa huuhaa o Taupiri.</p>	<p>There on the fertile mound I would rest my head, and look through the thighs of Taupiri.</p>
<p>Kei reira raa, kei te oroko hanganga o te tangata, Waahia te tuungaroa o te whare, te whakaputanga moo te Kiingi.</p>	<p>There at the place of all creation... let the King come forth.</p>



Mihimihi/Foreword

E wehi ana ki te Atua, te tiimatanga me te whakamutunga o ngaa mea katoa.

Kiingi Tuheitia Pootatau Te Wherowhero te tuawhitu me toou Whare Ariki, paimaarire.

E te kaiwhakawahi Kiingi, e te Tumuaki e Anaru moe mai raa. He iti oou kupu engari he nui toou aroha ki ngaa iwi katoa, Hauaa reo, Hauaa taangata, Hauaa whenua, okioki atu raa. Ki ngaa Pare Kawakawa katoa o te motu, o te ao kua takahi i te ara ki a Hine-nui-te-poo, haere, haere, haere atu raa koutou; taatou maa ngaa waihotanga o raatou maa, teenaa koutou, teenaa koutou, teenaa taatou katoa.

E rere ana ngaa mihi ki ngaa Koromatua e toru, Ko Paula Southgate (Te Kaunihera o Kirikiriroa), Ko Allan Sanson (Te Kaunihera aa-rohe o Waikato) raatou ko Jim Mylchreest me aa koutou kaiwhakahaere matua, ngaa kaitohutohu, teenaa raa koutou katoa. E tika ana me mihi ki te manu taiko o teenei o ngaa mahi, i kawae i teenei o ngaa haepapa ki toona taumata ki a Jackie Colliar, e kore ngaa mihi e mutu. E ngaa mana o te whenua, e ngaa mana whenua, ngaa kaitiaki o te taiao me oona katoa Ngaati Tamainupoo, Ngaati Mahanga, Ngaati Wairere, Ngaati Koroki-Kahukura, Ngaati Hauaa, Ngaati Mahuta, teenei te mihi, teenei te mihi.

Acknowledgement

Acknowledgements to Mayor Paula Southgate, Mayor Allan Sanson and Mayor Jim Mylchreest, to their respective Chief Executives, teams and to Jackie Colliar who has led this collaborative governance project, with Waikato Tainui and Mana Whenua.

Special thanks to the Co-Governance Chair Jim Mylchreest (Waipa Mayor) who has led the Detailed Business Case Metropolitan Wastewater project as a partner with Waikato Tainui.

Kua mahi tahi taatou, kua tutuki pai ngaa mahi i waenganui i a taatou. Kotahi te kaakaho ka whati ki te kaapuia e kore e whati - 'when reeds stand alone, they are vulnerable, but bound together they are unbreakable.'

Let us continue to work together to achieve great things for our communities.

We are pleased and proud to present this Detailed Business Case, a culmination of four years of sustained and comprehensive effort from partners who are deeply committed to delivering more sustainable outcomes for communities across our rohe.

At its core, this work has been grounded by a core vision from which we have never wavered: Tooku awa koiora me oona pikonga he kura tangihia o te maataamuri, the river of life, each curve more beautiful than the last.

Our decision-making has been guided by our vision of a healthy Waikato River which, once restored, will nurture our people for generations to come. In doing so, we have embraced maatauranga Maaori while also embracing and practicing co-management and co-governance principles.

We have all benefited from this approach and urge that these core principles be retained as this important work moves forward.

Our vision, to restore and protect the health and well-being of the Awa has required a boundaryless approach to planning for wastewater treatment improvements. We commend all partners for fully embracing that approach. Doing so has allowed those involved in this work to, for the first time, establish a roadmap for future investment in the Metro Area for the next 50 years. That is a significant achievement.

This commitment to planning a future unrestrained by boundaries must remain absolute if our communities are to benefit from the enormous amount of work which has already gone into this project. We urge all partners to continue modelling this holistic approach.

We thank all of those involved in this project for your expertise, your commitment and for the many hours of work to deliver a comprehensive wastewater treatment plan for our region. Our particular thanks to former Waikato District Mayor Allan Sanson and former Waipā District Mayor Jim Mylchreest who both provided strong guidance and sound counsel during sometimes challenging discussions.

We look forward to seeing the delivery of projects outlined in this Detailed Business Case, seen through to completion. In particular, we look forward to seeing the Waikato River become healthy again so it can continue to nourish us all.

Document Information

	Position
Document ID	Content Manager
Document Owner	Hamilton City Council on behalf of the project partners
Issue Date	April 2022
File Name	Hamilton-Waikato Metropolitan Area: Southern Metro Wastewater Detailed Business Case

Document History

Version	Issue Date	Changes
0.0	21/08/2020	GHD review - Minor changes made to chapters 1 to 3
1.0	28/08/2020	PwC review - Changes made to wording and figures to be clearer and more concise
1.1	04/09/2020	Partner review -Review to be undertaken
1.2	02/03/2020	Updates made to Draft Strategic Case following Partner review and comments received
1.3	13/10/2021	Document restructure, inclusion of recently available information and inserts from partner organisations
1.4	24/02/2022	Updates from client comments and initial peer review
1.5	22/04/2022	Updates from final peer review, readability review and client comments. Issued to PGG

Document Review

Role	Name	Review Status

Document Sign-off

Role	Name	Sign-off Date
Senior Responsible Owner/ Project Executive	Jackie Colliar	

Glossary of Terms

Abbreviation	Description
ADWF	Annual Daily Wastewater Flows
AEE	Assessment of Environmental Effects
BBC	Better Business Case
BOD	Biochemical Oxygen Demand
DBC	Detailed Business Case
DIA	Department of Internal Affairs
IBC	Indicative Business Case
KPI	Key Performance Indicators
LTP	Long Term Plan
MCA	Multi-criteria assessment
MCI	Macroinvertebrates Community Index
NPS	National Policy Statement
RMA	Resource Management Act
TLA	Territorial Local Authorities
UV	Ultraviolet
WWTP	Wastewater Treatment Plant

Disclaimer

This report: has been prepared by GHD/BECA for Hamilton City Council as the lead agent for the Waikato - Hamilton Metro Area Wastewater Detailed Business Case Project. The Waikato - Hamilton Metro Area Wastewater Detailed Business Case Project is being delivered and funded by the project partners Hamilton City Council, Waipa District Council, Waikato District Council, Waikato-Tainui (Te Whakakitenga o Waikato) and mana whenua from the Metro area. The report may only be used and relied on by the project partners as set out in section 1.1 of this report.

GHD/Beca otherwise disclaims responsibility to any person other than Hamilton City Council and its partners arising in connection with this report. GHD/Beca also excludes implied warranties and conditions, to the extent legally permissible.

The services undertaken by GHD/Beca in connection with preparing this report were limited to those specifically detailed in the report and are subject to the scope limitations set out in the report.

The opinions, conclusions and any recommendations in this report are based on conditions encountered and information reviewed at the date of preparation of the report. GHD/Beca has no responsibility or obligation to update this report to account for events or changes occurring subsequent to the date that the report was prepared.

The opinions, conclusions and any recommendations in this report are based on assumptions made by GHD/Beca described in this report (refer section 2). GHD/Beca disclaims liability arising from any of the assumptions being incorrect.

If GHD/Beca has relied on information provided by the client and/or others when preparing the document containing the following should be added to the generic disclaimer detailed above:

GHD/Beca has prepared this report on the basis of information provided by Hamilton City Council and others who provided information to GHD/Beca (including Government authorities)], which GHD/Beca has not independently verified or checked beyond the agreed scope of work. GHD/Beca does not accept liability in connection with such unverified information, including errors and omissions in the report which were caused by errors or omissions in that information.

GHD/Beca has prepared the preliminary cost estimates set out in Section 3.6 of this report (“Cost Estimate”) using information reasonably available to the GHD/Beca employee(s) who prepared this report; and based on assumptions and judgments made by GHD/Beca (refer to section 2.4).

The Cost Estimate has been prepared for the purpose of making a relative assessment of options and must not be used for any other purpose.

The Cost Estimate is a preliminary estimate only. Actual prices, costs and other variables may be different to those used to prepare the Cost Estimate and may change. Unless as otherwise specified in this report, no detailed quotation has been obtained for actions identified in this report. GHD/Beca does not represent, warrant or guarantee that the project can or will be undertaken at a cost which is the same or less than the Cost Estimate.

Letters of Endorsement

E wehi ana ki te Atua te tiimatanga me te whakamutunga o ngaa mea katoa.	Glory to God as the author and finisher of all living things.
Kia tau iho mai ngaa manaakitanga o te Atua ki runga i too taatou Kiingi a Kiingi Tuheitia Pootatau Te Wherowhero Te Tuawhitu, otiraa, toona whare ariki, rire, rire, hau, paimaarire.	Salutations upon the monarch King Tuuheitia Pootatau Te Wherowhero VII and the royal house of Kiingitanga. Blessings.
E te kaiwhakawahi Kiingi, e te Tumuaki o mua e Anaru moe mai raa ki roto i ngaa ringaringa o te Ariki. Ahakoa he iti noa ouu kupu he nui rawa toou aroha ki ngaa Iwi katoa, Hauaa reo, Hauaa taangata, Hauaa whenua, okioki atu raa.	Acknowledgements to the house of the Kingmaker's and Premier of Kiingitanga Anaru Tamihana. You were the quiet voice that uplifted your people. Take flight to the eternal home and join those beyond the veil Hauaa the ancestor, Hauaa the people, Hauaa the enduring landscape.
E rere ana ngaa whakaaro ki ngaa pare kawakawa katoa o te motu, otiraa, te ao kua takahi i te ara whaanui ki a Hine-nui-te-poo, haere, haere, whoatu raa koutou ki ngaa tuupuna o te poo. Ka tahuri aku mihi ki a taatou ngaa waihotanga o raatou maa, teenaa koutou, teenaa koutou, teenaa taatou katoa.	Indeed all those who have been called home by the maiden of eternity Hine-nui-te-poo. Go, take rest among those who have made the journey before you and now adorn our night skies as eternal stars to provide light to us that remain.
E rere ana raa ngaa mihi ki a koe e te Manu Kaahui e Paula Southgate (Te Kaunihera o Kirikiriroa) otiraa, ngaa Koromatua a Allan Sanson (Te Kaunihera-aarohe o Waikato) raaua ko Jim Mylchreest me aa raatou kaiwhakahaere matua, ngaa kaitohutou hoki e kore rawa ngaa tai nui o mihi e mutu, teenaa raa koutou katoa.	Acknowledgement to Mayor Paula Southgate (Hamilton), Mayor Allan Sanson (Waikato), Mayor Jim Mylchreest (Waipaa) and their staff for their contribution and commitment to this important matter. We acknowledge and sincerely thank you all.
E ngaa mana o te whenua, e ngaa mana whenua, ngaa kaitiaki o te taiao me oona aahuatanga katoa Ngaati Maahanga, Ngaati Tamainupoo, Ngaati Wairere, Ngaati Koroki-Kahukura, Ngaati Hauaa, Ngaati Mahuta, Waikato-Tainui teenei te mihi, teenei te mihi.	Lastly, we acknowledge the people and history of the lands, the descendants that care for and protect our environment Ngaati Maahanga, Ngaati Tamainupoo, Ngaati Wairere, Ngaati Korokii Kahukura, Ngaati Hauaa, Ngaati Mahuta and the representatives of Waikato-Tainui.
Donald Turner Co-chair Project Governance Group	Paula Southgate Co-chair Project Governance Group

Participants

Kua whakatinana taatou i te pai o teenei mea te mahi tahi, kua tutuki pai ngaa mahi, kua ea ngaa mahi, huihui ka tuu, wehewehe ka hinga.

Kotahi te kaakaho ka whati ki te kaapuia e kore e whati – ‘when reeds stand alone, they are vulnerable, but bound together they are unbreakable.’

This project has been delivered through consistent and concerted effort and leadership across all aspects of the project.

It is appropriate to acknowledge the valuable contribution from the members of the project governance and control group as well as the subject matter experts from the partner organisations and consultants.

Project Governance Group	
Te Whakakitenga o Waikato (Waikato-Tainui)	Donald Turner (Governance Group Co - Chair) Hinerangi Raumati
Mana whenua representatives	Poto Davis Milton Ngaruhe
Hamilton City Council	Mayor Paula Southgate Councillor Dave McPherson (until October 2022)
Waipā District Council	Mayor Jim Mylchreest (until October 2022) (Governance Group Co-Chair) Mayor Susan O'Regan (from October 2022) Deputy Mayor Liz Stolwyk
Waikato District Council	Mayor Alan Sanson (until October 2022) Mayor Jacqui Church (from October 2022) Aksel Bech (until October 2022) Garth Dibley
Waikato Regional Council (Observing Member)	Deputy Chair Kataraina Hodge

Project Control Group	
Independent Project Director	Peter Winder (until July 2022)
Project Manager	Jackie Colliar
Mana whenua representatives	Harry Wilson Piripi Matika Rangiuia Riki Rangitonga Kaukau (until June 2021)
Hamilton City Council	Blair Bowcott Chris Allen
Waipā District Council	Garry Dyet Dawn Inglis
Waikato District Council	Gavin Ion Ian Cathcart (until June 2021) Vishal Ramduny (from June 2021)
Waikato Regional Council (Observing Member)	Brent Sinclair
Future Proof Waters Committee (Observing Member)	Andrew Parsons
Watercare Services Ltd (Observing Member)	Mark Bourne

Subject Matter Experts

Delivery of the DBC projects would not have been possible without the expertise, and knowledge provided by many subject matter experts across the partnership organisations. There are too many to name, but they include representatives from Te Haa o te Whenua o Kirikiriroa, Waikato-Tainui, Ngaati Koroki Kahukura, Ngaati Wairere, Hamilton City Council, Waipa District Council, Waikato District Council and Watercare Services Limited. Ngaa mihi nui kia koutou katoa.


Consultants

The detailed business case document has been co-authored by several lead consultants alongside the project manager and key staff. The key consultants involved in delivering this work were:

	BECA Ltd GHD Advisory Ltd Maximize Consultants PriceWaterhouseCoopers Te Huia Consultants
	Independent Peer Review was provided by Stantec

Strategic Case

He Keehi Rautaki - He keehi
kaha moo te panoni

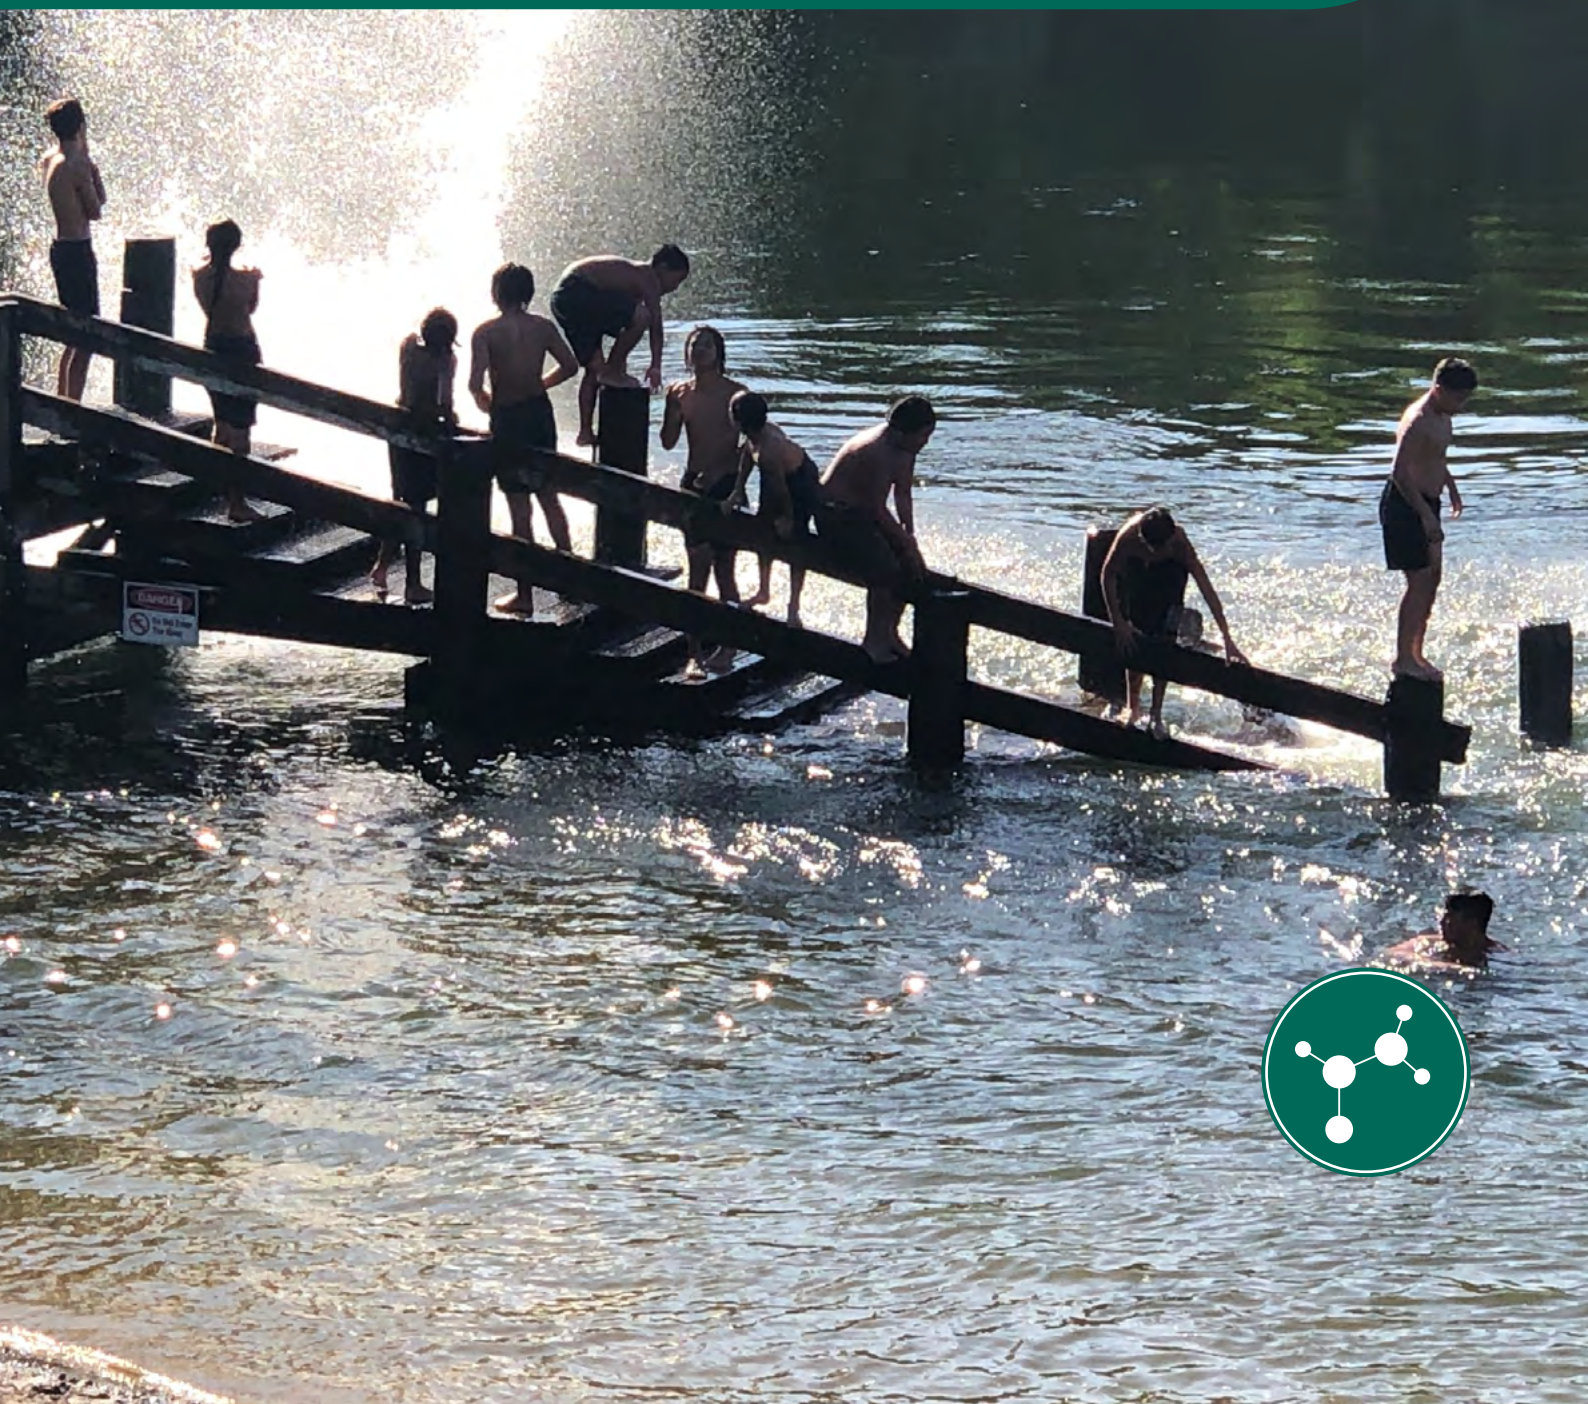

Strategic Case Contents

1. Introduction 14

1.1 Purpose	15
1.2 Better Business Case Approach	15
1.3 Partnership and Collaboration	17

2. Strategic Context 19

2.1 Geographical Context	20
2.2 Historical Context	21
2.3 Treaty Settlements	22
2.4 Current Wastewater Assets	24
2.4.1 Pukete Wastewater Plant & Hamilton City Conveyance Network	24
2.4.2 Ngaruawahia WWTP	29
2.4.3 Airport Industrial Precinct Wastewater Services	29
2.4.4 Cambridge Wastewater System	29
2.4.5 Te Awamutu Wastewater System.....	29
2.4.6 Other Minor WW Systems.....	30
2.4.7 Plant Performance	30
2.5 Previous Investigations	30
2.6 Relevant Policies, Regulation and Plans	32
2.7 Population and Land Use Assumptions	33
2.7.1 General	33
2.7.2 Residential Landuse	33
2.7.3 Non-residential Growth.....	36
2.7.3 Wet Industrial Activities.....	38
2.7.4 Hamilton City Growth	38

3. Case for Change 40

3.1 Problem Development	40
3.1.1 Problem Statement One	42
3.1.2 Problem Statement Two	46
3.1.3 Problem Statement Three.....	51
3.1.4 Problem Statement Four	57
3.2 Benefits, Opportunities and Constraints	61
3.2.1 Benefits	61
3.2.2 Opportunities	64
3.2.3 Constraints, Dependencies	65
3.3 Investment Objectives	67
3.3.1 Best for River Definition	67
3.3.2 Project Objectives	68
3.3.3 KPIs and Measures	71
3.3.4 Strategic Alignment of Objectives.....	73

Figures

<i>Figure SC - 1:</i>	<i>The Better Business Cases Framework – Think and Plan phases (NZ Treasury, 2018).....</i>	<i>16</i>
<i>Figure SC - 2:</i>	<i>Metro Wastewater DBC Project Governance Structure.....</i>	<i>17</i>
<i>Figure SC - 3:</i>	<i>Waikato Three Waters Sub-Regional study area and project study area.....</i>	<i>18</i>
<i>Figure SC - 4:</i>	<i>Metro Wastewater Detailed Business Case Study Area: Southern Metro Area</i>	<i>20</i>
<i>Figure SC - 5:</i>	<i>Pukete Wastewater Treatment Plant</i>	<i>24</i>
<i>Figure SC - 6:</i>	<i>Strategic interceptor network (HCC Long Term Infrastructure Strategy 2015-2045).....</i>	<i>27</i>
<i>Figure SC - 7:</i>	<i>Predicted network overflows at 2061 (based on 2015 growth projections).....</i>	<i>28</i>
<i>Figure SC - 8:</i>	<i>Existing strategies tree diagram</i>	<i>32</i>
<i>Figure SC - 9:</i>	<i>Projected population growth in the Metro Area.....</i>	<i>34</i>
<i>Figure SC - 10:</i>	<i>Hamilton City population growth projections NIDEA 2018.....</i>	<i>35</i>
<i>Figure SC - 11:</i>	<i>Non-residential land use zoning</i>	<i>37</i>
<i>Figure SC - 12:</i>	<i>Population equivalence growth in the Hamilton City.....</i>	<i>39</i>
<i>Figure SC - 13:</i>	<i>Estimated capital investment – Hamilton City Council Infrastructure Strategy (2021-2051)</i>	<i>45</i>
<i>Figure SC - 14:</i>	<i>Water quality of the Waikato River⁴⁵.....</i>	<i>49</i>
<i>Figure SC - 15:</i>	<i>Life of the Waikato River – Macroinvertebrate (MCI).....</i>	<i>49</i>
<i>Figure SC - 16:</i>	<i>Compliance of WWTPs in Metro Area</i>	<i>55</i>
<i>Figure SC - 17:</i>	<i>People’s environmental attitudes to regulation.....</i>	<i>58</i>
<i>Figure SC - 18:</i>	<i>Forecasted Capital Expenditure for Wastewater – Five Yearly Periods 2021-2051 (Hamilton City Council’s Infrastructure Strategy).....</i>	<i>60</i>
<i>Figure SC - 19:</i>	<i>Best for River definition statements and their alignment with Te Ture Whaimana o Waikato – the Vision and Strategy for the Waikato River</i>	<i>67</i>
<i>Figure SC - 20:</i>	<i>Investment Logic Map</i>	<i>70</i>

Tables

<i>Table SC - 1:</i>	<i>Current WWTP within the Metro Area</i>	<i>25</i>
<i>Table SC - 2:</i>	<i>Summary of previous wastewater servicing investigations and their relevance to DBC</i>	<i>30</i>
<i>Table SC - 3:</i>	<i>Residential population assumptions.....</i>	<i>35</i>
<i>Table SC - 4:</i>	<i>Industrial demand and capacity in the Metro Area.....</i>	<i>36</i>
<i>Table SC - 5:</i>	<i>Hamilton City population equivalence growth estimates.....</i>	<i>38</i>
<i>Table SC - 6:</i>	<i>Programme problem statement and relevance to the project.....</i>	<i>41</i>
<i>Table SC - 7:</i>	<i>Previous decision-making issues at existing WWTPs.....</i>	<i>47</i>
<i>Table SC - 8:</i>	<i>Plan Change 1 and NPS standards comparison at Whakamuru Tailrace and Tuakau Bridge</i>	<i>53</i>
<i>Table SC - 9:</i>	<i>Quality of discharge consents of WWTPs (for river only discharges) ..</i>	<i>54</i>
<i>Table SC - 10:</i>	<i>Capacity constraints at existing WWTPs</i>	<i>59</i>
<i>Table SC - 11:</i>	<i>Key constraints, dependencies and risk areas.....</i>	<i>66</i>
<i>Table SC - 12:</i>	<i>DBC Objectives and alignment to Best for River.....</i>	<i>68</i>
<i>Table SC - 13:</i>	<i>Additional Best for River considerations.</i>	<i>69</i>
<i>Table SC - 14:</i>	<i>KPIs and relevant data sources.....</i>	<i>71</i>
<i>Table SC - 15:</i>	<i>Strategic alignment with Sub-regional Three Waters Strategy</i>	<i>74</i>
<i>Table SC - 16:</i>	<i>Strategic alignment with UN Sustainable development goals</i>	<i>75</i>
<i>Table SC - 17:</i>	<i>Strategic alignment with Tai Tumu Tai Pari Tai Ao</i>	<i>77</i>
<i>Table SC - 18:</i>	<i>Strategic alignment with Ngāti Hauā Environmental Management Plan.....</i>	<i>78</i>

1. Introduction

The Hamilton-Waikato Metropolitan Area (Metro Area) is the urban sub-region of the Waikato. Hamilton is at the core of the Metro Area which extends from Taupiri in the north to Te Awamutu and Cambridge in the south¹. The Metro Area sits across three local authority jurisdictions (Waikato District, Hamilton City, Waipā District).

The Metro Area is located on tribal lands unjustly confiscated by the Crown in 1865. The Raupatu (confiscated) lands were the subject of a Treaty of Waitangi claim and the 1995 Waikato Raupatu Land Settlement.

In 2009, Waikato-Tainui entered into a deed of settlement in response to the Raupatu claims over the Waikato River. The Waikato-Tainui Raupatu Claims (Waikato River) Settlement Act 2010 (the Waikato-Tainui Act) gave effect to the 2009 deed of settlement. The overarching purpose of the settlement is to restore and protect the health and wellbeing of the river for future generations.

Recommendations in this DBC are based on achieving “Best for River, Best of Community” outcomes that seek to contribute to achieving the vision and objectives of Te Ture Whaimana o te Awa o Waikato (The Vision and Strategy for the Waikato River).

Challenges

Local authorities, iwi, communities and industry face significant challenges in meeting current and future three waters service needs in the Metro Area. Ongoing population growth and development in the Metro Area and the broader Waikato River catchment is increasing pressure on lands and waters. These pressures manifest in negative ways, from degraded environmental quality and loss of biodiversity through to constraints on water allocation.

Many of the municipal wastewater treatment plants (WWTPs) in the sub-region have poor resource consent compliance records. The majority of municipal wastewater discharge consents will expire in the next 10 years. System performance has been variable, and not of the standard needed to meet Best for River principles and achieve the environmental, cultural and economic aspirations of the sub-region.

Historically, each of the three local authorities in the Metro Area have planned and funded wastewater infrastructure separately. Tangata whenua have been excluded from strategic infrastructure planning resulting in a lack of system thinking and integration. In some instances, this has resulted in short-term investment decisions, including deferred investment decisions, which do not align with the vision for co-governance established in the Waikato-Tainui Raupatu Claims (Waikato River) Settlement Act 2010.

1. Hamilton – Waikato Metro Spatial Plan, 2020.



1.1 Purpose

This DBC identifies and recommends long-term wastewater treatment solutions for the Metro Area unconstrained by territorial boundaries. The DBC seeks formal approval to invest in a wastewater treatment solution for the Southern Metro Area (refer to Figure SC - 3:).

The DBC has been delivered through a partnership between taangata whenua and the three local authorities. The project delivery structure has sought to give effect to Te Tiriti o Waitangi partnership in the form of equal representation between local authorities and iwi/hapuu at all levels of the project (i.e., from governance through to technical project teams).

In summary, the purpose of this DBC is to:

- Identify the investment option that delivers Best for River outcomes.
- Prepare the investment proposal for procurement.
- Plan the necessary funding and management arrangements for the successful delivery of the project.
- Inform a proposal to decision-makers to seek agreement and finalise the arrangements for implementation and funding assessment of the project.

1.2 Better Business Case Approach


The five case Better Business Cases model (BBC) has guided this DBC. The BBC model provides a disciplined, step-by-step approach to ensure the key aspects of a robust investment proposal are explicitly and systematically addressed (NZ Treasury, 2018).

The Waikato Sub-Regional Three Waters Strategic Case was approved in December 2019, which provided a compelling case for change in the way that water, wastewater, and stormwater (three waters) services are planned, managed and delivered in the Waikato and Waipā river catchments. A Waikato Sub-Regional Three Waters Programme Business Case (PBC) building on the earlier strategic case is being undertaken and is expected to be completed in 2023. The PBC will incorporate the work undertaken to complete this DBC as well as the work currently being undertaken for the Northern DBC in relation to Wastewater. The PBC will incorporate this information with water supply and stormwater to provide a long-term understanding of the Three Waters programme for the sub-region.

The Cambridge Wastewater Treatment Indicative Business Case (IBC) was also approved in late 2019. This indicative case set out the case for change, and high-level options assessment for the Cambridge WWTP. Both projects provide key inputs to the 'thinking' part informing this DBC process, mapping out the strategic intent for the wastewater infrastructure within the Metro Area (see Figure SC - 1).

This DBC moves into the 'planning' phase of the process.

Figure SC - 1: The Better Business Cases Framework – Think and Plan phases (NZ Treasury, 2018)

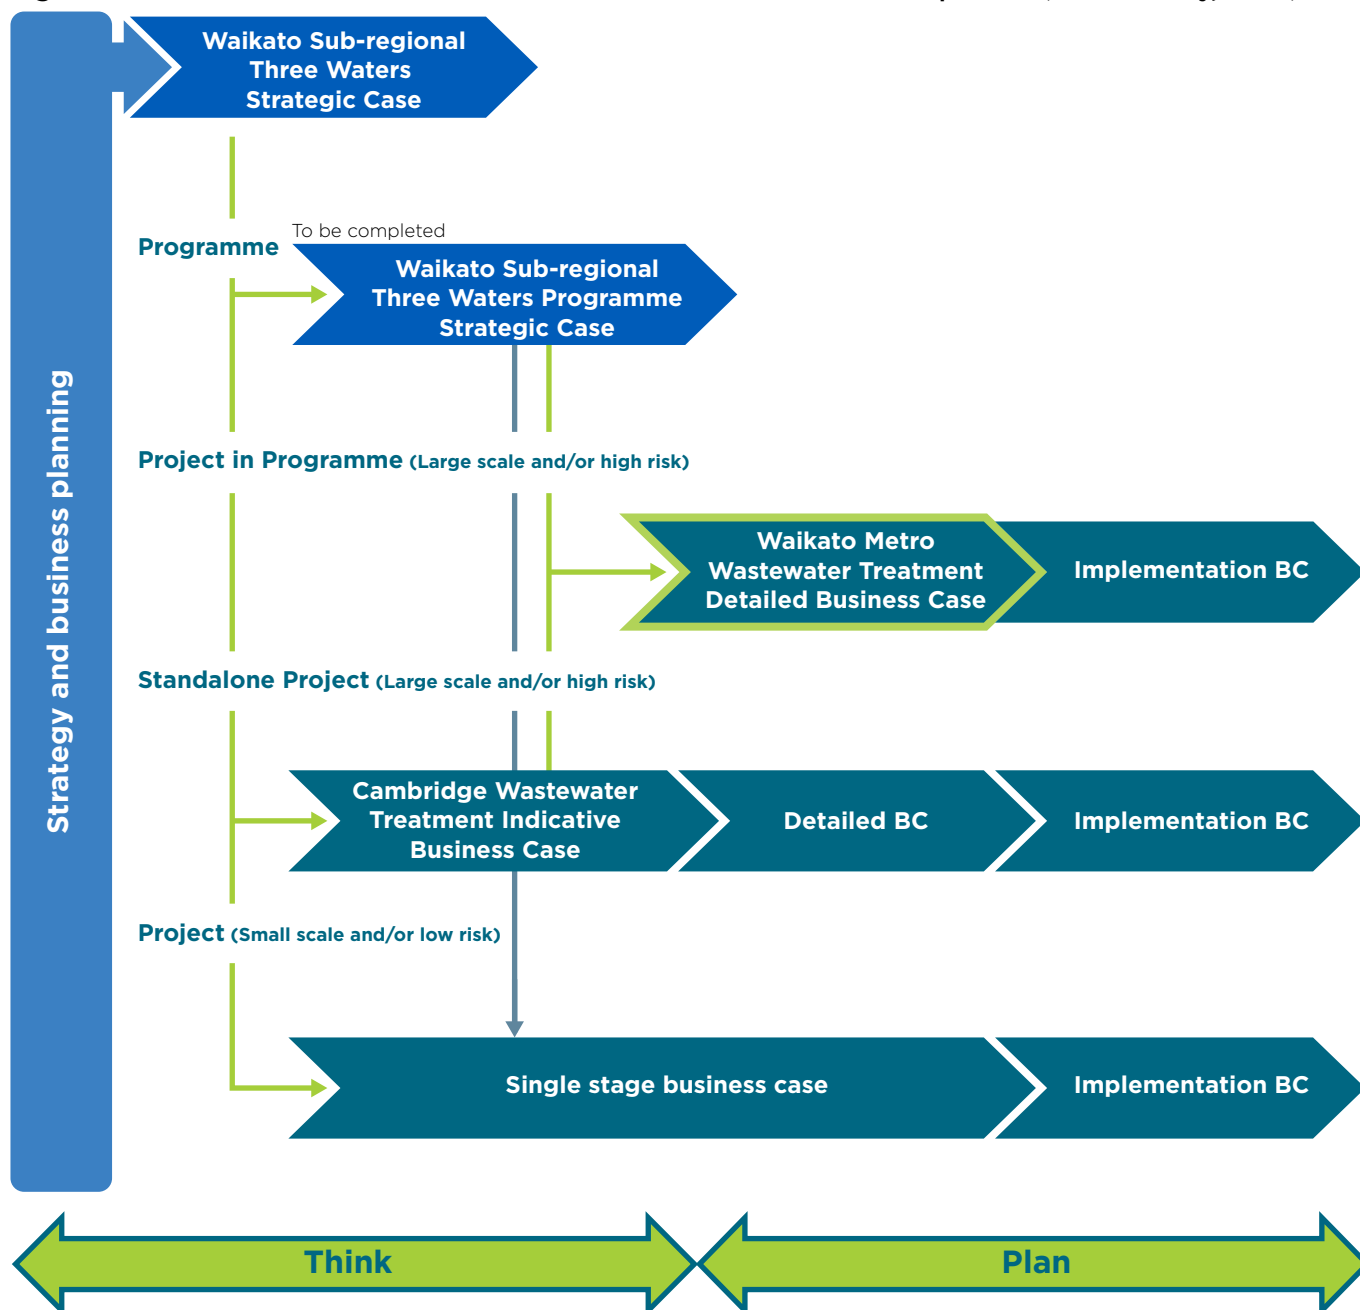

To achieve the DBC purpose (in line with the BBC guidelines) the following five cases are investigated: Strategic Case, Economic Case, Financial Case, Commercial Case and Management Case.

The high-level purpose and scope of each case is as follows:

- The Strategic Case evaluates the strategic need for the project and case for change. The case for change has been informed by examining the problems of the existing situation and refining the benefits of addressing the existing problems. Investment objectives are also defined to inform the other cases.
- The Economic Case evaluates whether the project is environmentally, socially, culturally and economically desirable through identifying options and evaluating which option best aligns with the project investment objectives. Through this DBC a longlist of wastewater servicing options for the

2. A cost benefit analysis is not to be undertaken due to the challenges in monetizing environmental and cultural benefits.


full Metro Area is evaluated utilising a Multi-Criteria Assessment (MCA) to determine a shortlist of options. The short-listed options are refined, and a more detailed MCA of these options completed to determine a preferred way forward for the Southern Metro Area².

- The Commercial Case evaluates whether the preferred way forward is commercially viable. A longlist of potential commercial models and procurement options are assessed to determine preferred options. A detailed procurement strategy has also been developed as part of the Commercial Case.
- The Financial Case evaluates the affordability of the project to determine whether it is financially feasible. A longlist of funding and financing options was identified, refined and evaluated to determine a shortlist and then to determine a preferred way forward. A funding and financing strategy has been developed as part of the Financial Case.
- The Management Case evaluates whether the project can be practically delivered and outlines the governance structures, plans and management aspects required to implement the preferred option. Stakeholder engagement, risk management and benefits realisation strategies have been developed as part of the Management Case.

1.3 Partnership and Collaboration

Delivering this DBC has been a collaboration between HCC, Waipā DC, Waikato DC, Waikato-Tainui and Mana Whenua representatives (collectively referred to as “the Partners”) at all levels of the project structure. The membership of the Governance and Control Groups provide for equal representation for local government and Iwi/Mana whenua.

Figure SC - 2: Metro Wastewater DBC Project Governance Structure³

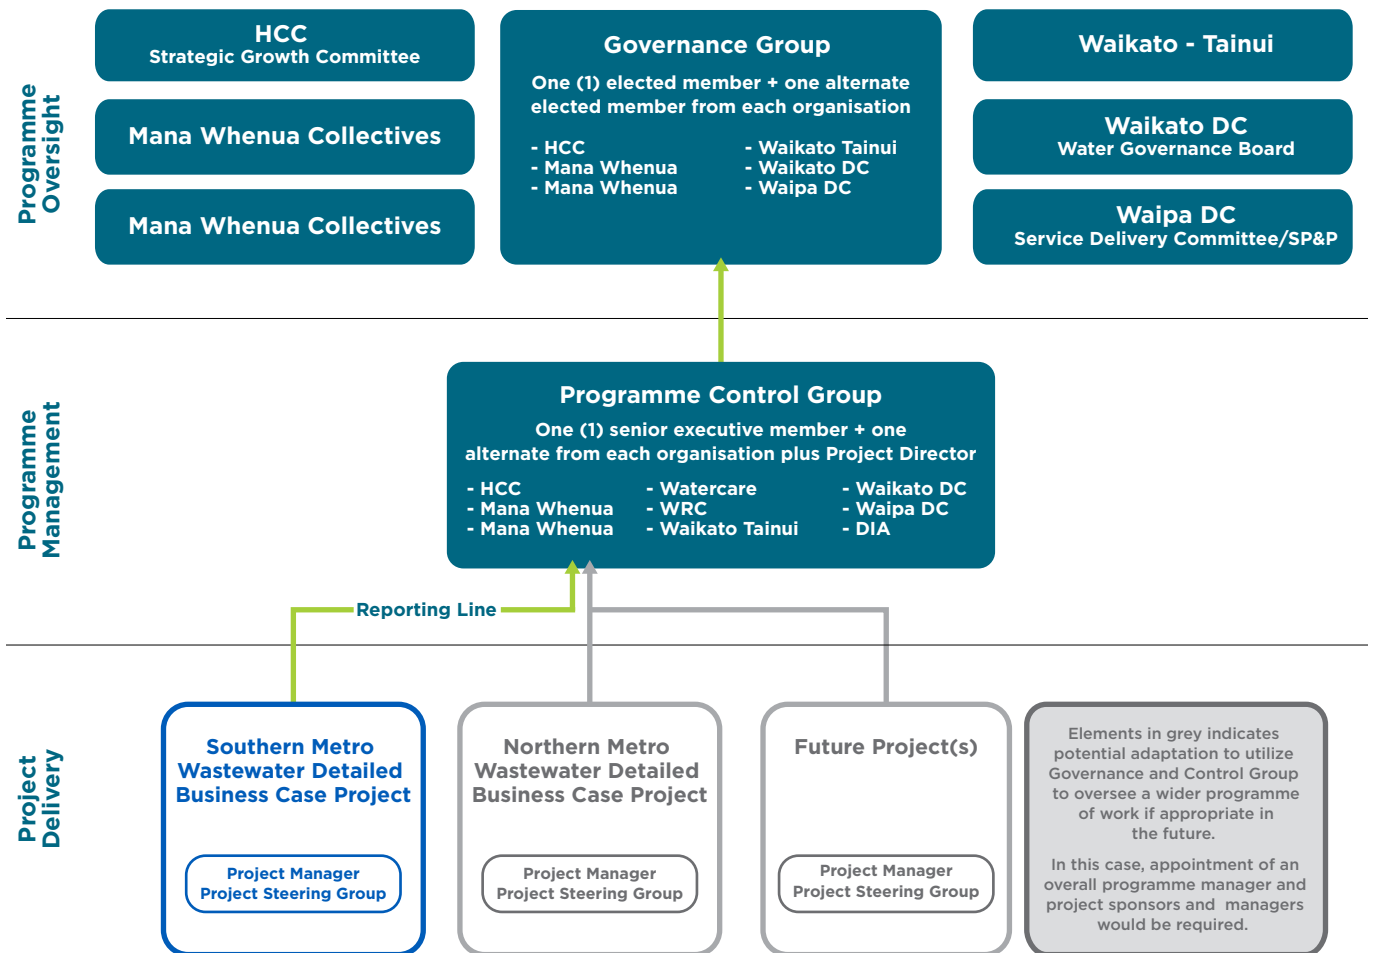


Key milestone decisions informing this DBC were made by the Partners throughout the project. The process adopted for decision-making has been to develop and review the key project elements with subject matter specialists from the partnership; seek endorsement from the Project Control Group; seek approval from the Project Governance Group.

Key decisions have included:

- Scope of the DBC.
- Growth assumptions.
- Project vision, Investment Objectives and Key Performance Indicators (KPIs).
- Long list and short list of commercial, financial and wastewater servicing options.
- Preferred commercial, financial and wastewater servicing solutions.
- Minimum treatment performance standards.

Figure SC - 3: Waikato Three Waters Sub-Regional study area and project study area

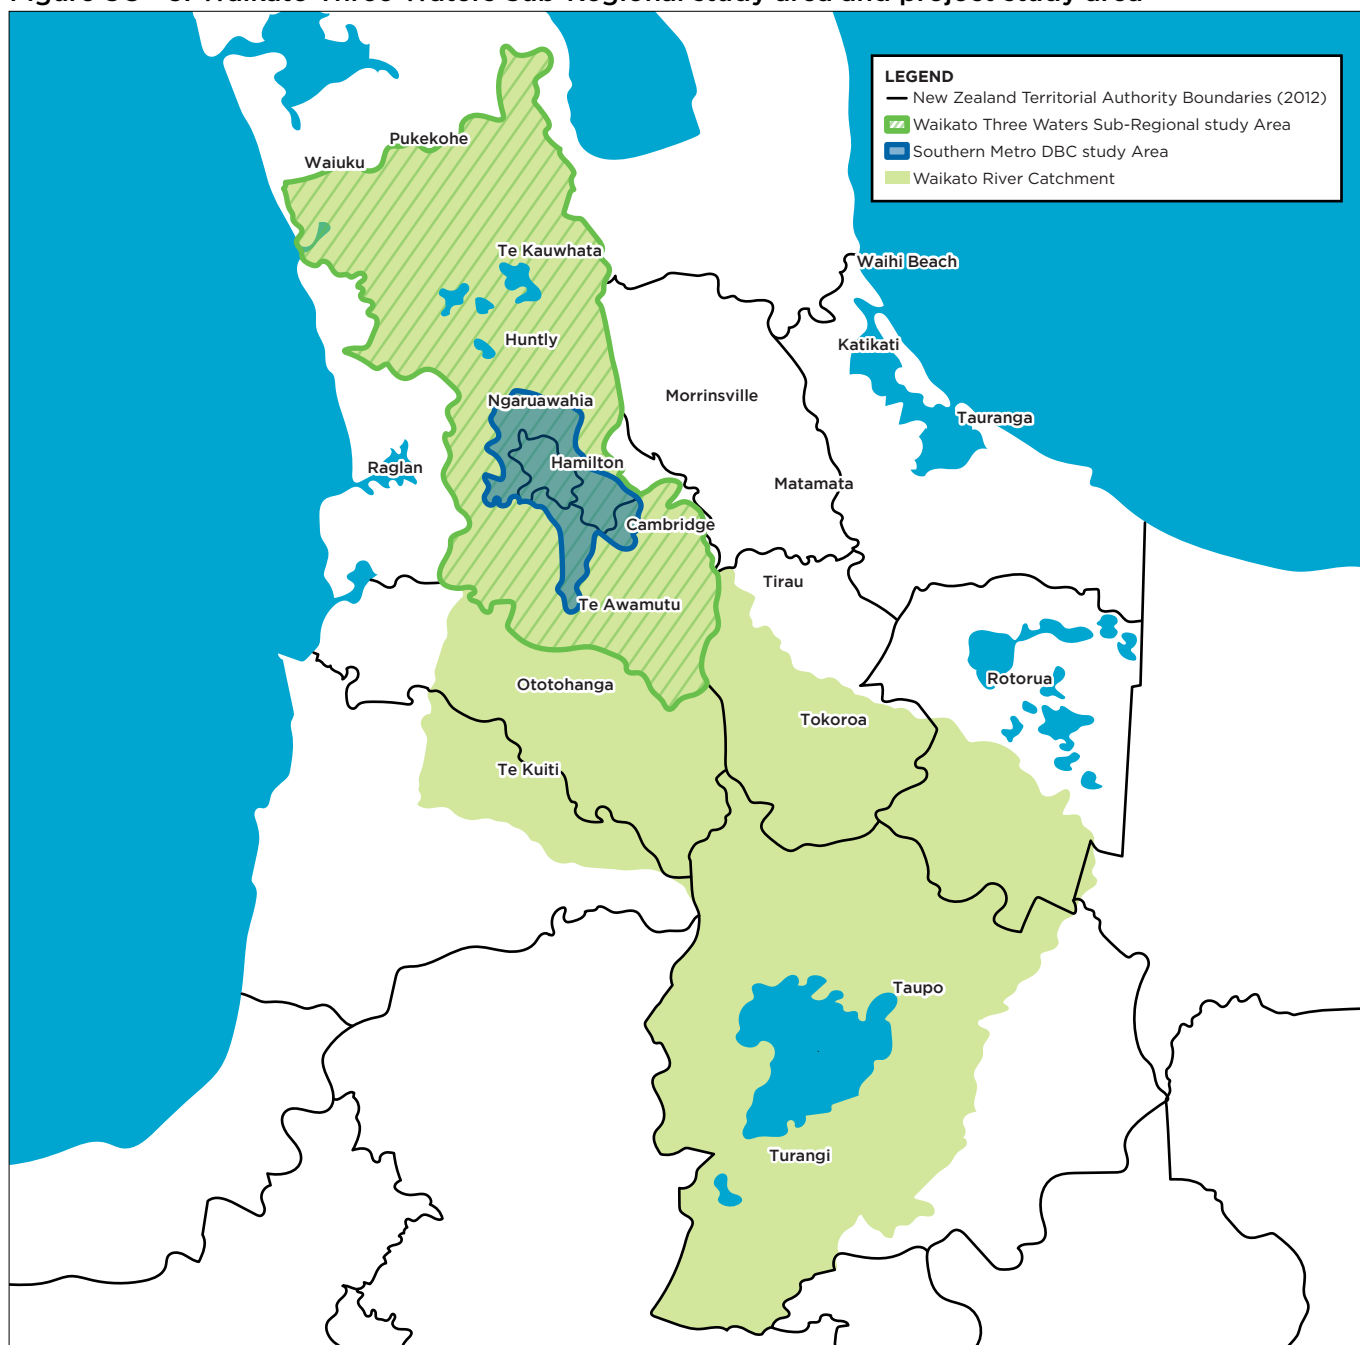

3. Hamilton - Waikato Metro Area Wastewater Detailed Business Case Project - Project Governance Terms of Reference

2. Strategic Context

This DBC seeks to identify the most innovative, responsive and timely wastewater servicing solutions, unconstrained by territorial boundaries, while creating better environmental outcomes, community benefits and overall efficiencies than can currently be achieved by individual councils.

A “boundaryless” approach is considered essential to restoring and protecting the health and wellbeing of the Waikato River. A boundaryless approach can deliver greater alignment and consistency in approach and objectives, economies of scale, support the adoption of new and emerging technologies. It can secure a future state of water and overall environmental gains that individual local authorities will struggle to realise alone.

Benefits of this approach include a more holistic, integrated and planning approach to land use and water, including responding to current and future growth, more efficient resource use (including water, energy, carbon, nutrients), water quality improvement and ecological enhancement.

Currently Hamilton City, Waikato District, and Waipaa District Councils are individually responsible for three waters infrastructure and services in their respective communities. Despite best intentions and considerable work and expenditure on three waters infrastructure, decisions relating to this infrastructure and land use and development in the Waikato River catchment have contributed to a current state where:

- The water quality of the Waikato River is significantly degraded.
- Three waters infrastructure is inefficient and ageing, no longer fit-for-purpose.
- There is with a significant legacy of under-investment.
- There is uncertainty around the abilities of individual councils to fund infrastructure, maintenance and operations for future growth and to achieve regulatory targets for freshwater quality.
- There is concern under existing funding arrangements that ratepayers will not be able to afford appropriate three waters infrastructure in the future.
- Developers in some areas are providing their own site-specific infrastructure (e.g., wastewater package plants) leading to fragmented networks and services that are complex to manage and renew, increasing the risk of failure and resulting environmental degradation.

Future growth pressures, environmental expectations and increased regulatory requirements (such as Te Ture Whaimana and the National Policy Statement for Freshwater Management) are likely to exacerbate these issues. Without a coordinated solution to these problems, three waters infrastructure will be a hand brake on development in our Metro Area. Ongoing environmental degradation will occur.


2.1 Geographical Context

The Metro Area extends from Taupiri in the north to Te Kowhai in the west, Tauwhare in the east, and Te Awamutu/Kihikihi and Cambridge in the south.

The DBC considers wastewater servicing for the following communities⁴ (separated into northern and southern areas):

Northern Communities	Southern Communities
Taupiri	Mātangi
Hopuhopu	Tamahere
Ngaaruawaahia	Hamilton Airport
Horotiu	Ohaupo
Te Kowhai	Cambridge/Karapiro
Hamilton (North)	Te Awamutu/Kihikihi
Area east of Hamilton	Tauwhare
	Tauwhare Pa.

Figure SC - 4: Metro Wastewater Detailed Business Case Study Area: Southern Metro Area⁵

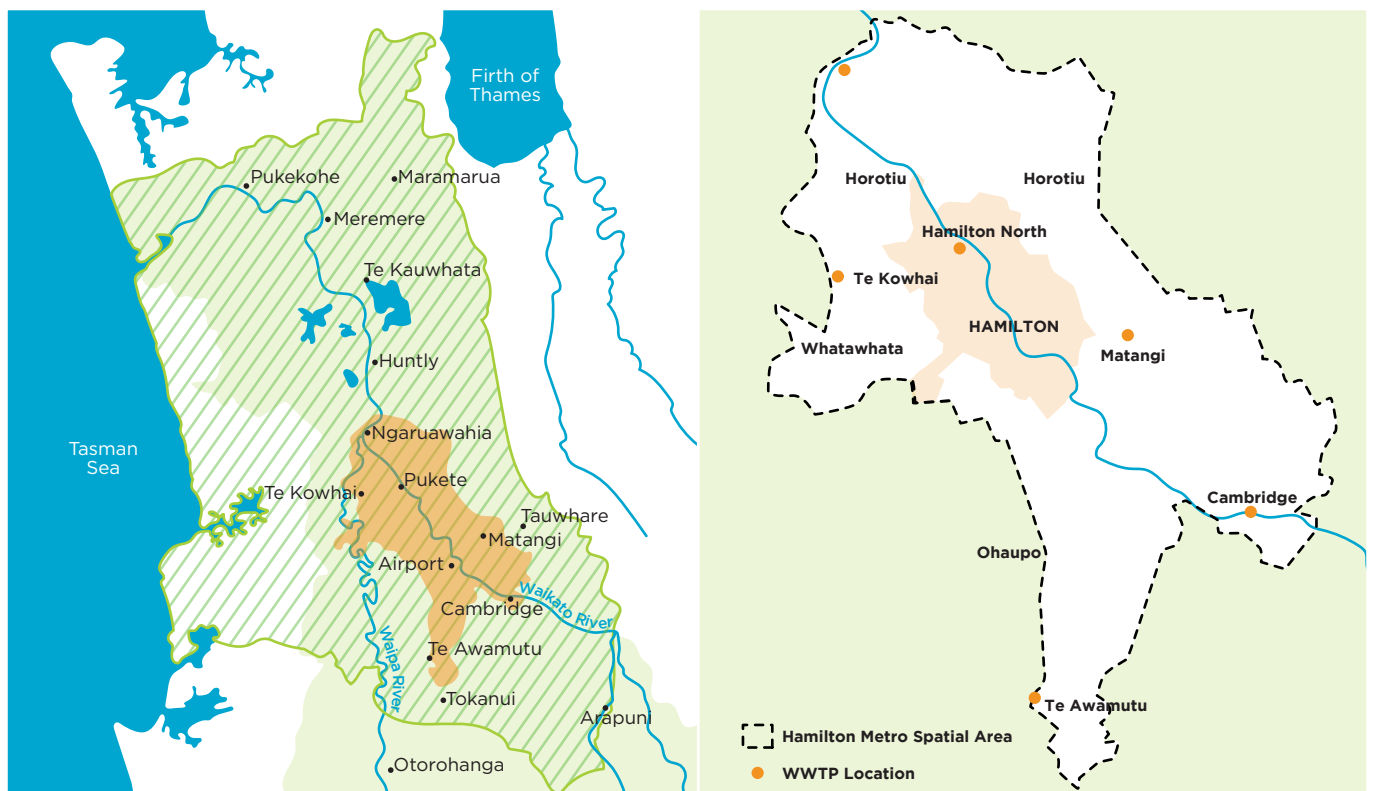

⁴ Gordonton, Pirongia, Whatawhata and Tamahere Country Living Area were excluded from the scope of the study at the direction of Waikato and Waipa District Council.

⁵ Note: The Northern Metro Area and Southern Metro Area boundary shown is indicative only and subject to further consideration following existing WWTP capacity assessments.

2.2 Historical Context

Taangata Whenua within the Metro Area are descended from the Tainui waka. There are six significant iwi/hapuu groupings within the Metro Area boundaries: Ngaati Hauaa, Ngaati Korokii- Kahukura, Ngaati Maahanga, Ngaati Mahuta, Ngaati Tamainupo, and Waikato-Tainui.

The southern towns of Cambridge and Te Awamutu includes additional mana whenua Ngaati Maniapoto, Raukawa, Ngaati Apakura, Ngaati Hikairo, and Paretekawa.

The Metro Area contains significant landmarks, including the sacred Taupiri mountain and the Waikato River. It is said that Taupiri lived near her brother Tongariro until her marriage to the mountain chief Pirongia brought her to her new home near Ngaaruawaahia. Upon her arrival she became ill and sent a message asking Tongariro to deliver healing waters. Tongariro sent a faithful dog to cut a pathway between Tongariro and Taupiri – said to be the origin of the Waikato River. Taupiri recovered once she was able to drink the healing waters.

Tangata whenua hold the Waikato River in very high regard, viewing it as an ancestor who is a source of sustenance, identity and mana. They view themselves as belonging to, and being part of, the River, and they have an obligation to protect it.

Prior to European settlement, the Waikato River and all its tributaries in the Metro Area would have had very high water-quality and would have been mostly free of contaminants other than those occurring naturally, such as vegetation litter and sediments from naturally occurring stream erosion and scour. The Waikato River, streams, lakes and extensive wetlands in the Metro area (and indeed throughout the entire catchment) teemed with life. Tuna (eels), whitebait species (inanga, banded kokopu and giant kokopu), smelt, piiharau (lamprey eels), kanae (mullet – yellow-eyed and grey), paatiki (flounder), kaakahi/kaaeo (freshwater mussels) and koura (freshwater crayfish)⁶ lived in one or more of these different types of water body. The health, wellbeing and abundance of resources provided food, rongoa (medicines) and materials for making tools, clothing, houses, fortifications, weapons and canoes, and sustained the people physically, mentally and spiritually.

In 1858 the Kiingitanga movement originated in the Waikato region under the first Maaori King Pootatau Te Wherowhero to unite iwi and halt the alienation of Maaori land. The movement continues to this day with the headquarters of the Kiingitanga movement located at Tuurangawaewae Marae in Ngaaruawaahia, on the eastern banks of the Waikato River. It is the official residence of the current Maaori King, Tuheitia Pootatau Te Wherowhero VII. On 12 July 1863, British troops crossed the Mangatawhiri Stream, breaching the aukati (a boundary not to be crossed) declared by the second Maaori King Taawhiao, and invaded Waikato.⁷

In 1864 and 1865, military settlements, including Hamilton and Cambridge, were established.⁸ In 1865⁹, by Orders in Council under the New Zealand Settlements Act 1863, the Crown unjustly confiscated approximately 1.2 million acres (approximately 500,000ha) of Waikato-Tainui land from the Tainui iwi in order to punish them and gain control of the land placed by them under the protection of the Kiingitanga.¹⁰

New settlers occupied the confiscated lands, wetlands were drained, and farms and towns developed. The development contributed to the economic growth of New Zealand but resulted in the pollution and deterioration of the health of the Waikato River and significantly impacted on the fisheries and plant life of the River.¹¹

6 Waikato-Tainui Te Kauhanganui Incorporated, 2013, s.22.1.5, p.186

7 Waikato-Tainui Raupatu Claims (Waikato River) Settlement Act 2010, Preamble, paragraph 5

8 Ibid, Preamble, paragraphs 6

9 Ibid, Preamble, paragraph 7

10 Waikato Raupatu Claims Settlement Act 1995, Preamble, paragraph F.

11 Waikato-Tainui Raupatu Claims (Waikato River) Settlement Act 2010, Preamble, paragraph 9

Widespread suffering, distress, and deprivation were caused to the Waikato iwi because of the war waged against them, the loss of life, the destruction of their taonga and property, and the confiscations of their lands. The effects of the Raupatu have lasted for generations.¹²

From the time of the Raupatu (the land confiscation), which occurred in 1865 following the invasion of the Waikato by the Crown's military forces, Waikato-Tainui were excluded from decision-making regarding the Waikato River.¹³

Waikato-Tainui never willingly or knowingly relinquished their rights and interests in, or authority over, the Waikato River¹⁴. From the 1860s onwards, Waikato-Tainui continually sought justice for their Raupatu claim and protection for the River¹⁵.

2.3 Treaty Settlements

Waikato-Tainui negotiated directly with the Crown and reached settlement of their Raupatu land claim in 1995 and their river claim in 2008.¹⁶

The Waikato-Tainui Deed of Settlement for the Waikato River received royal assent in 2010. The overarching purpose of the settlement is to restore and protect the health and wellbeing of the Waikato River for future generations. Under this Settlement the Waikato River includes the river's main stem, from Huka Falls to the Waikato River mouth, and all its tributaries.¹⁷

The purpose of the Waikato-Tainui Raupatu Claims (Waikato River) Act 2010, as set out in Section 4 is to:

- a. Give effect to the settlement of raupatu claims under the 2009 deed.
- b. Recognise the significance of the Waikato River to Waikato-Tainui.
- c. Recognise the vision and strategy for the Waikato River (Te Ture Whaimana o te Awa o Waikato).
- d. Establish and grant functions and powers to the Waikato River Authority.
- e. Establish the Waikato River Clean-up Trust.
- f. Recognise certain customary activities of Waikato-Tainui.
- g. Provide co-management arrangements for the Waikato River.
- h. Provide redress to Waikato-Tainui relating to certain assets.
- i. Recognise redress to Waikato-Tainui of the Kiingitanga Accord and other accords provided for in the schedule of the Kiingitanga Accord.

Amongst other redress, the Act recognises the Vision and Strategy for Waikato River¹⁸, Te Ture Whaimana o Te Awa o Waikato¹⁹, (the Vision and Strategy) as the primary direction-setting document for the Waikato River and activities within its catchment affecting the Waikato River.²⁰

12 Waikato Raupatu Claims Settlement Act 1995, Preamble, paragraph G

13 Waikato-Tainui Raupatu Claims (Waikato River) Settlement Act 2010, Preamble, paragraph 8

14 Ibid, Preamble, paragraph 17(d)

15 Ibid, Preamble, paragraph 16

16 Ibid, Preamble, paragraphs 12 and 15

17 Ibid, s.6, interpretation of "Waikato River"

18 Ibid, Schedule 2

19 Ibid, s.9(3)

20 Ibid, s.5(1)

The Waikato-Tainui Raupatu Claims (Waikato River) Settlement Act 2010 gives effect to the deed of settlement in respect of the raupatu claims of Waikato- Tainui over the Waikato River. The overarching purpose of the Act is to restore and protect the health and wellbeing of the Waikato River for future generations²¹. Specifically, the Act established the Waikato River Authority and recognises Te Ture Whaimana o te Awa o Waikato (the Vision and Strategy for the Waikato River). The principles which underpin this legislation, as set out in the Kiingitanga Accord, are:

1. Te mana o te awa (the spiritual authority, protective power, and prestige of the river).
2. Mana whakahaere (authority and rights of control).
3. Health and wellbeing.
4. Co-management.
5. Integration.
6. Honour and integrity.
7. Te Tiriti o Waitangi.

Additionally, the Ngaati Tuuwharetoa, Raukawa, Te Arawa River Iwi Waikato River Act 2010 and the Ngā Wai o Maniapoto (Waipa River) Act 2012 are important pieces of legislation that give effect to Te Ture Whaimana so that it now covers the whole of the Waikato and Waipā river catchments.

Te Ture Whaimana o Te Awa o Waikato sets out the vision, objectives and strategies to restore and protect the health and wellbeing of the Waikato River. It is the primary direction-setting document for the Waikato River and its catchments, which includes the Waipā River. The restoration and protection of the health and wellbeing of the Waikato River.

The Vision and Strategy is deemed part of the Waikato Regional Policy Statement²², and regional and district plans are required to give effect to it²³. The vision is for:

“A future where a healthy Waikato River sustains abundant life and prosperous communities who, in turn, are all responsible for restoring and protecting the health and wellbeing of the Waikato River, and all it embraces, for generations to come.”

Disposal of human sewage directly to water is offensive to taangata whenua, adversely impacting on spiritual values and the feeling of connection.

²¹ Ibid, s.3

²² Ibid, s.11

2.4 Current Wastewater Assets

There are seven municipal WWTPs currently servicing the Metro Area urban settlements: Ngaruawahia (servicing Taupiri, Hopuhopu, Ngaruawahia, Horotiu), Pukete (servicing Hamilton City), Te Kowhai, Mātangi, Tauwhare Pā, Cambridge and Te Awamutu. A network of strategic, trunk and local conveyance infrastructure (Interceptors, trunk mains, local reticulation, pump stations, storage facilities) manage and transfer wastewater from customers to the WWTPs.

In addition to the municipal WWTPs, there are many private systems servicing un-reticulated or un-serviced residential and industrial/commercial properties. The industrial/commercial properties serviced by private systems include the Waikato Regional Airport Precinct and Fonterra Hautapu (see Figure SC - 4:).

This DBC considers the seven municipal plants and the long-term servicing needs of the airport precinct. The long-list options assessment also considered long-term servicing of the Fonterra Hautapu plant. Other private facilities are not included in this study.

Table SC - 1: on the next page describes the municipal plants included in this DBC and their capacity, average peak flows and current performance standards. Further details on these plants and the conveyance systems discharging to the plants is included as Appendix A.

2.4.1 Pukete Wastewater Plant & Hamilton City Conveyance Network

Hamilton City is serviced through a network of local, trunk and strategic wastewater conveyance draining to the Pukete WWTP.

The Pukete WWTP is the largest plant in the Metro Area and services a residential population of more than 180,000 plus commercial and industrial activity (approximately 246,000 population equivalents²⁴.)

Figure SC - 5: Pukete Wastewater Treatment Plant



²³ Ibid, s.13(4)(b)

²⁴ Pukete Buildout Capacity Review, Beca, January 2021.

Table SC - 1: Current WWTP within the Metro Area

Metro WWTP	Type of plant	Current treatment capacity (m ³ /day)	Current average and peak flow (m ³ /day)	Consent expiry date	Plant performance
Ngaaruawaahia	Oxidation pond system, Actiflo and UV treatment. Treated effluent discharge to Waikato River	3,120	Avg. - 1,500 Peak - 4,500	31/03/2029	Following the construction of Stage II facilities and the ACTIFLO plant in 2014, the WWTP has been in full compliance with treated wastewater requirements.
Te Kowhai	System of septic tanks, followed by a re-circulating media system. Treated effluent discharge to land via soakage wells.	<100	Avg. - <100 Peak - <200	31/10/2033	Consent renewed for 15 year term in 2018.
Pukete	Activated sludge, Modified Ludzack Ettinger (MLE) moving toward 4-Stage Bardenpho, and UV treatment. Treated effluent discharge to Waikato River via diffuser.	60,000	Avg. - 10,400 Peak - 240,000	18/09/2027	High level of compliance (based on Annual Report 1 July 2019 - 30 June 2020) and 2018-19 annual audit.
Mātangi	System of septic tanks, followed by a re-circulating media system. Treated effluent discharge to land via irrigation.	<100	Avg. - <100 Peak - <200	30/09/2021	The WWTP is generally compliant. Waikato DC are in the process of securing a new discharge consent for Matangi for a term of 15 years. Planned and funded upgrades will be implemented to reduce TN in treated wastewater and improve land discharge area.
Cambridge	Anaerobic and Aerated lagoons, wetlands, Dosing for phosphorus removal, UV disinfection and discharge to rapid infiltration beds adjacent to the Waikato River	7,200	Avg. - 5,800 Peak - 10,000	Currently hold a short term (6 year) consent expiring 1 December 2026.	WWTP compliant with short term consent limits issued in 2020. However, the short-term consent conditions simply increased the allowable contaminant discharge limits for the plant to achieve compliance. Improvements in phosphorus and E.coli removal have been achieved, but no significant improvement in nitrogen removal has been achieved.
Te Awamutu	Activated sludge, five stages, UV treatment. Treated wastewater discharged to Mangapiko Stream via rock diffuser.	6,300	Avg. - 4,500 Peak - 16,200	30/06/2043	A high level of compliance with consent conditions has been achieved since 2012.
Tauwhare Pā	System of septic tanks, followed by a re-circulating media system then final disposal to land via irrigation	<100	Avg. - <100 Peak - <200	31/10/2035	The existing plant is near capacity and is currently breaching wastewater discharge quality consent limits. Limited ability to cater for increased flows.
Airport (private)	Very small treatment facility, sludge transported and managed at Cambridge.	<100	Avg. - <100 Peak - <200		In accordance with consent requirements.
Ngāruawāhia	Oxidation pond system, Actiflo and UV treatment. Treated effluent discharge to Waikato River	3,120	Avg. - 1,500 Peak - 4,500	31/03/2029	Following the construction of Stage II facilities and the ACTIFLO plant in 2014, the WWTP has been in full compliance with treated wastewater requirements.



The Pukete WWTP process is complex and involves primary, secondary and tertiary treatment stages. Treated wastewater (effluent) is discharged to the Waikato River via a diffuser and biosolids from the process are transported to a vermiculture facility in South Waikato.

The Pukete WWTP was commissioned in 1975/76 to replace the inadequate septic tanks used to manage wastewater from the city. Early concepts sited the WWTP on the banks of the Waikato River and identified surrounding land that should be either acquired for the plant or zoned to provide buffer zones around the site²⁵.

Through foresight and strategic investment, a large site was secured to provide space and buffer margins for a WWTP to serve a city of 300,000 people plus non-domestic flows and loads over time²⁶.

While the Pukete WWTP has served Hamilton City well and will continue to do so in the future, the site footprint does have an ultimate 'build-out' capacity. The ultimate population size that can be served at the site will depend on the treatment processes, adopted performance standards, and the ongoing build-out and development of the site. The build-out capacity of the plant has been assessed and informs this DBC, in particular the potential timing that flows from Hamilton City may need to be diverted to a second WWTP. Details of this assessment are included in Section 4.1 of the Economic Case.


Recent upgrades at Pukete aim to meet the short-term needs of the city until around 2028. A programme of further upgrades at Pukete WWTP is included in HCC's 2021-31 Long-term Plan (LTP) and 2021-51 infrastructure strategy based on status quo growth assumptions and treatment standards. Further investment will be required at Pukete to cater for growth and to contribute toward restoring and protecting the health and wellbeing of the Waikato River.

The strategic wastewater interceptors as shown in Figure SC - 6. These strategic interceptors have finite capacity, and the upper western interceptor is already constraining development in the western and southern extents of the city.

25 Sewage Treatment and Disposal for the City of Hamilton, Steven & Fitzmaurice, 1966

26 Hamilton City Comprehensive Development Plan, 1974

Figure SC - 6: Strategic interceptor network (HCC Long Term Infrastructure Strategy 2015-2045)

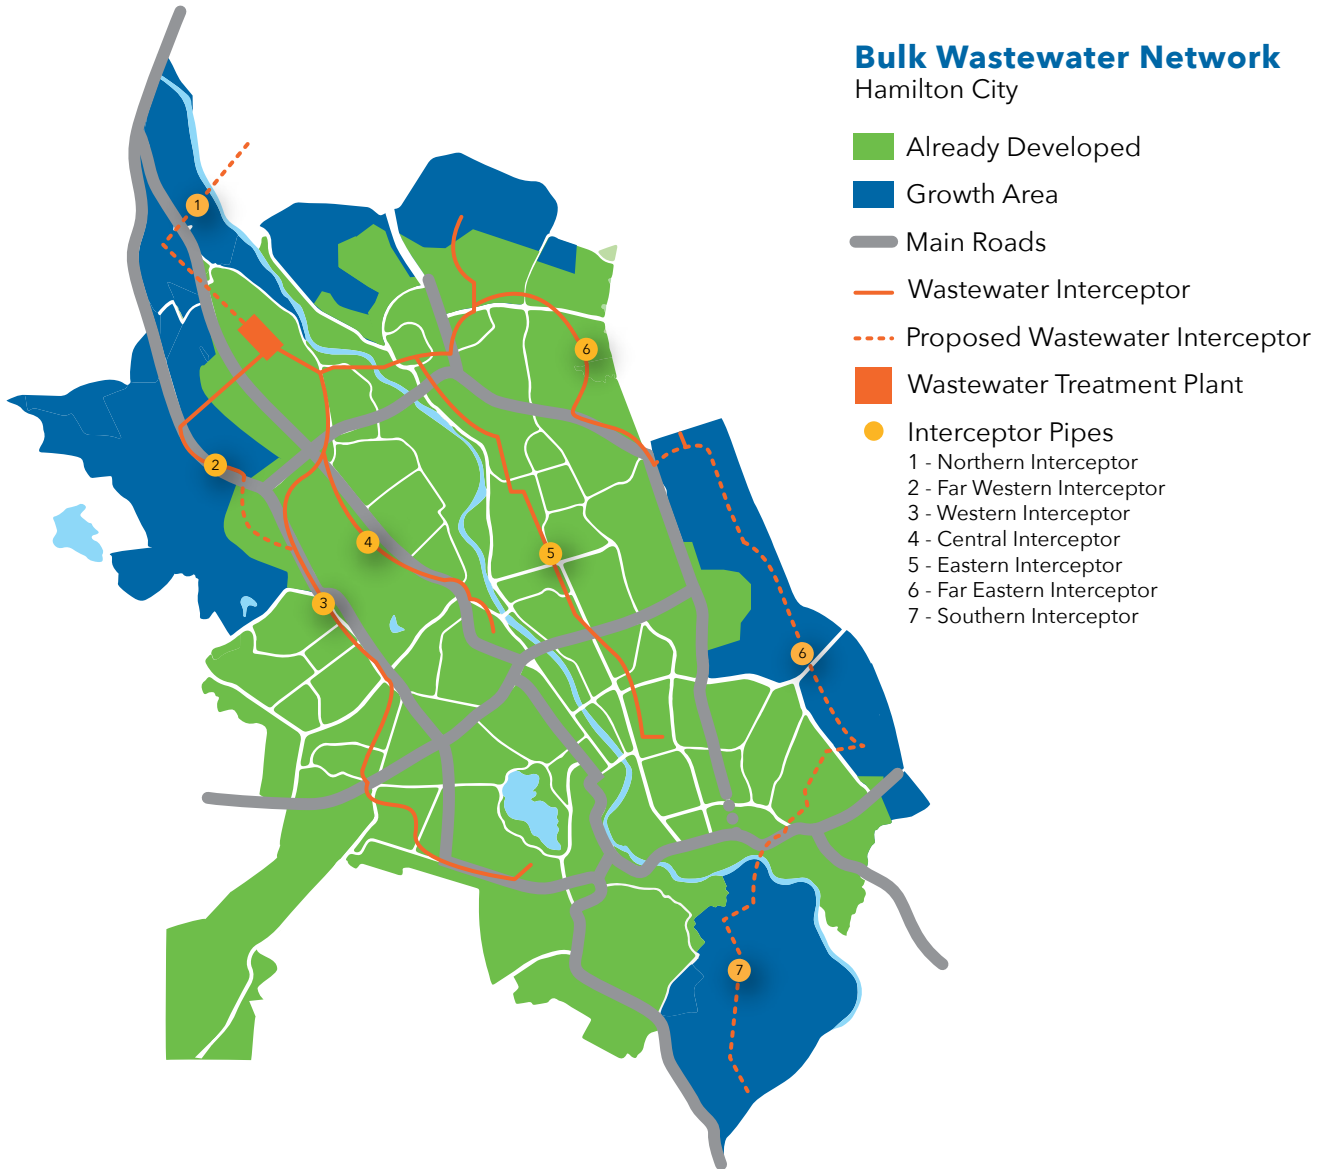


Dry weather flows into the network will increase as ‘brownfield’ intensification, infill and greenfield development occurs. Wet weather peak flows and their frequency will also increase as a result of more extreme rainfall events arising from climate change. These flow increases will place increasing pressure on the networks. Without appropriate investment in the conveyance networks there will be more frequent and larger scale network overflows to the environment.

Predicted network overflows at 2061 (based on 2015 growth projections) are shown in Figure SC - 7.

HCC has developed a conveyance network investment programme involving new interceptors, bulk storage facilities (particularly to manage wet weather flows and provide system resilience), trunk network upgrades, infiltration and ingress reduction programmes and asset renewals. However, the planned investment programme does not reflect the additional pressures and demand contemplated by Metro Spatial Plan (2020), the NPS-Urban Development, and the RMA (Enabling Housing) amendment Bill.

As demand increases more pressure will be placed on the conveyance network and a step change in investment in the conveyance network will be required. It is not uncommon for strategic wastewater conveyance costs (especially at a city-wide scale) to be equal to, or greater than, the capital cost of treatment facilities. There will be a trigger point at which it will be more efficient to invest in diverting flows to an alternative treatment location than upgrading the existing conveyance networks to the Pukete WWTP.

Figure SC - 7: Predicted network overflows at 2061 (based on 2015 growth projections)

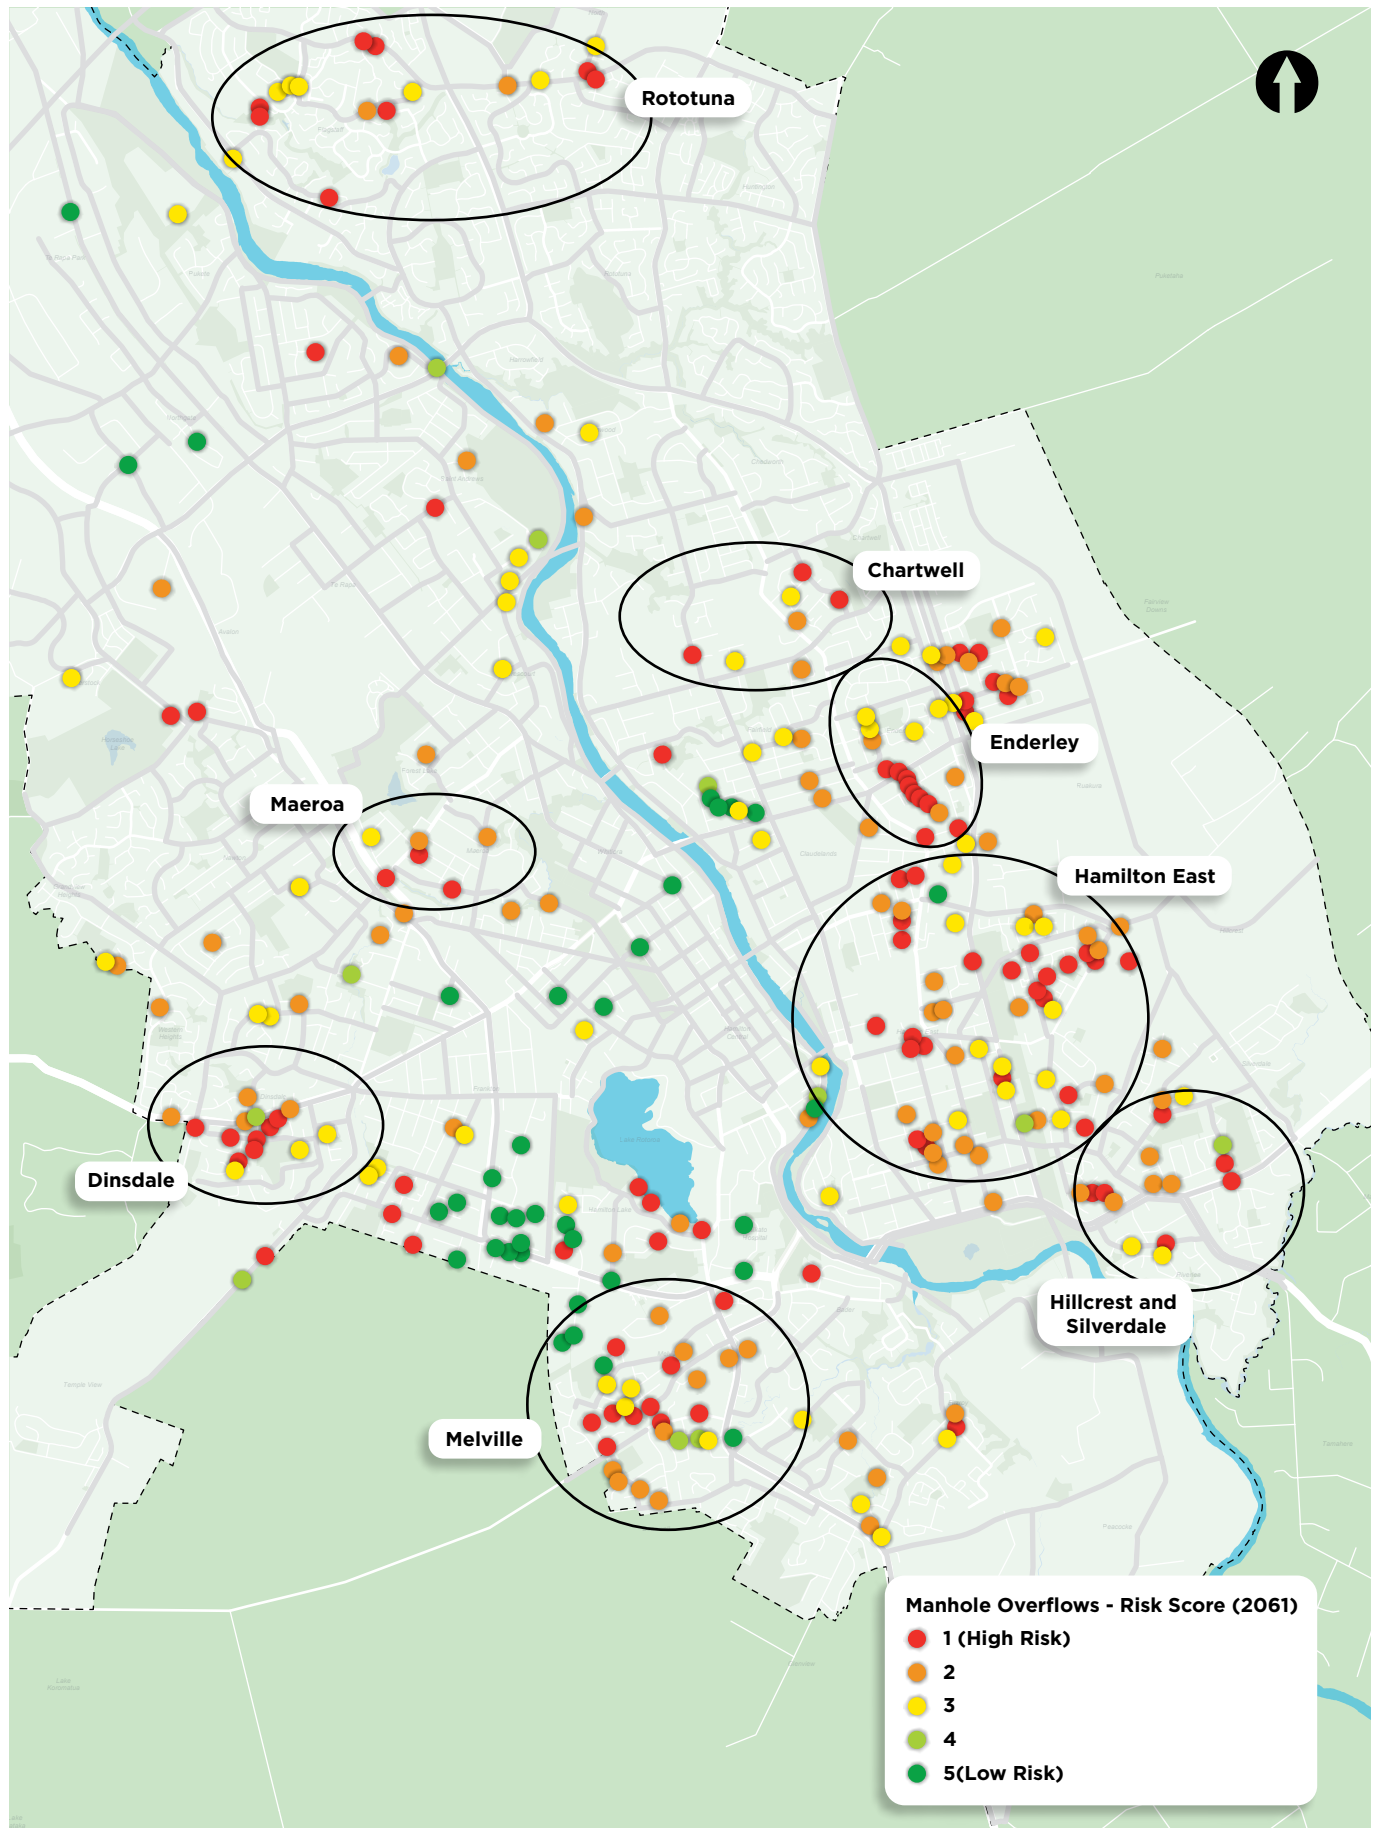

2.4.2 Ngaruawahia WWTP

The Ngaruawahia WWTP services the main township of Ngaruawahia and the communities of Hopuhopu, Horotiu and Taupiri. Wastewater is collected from the towns and pumped to the Ngaruawahia WWTP. The Ngaruawahia WWTP is located at Hopuhopu and comprises inlet screening, oxidation pond, solids removal (Actiflo), UV disinfection, gravel channels and a discharge to the Waikato River.

The Ngaruawahia WWTP is generally compliant with its current consent conditions; however transgressions can occur.

2.4.3 Airport Industrial Precinct Wastewater Services

The airport precinct including activities such as the Hotel, Airport terminal and ancillary activities, and the International Aviation Academy have been operating for many years. They are generally serviced by their own, on-site wastewater treatment and disposal systems, each of which will have a small treatment plant and an associated discharge to land. The industrial parks around the airport proper, such as Titanium Park, have been developing for the past 10 years or so. It is understood that the industrial park precincts are serviced by a combination of on-site systems and tankering of accumulated wastewater to Cambridge WWTP for treatment and discharge to the Waikato River.

2.4.4 Cambridge Wastewater System

The bulk of Cambridge wastewater is collected via a gravity reticulation system from domestic areas in Cambridge and Leamington, as well as wastewater from commercial/light industries in the central part of Cambridge. The wastewater is conveyed to the WWTP via a pipeline running along the south bank of the Waikato River. The WWTP also receives inflows from septage (septic tanker disposal), the Karapiro Water Treatment Works, St Peters School septic tank sludge, and trade waste from Inghams Chicken.

The treatment plant is a pond-based system with preliminary and primary treatment. Wastewater is screened on entry to the site, including grit removal. The wastewater then enters the anaerobic pond, which settles out the solids, and biologically degrades organic matter. A pumpstation pumps the partially treated wastewater over the aerated pond for secondary treatment. The aerated basin is hydraulically connected to the sedimentation tank (clarifier), the activated sludge settles at the bottom. The secondary treatment wastewater then flows onto the wetlands before discharging via a UV system onto the Rapid Infiltration Beds which ultimately discharge into the Waikato River.

The Cambridge WWTP has historically operated outside its consent conditions (nitrogen) for almost 20 years. In 2021, Waipā DC secured a short-term (6 year) consent to authorise a level of treatment that the plant can achieve without long-term upgrades. While the plant is now compliant, and improvements in phosphorus and E.coli discharge loadings have been achieved there has not been any vast improvement in terms of nitrogen.

2.4.5 Te Awamutu Wastewater System

The Te Awamutu Wastewater system is a gravity and pumped network system that collects wastewater from the Te Awamutu township, including Kihikihi and the Waikeria Prison. The trade waste composition of the system is considered minor.

The treatment plant consists of a grit channel, screening, Biological Nutrient Removal (BNR), transfer pumps, clarifier, tertiary filtration, UV disinfection, and rock filter before discharge to the Mangapiko Stream. AS per the current consent, the plant will be upgraded again in 2030.

2.4.6 Other Minor WW Systems

The other plants in the Metro Area are serviced by pond-based systems or other very small and basic treatment plants. Mātangi and Te Kowhai currently practice discharge of their treated effluent to land.

The Te Kowhai WWTP has had issues with its nitrate quality limits. The Mātangi WWTP is currently compliant with its consents.

Tauwhare Pā is serviced by a low pressure pumped sewer network discharging to a very small and basic treatment plants followed by land-based discharge.

Tauwhare Village, Ohaupo and Tamahere villages and surrounding rural residential land uses are serviced through private onsite wastewater systems.

2.4.7 Plant Performance

The performance of each plant is further discussed and investigated in Table SC - 1: and in Section 3.1.3.

2.5 Previous Investigations

This project builds on previous wastewater servicing investigations for the Metro Area. The most recent investigations relevant to this DBC are the Pukete Buildout Capacity Review (2021), Hamilton Metro Spatial Wastewater Feasibility Study (2020), Waikato Three Waters Sub-Regional Strategic Business Case (2019), Current State Report: Three Waters Sub-Regional Strategic Business Case (2019), and the Cambridge WWTP IBC (2019). All of these investigations aim to give effect to Te Ture Whaimana o Te Awa o Waikato: The Vision and Strategy for the Waikato River²⁷ by delivering ‘Best for River’ outcomes. The relevance of these investigations to this DBC are summarised in Table SC - 2: below.

In addition, a summary of other previous wastewater servicing investigations focussed on the Southern Metro area is included as Appendix A. This summary provides an overview of the scope and findings of these studies and also highlights the long-standing nature of wastewater servicing challenges in the Southern Metro Area.

Table SC - 2: Summary of previous wastewater servicing investigations and their relevance to DBC

Previous investigations	Relevance to the DBC
<p>Pukete Buildout Capacity Review Memorandum, Beca, 2021</p> <p>Client: Hamilton City Council</p>	<p>The memorandum records the high-level reassessment of the potential Pukete Wastewater Treatment Plant (WWTP) site buildout capacity to assess how future population growth and a more stringent effluent quality scenario could be accommodated at the site.</p>
<p>Hamilton Metro Spatial Wastewater Treatment Feasibility Study, 2020</p> <p>Client: Future Proof</p>	<p>This study was the most recent pre-cursor to this DBC. The assessment was developed collaboratively with local authority staff and iwi/mana whenua representatives.</p> <p>This feasibility assessment undertook a high-level comparative assessment of wastewater servicing areas to determine whether centralised wastewater servicing solutions for the Metro Area should be considered in more detail both as part of the Sub-Regional Three Waters Strategic Case and the Cambridge Wastewater Treatment Project.</p> <p>An initial list of 13 concepts and 120 variations were identified, ranging from centralised facilities for the entire metro area to decentralised solutions. This list evaluated and refined to six concepts included in the final assessment.</p> <p>The preferred concept was to have two metro wastewater facilities: a northern site (the existing Pukete site in Hamilton) and a southern site (new site), as well as keeping the existing Te Awamutu plant.</p> <p>This shortlist of metro options identified through the Feasibility study have provided the starting point for the options considered and further developed as part of this DBC.</p>


²⁷ Te Ture Whaimana o Te Awa o Waikato: The Vision and Strategy for the Waikato River is the primary direction setting document for the Waikato River and its catchments. It calls for an integrated, holistic and co-ordinated approach to the management of the natural, physical, cultural and historic resources of the Waikato River, and the restoration and protection of the health and wellbeing of the Waikato River. There are also significant expectations for swimming and fishing in the wider community.

Previous investigations	Relevance to the DBC
<p>Waikato Three Waters Sub-Regional Strategic Case, 2019 (part of the Sub-regional Three Water Programme (ongoing))</p> <p>Client: Future Proof</p>	<p>This Waikato Sub-Regional Three Waters Strategic Business Case (Strategic Case) sets out the case for change in urban water management in the Waikato and Waipā River catchment.</p> <p>Changes are needed because of:</p> <ul style="list-style-type: none"> • increasing freshwater water quality standards and the desire for Best for River environmental and social outcomes • forecast population increases and changes in land use • the need to deliver services more efficiently • concerns around community affordability. <p>The problems and opportunities identified in the Strategic Case are directly relevant to this DBC and have been used for this DBC as a guide to explore and describe specific problems and opportunities associated with wastewater servicing in the Metro Area. The approach taken in this DBC has sought to respond to the problems identified in the Strategic case.</p> <p>The vision and objectives established in the Strategic Case are also relevant to this DBC and have informed the vision and objectives developed in this DBC.</p> <p>The strategic business case is part of the Sub-Regional Three Waters Project, which responds to Te Ture Whaimana o Te Awa o Waikato – the Vision and Strategy for the Waikato River, Future Proof objectives, and national and regional policy directives.</p>
<p>Three Waters Current State Report, GHD & BECA, 2019</p> <p>Client: Future Proof</p>	<p>This report provides an evidence base for existing problems with three waters servicing for urban settlements in the Hamilton to Auckland Corridor. Provides an evidence base to support the Waikato Three Waters Sub-Regional Strategic Case, 2019</p> <p>The report documents the current state of wastewater treatment infrastructure within the Hamilton to Auckland Corridor including treatment capacities, performance standards and existing consent compliance.</p>
<p>Cambridge WWTP Indicative Business Case, 2019</p> <p>Client: Waipā District Council</p>	<p>The Cambridge Wastewater Treatment IBC was first undertaken to identify a long-term solution to the currently non-compliant WWTP at Cambridge. The IBC was led by Waipā District Council and collaboratively progressed with Iwi partners, Hamilton City Council and Waikato Regional Council. This work also provided an interim consent while Waipā District Council investigated and implemented a long-term solution that addressed all underlying problems.</p> <p>As part of this process, a number of short-term upgrades were commissioned to the existing plant. Long term upgrade options were also explored, including a long term joint sub-regional solution for the Southern Metro Area, which serviced Hamilton City Council and delivered a significant upgrade to the current WWTP. However, the impacts of a southern centralised treatment plant on the future planning of the surrounding areas was not evaluated as part of this study.</p> <p>It is critical to bring the plant up to a compliant level to reduce annual operating and maintenance costs over time and to support future planning. The plant needs to achieve considerably higher standards, particularly in relation to Nitrogen removal, to meet its consenting conditions. Significant action is required to achieve optimal outcomes and ensure future development plans and the Te Ture Whaimana strategy and vision are achieved.</p>

2.6 Relevant Policies, Regulation and Plans

National and regional policies, plans and strategies relevant to this DBC are in Figure SC - 8: below. High-level commentary on the relevance of the policies, plans and strategies to this project is included in Appendix B.

Figure SC - 8: Existing strategies tree diagram

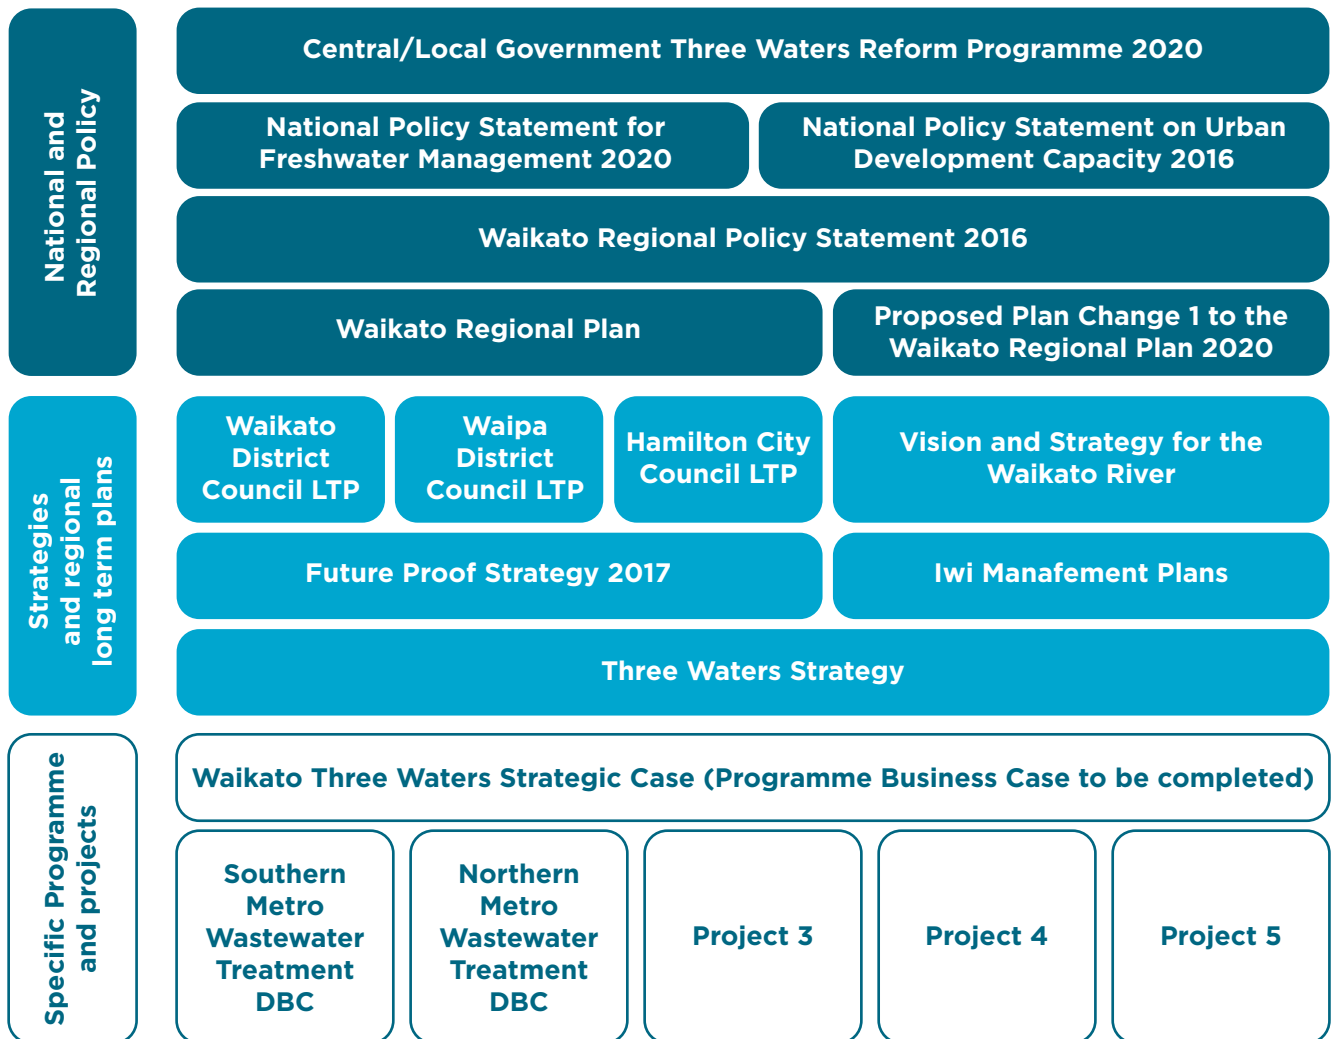

Key strategies that outline the collective vision, regional plan and targets for Waikato River water quality are further detailed in Appendix B: Relevant policies, regulation and plans.

2.7 Population and Land Use Assumptions

Hamilton City is the largest population centre in the sub-region with a population of around 181,500 people as at 2021²⁸. It is the fourth most populous and one of the fastest growing cities in New Zealand. Projections indicate that this growth is set to continue for the foreseeable future.

Waipā district has a population of around 58,300 as at 2021²⁹, largely living in the district's two well-founded towns – Cambridge and Te Awamutu. The Waikato district has a population of around 84,300³⁰ as of 2021. The district is projected to continue to experience strong growth, particularly in the main urban areas.

The existing pattern of urban growth in the Metro Area comprises of infill, brownfield and greenfield development. The majority of infill and brownfield developments are located in Hamilton city, while greenfield development at various scales occurs across the entire Metro Area. Job growth generally occurs in existing centres and identified employment areas.

Both residential and non-residential population and growth assumptions are fundamental inputs to this DBC. They have been used to determine the indicative scale and timing of new conveyance systems and wastewater treatment plants and when upgrades are required for existing treatment plants. The sources and process for developing the growth assumptions used for this DBC are detailed in Growth Assumptions for Population and Growth Assumptions Memorandum³¹.

The projected population and economic growth within the Metro Area requires an appropriate infrastructure servicing response. Servicing will require significant capacity increases through new or upgraded networks and plants. Not providing adequate infrastructure capacity will constrain the sub-region's growth potential. This will likely have a negative economic impact with potential developers, employers and businesses looking elsewhere for expansion opportunities.

2.7.1 General

This DBC uses population equivalence (PE) to understand existing wastewater servicing issues and constraints and to develop servicing solutions. PE is the equivalent wastewater flow or load from one person. It is made up of residential and non-residential components.

2.7.2 Residential Landuse

Projected residential population growth for each of the communities (and rural/residential areas) within the Metro Area is shown in Figure SC - 9. The projections are in 10-year horizons from 2021 to 2061. An ultimate figure is also provided (based on projected land use development at 2019).

The NPS-UD seeks to encourage, and in some cases require, higher density residential development to occur in urban environments³², in locations which are close to centres and in locations that are accessible by active or public transport.

Under the NPS-UD, Ngaaruawaahia and Hamilton meet the definition of Tier 1 urban environments. Cambridge, Te Awamutu, Kihikihi and Pirongia meet the definition of Tier 3 urban environments. This means there are requirements to enable intensification in certain locations in these settlements.

The growth assumptions used for this DBC have not fully considered the implications of the NPS-UD which has the potential to enable increased rates and scale of growth in the Metro Area. Responding to growth enabled by NPS-UD may require earlier and larger scale investment than indicated (with respect to conveyance and treatment) and should be considered as part of detailed design investigations.

28 NIDEA, 2021. Population (Low, Medium and High) 2018 projection outputs.


29 NIDEA, 2021. Population (Low, Medium and High) 2018 projection outputs.

30 NIDEA, 2021. Population (Low, Medium and High) 2018 projection outputs.

31 GHD, Beca, Oct 2020. Growth Assumptions for the Waikato Metro Wastewater DBC Memorandum.

32 The NPS-UD defines urban environments as being any area of land (regardless of size, and irrespective of local authority or statistical boundaries) that (a) is, or is intended to be, predominantly urban in character; and (b) is, or is intended to be, part of a housing and labour market of at least 10,000 people.

Figure SC - 9: Projected population growth in the Metro Area³³

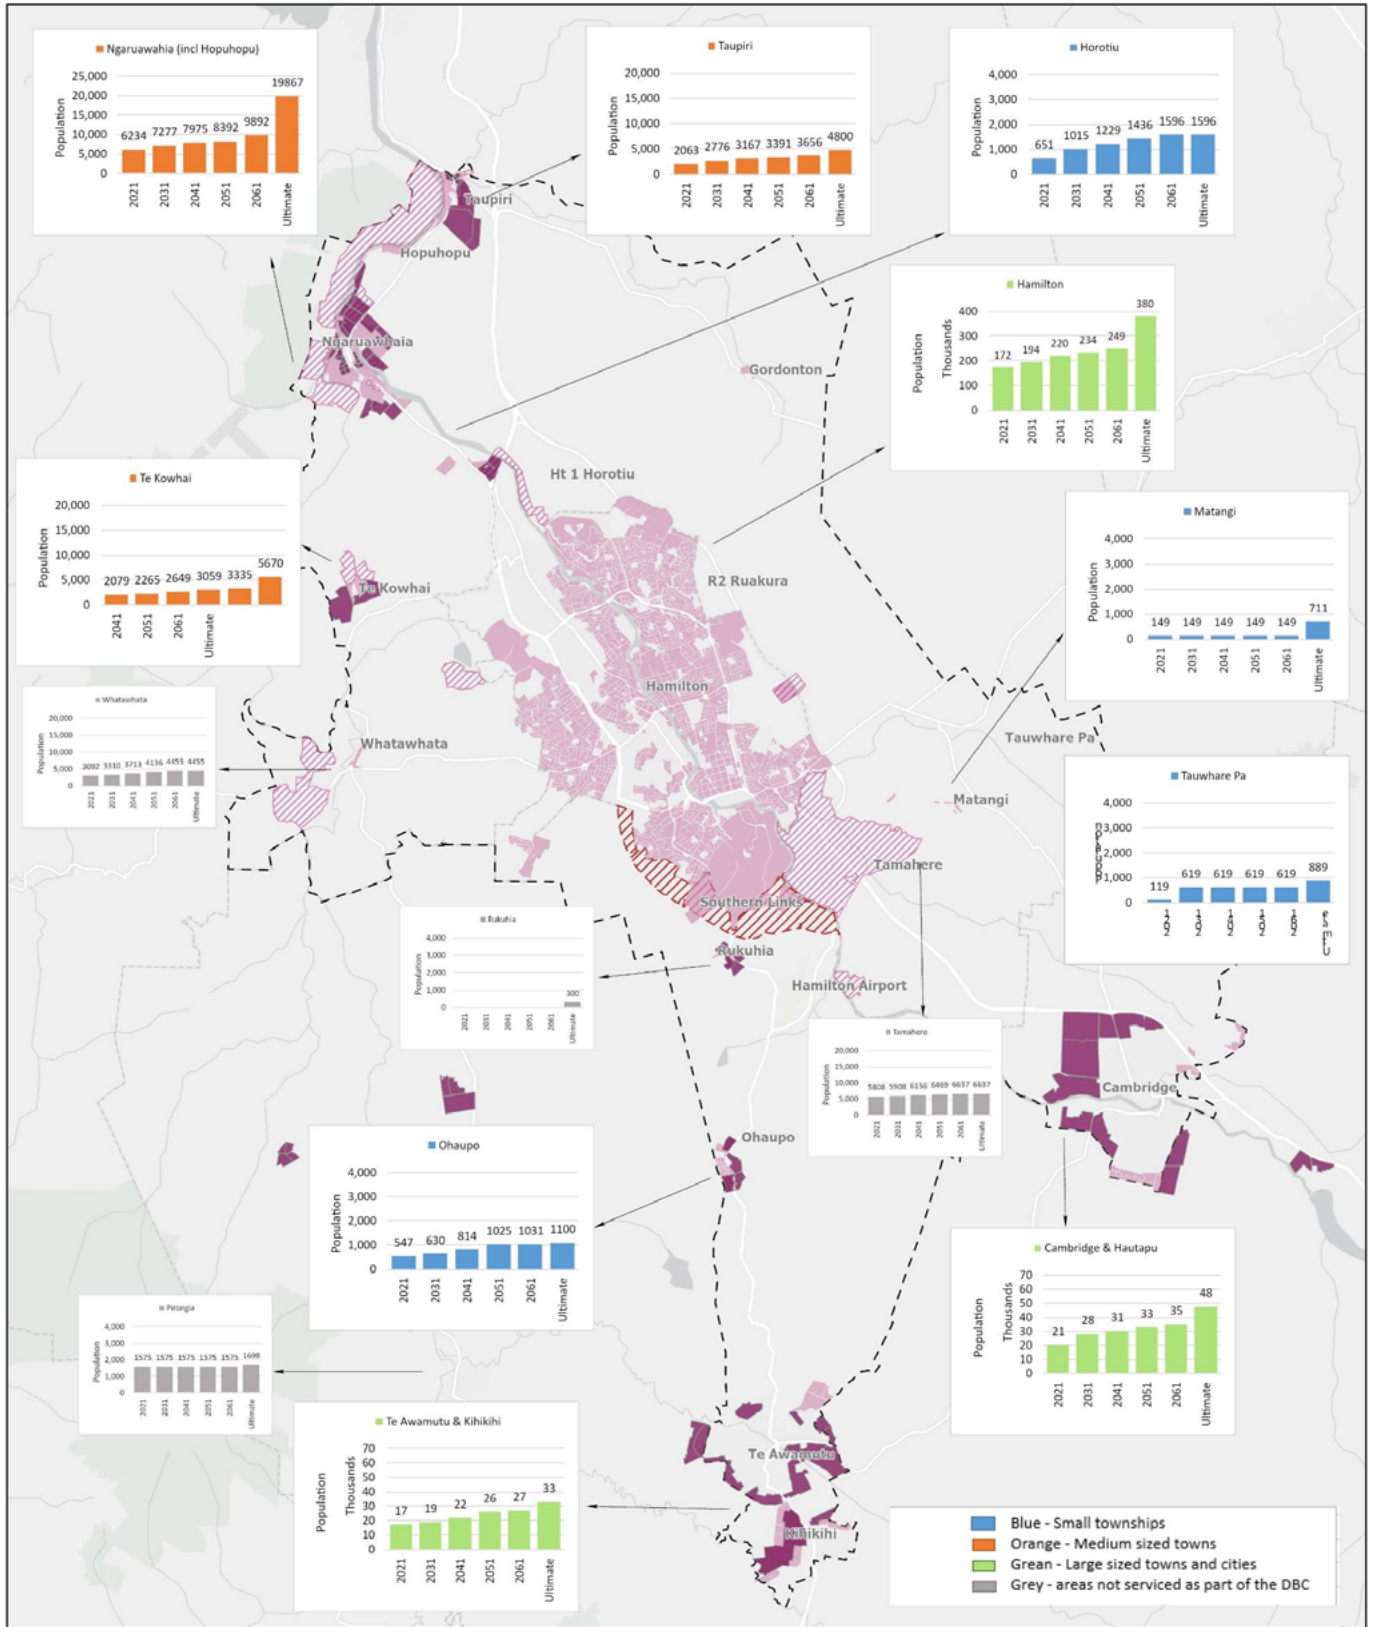

³³ GHD, Beca, 2020. Growth Assumptions for Waikato Metro Wastewater DBC. Hamilton City Council.

The projected residential population for each of the communities considered in this DBC are shown in Table SC - 3.


Significant increases in residential populations are expected in in Taupiri, Ngaruawahia, Te Kowhai, Hamilton, Cambridge and Te Awamutu. Smaller rural communities are currently expected to have very limited or static growth.

Table SC - 3: Residential population assumptions³⁴

Area	2021	2031	2041	2051	2061	Ultimate
Taupiri	2,060	2,780	3,170	3,390	3,660	4,800
Ngaaruawaahia (incl Hopuhopu)	6,230	7280	7980	8390	9890	19,870
Horotiu	650	1,020	1,230	1,440	1,600	1,600
Te Kowhai	2,080	2,270	2,650	3,060	3,330	5,670
Mātangi (including Tamahere Hub)	150	150	150	150	150	711
Tauwhare Pa	120	620	620	620	620	890
Hamilton	171,610	194,190	219,740	234,190	248,650	380,000
Out of boundary areas	N/A	N/A	N/A	N/A	N/A	60,000
Ohaupo	550	630	810	1,030	1,030	1,100
Cambridge (incl Hautapu and Karapiro)	20,520	28,310	30,540	33,010	35,140	47,760
Te Awamutu & Kihikihi	17,490	19,160	22,070	26,150	27,170	33,180

Projections for the communities not included in this DBC are in Appendix A (i.e. Gordonton, Whatawhata, Tamahere Country Living Area, Rukuhia, Pirongia).

Figure SC - 10: Hamilton City population growth projections NIDEA 2018

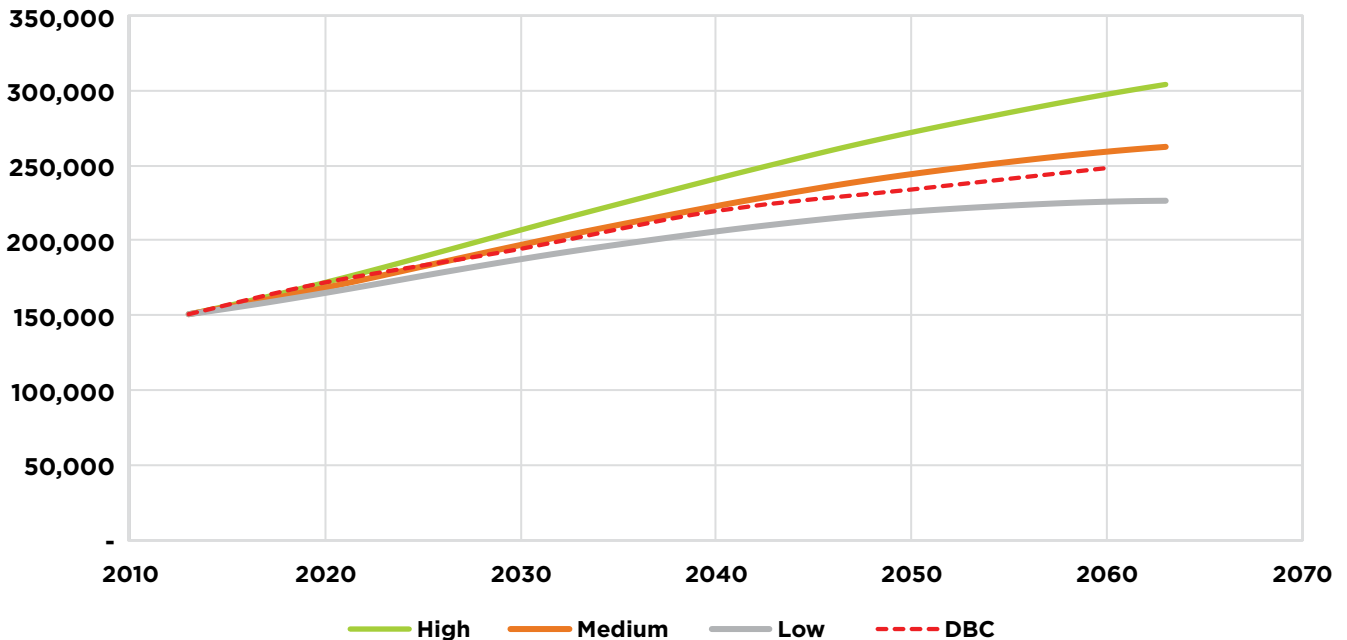

Waipā and Waikato District residential growth projections are based on the mid-point NIDEA projections while Hamilton City growth projections are based on the low projection with additional allowance for infill as identified in the Hamilton Waikato Metro Spatial Plan. For Hamilton City, the low NIDEA population forecast in 2060 is 226,000, and the medium forecast is 259,000, a difference of 33,000. The DBC has adopted the low NIDEA population forecast of 226,000, with additional allowance

34 GHD, Beca, Oct 2020. Growth Assumptions for the Waikato Metro Wastewater DBC Memorandum.

for infill of 18,000 in 2060 (and 72,000 for the city full scenario), giving a total of 244,000. As shown in Figure SC - 10: the difference between this adopted forecast and the medium NIDEA forecast is relatively minor. The assessment criteria for flexibility and adaptability (KPI 5.1) of solution considers the ability of servicing solutions to be staged/developed over time to meet the needs of the community including the potential to service higher or lower demands.

It is recognised that since this work was undertaken, NIDEA has rebased and updated its projections to reflect the COVID 19 pandemic. On the new series, all territorial authorities are using the new NIDEA high growth projections, which are reflected in the Future Proof Strategy.

2.7.3 Non-residential Growth

Providing enough serviced land for non-residential land uses is a key aspect of growth management and growing the economy of the Future Proof sub-region.

Existing non-residential land uses that generate significant wastewater demand include industrial, commercial, business areas.

The strategic industrial locations where greenfield industrial growth is expected to occur includes Horotiu/Te Rapa North/Rotokauri, Ruakura/Ruakura East, Hamilton Airport/Southern Links, and Hautapu (table 2).

Key commercial and business areas include Hamilton City Centre³⁵; specialised centres³⁶, Metropolitan centre³⁷, and town centres across Hamilton City.

Wastewater generated from these existing non-residential activities, and their demand on the network and plants, are captured through existing trade waste agreements (which include flow and load limits) or through applying appropriate population equivalent (PE) design assumptions.

Future demand on the networks is assessed based on anticipated demand for non-residential land and appropriate PE design assumptions.

The demand for industrial land in the Metro Area is projected to be 411 hectares over the next 10 years, increasing to 752 hectares over the next 30 years³⁸. Current capacity (i.e., industrial land currently zoned for development) is in excess of 1,250 hectares.

A summary of the available industrial demand and capacity information from the study is provided in Table SC - 4. This analysis pre-dates the Future Proof Housing and Business development capacity analysis that is shown in the draft Future Proof Strategy.

Table SC - 4: Industrial demand and capacity in the Metro Area³⁹

Location	2020-2030 hectares	2020-2050 hectares	Capacity in current zones
Ngaaruawaahia / Hopuhopu	4	10	39
Taupiri / Horotiu / Te Kowhai	44	102	194
Hamilton	318	524	659
Airport	6	17	104
Cambridge	27	72	205
Te Awamutu	12	28	49

³⁵ The Hamilton central city area is the primary commercial, employment, recreational and civic hub with a strong residential function which is provided at a regional scale. This centre contains significant office, retail and other commercial activities, education facilities including the WINTEC campus, a vibrant arts and museum precinct, central library and public squares. It has the greatest diversity, scale and intensity of activities in the metro area.

³⁶ Waikato Hospital and Waikato University are the two identified specialised centres in the Future Proof sub-region and form important employment areas and provide essential specialised services.


³⁷ five centres expected to grow into metropolitan centres over the course of time are Te Rapa, Chartwell, Ngāruawāhia, Cambridge and Te Awamutu. Hopuhopu is located near to the Ngāruawāhia township. It is envisioned that it will strengthen its role as the headquarters of Waikato Tainui and the home of the Waikato-Tainui Endowed College.

³⁸ Future Proof Industrial Land study (GMD March 2020)

³⁹ GHD, Beca, Sept 2020. Growth Assumptions for the Waikato Metro Wastewater DBC Memorandum.

The geographic extents of current non-residential land use zoning is shown in Figure SC - 11.

Figure SC - 11: Non-residential land use zoning

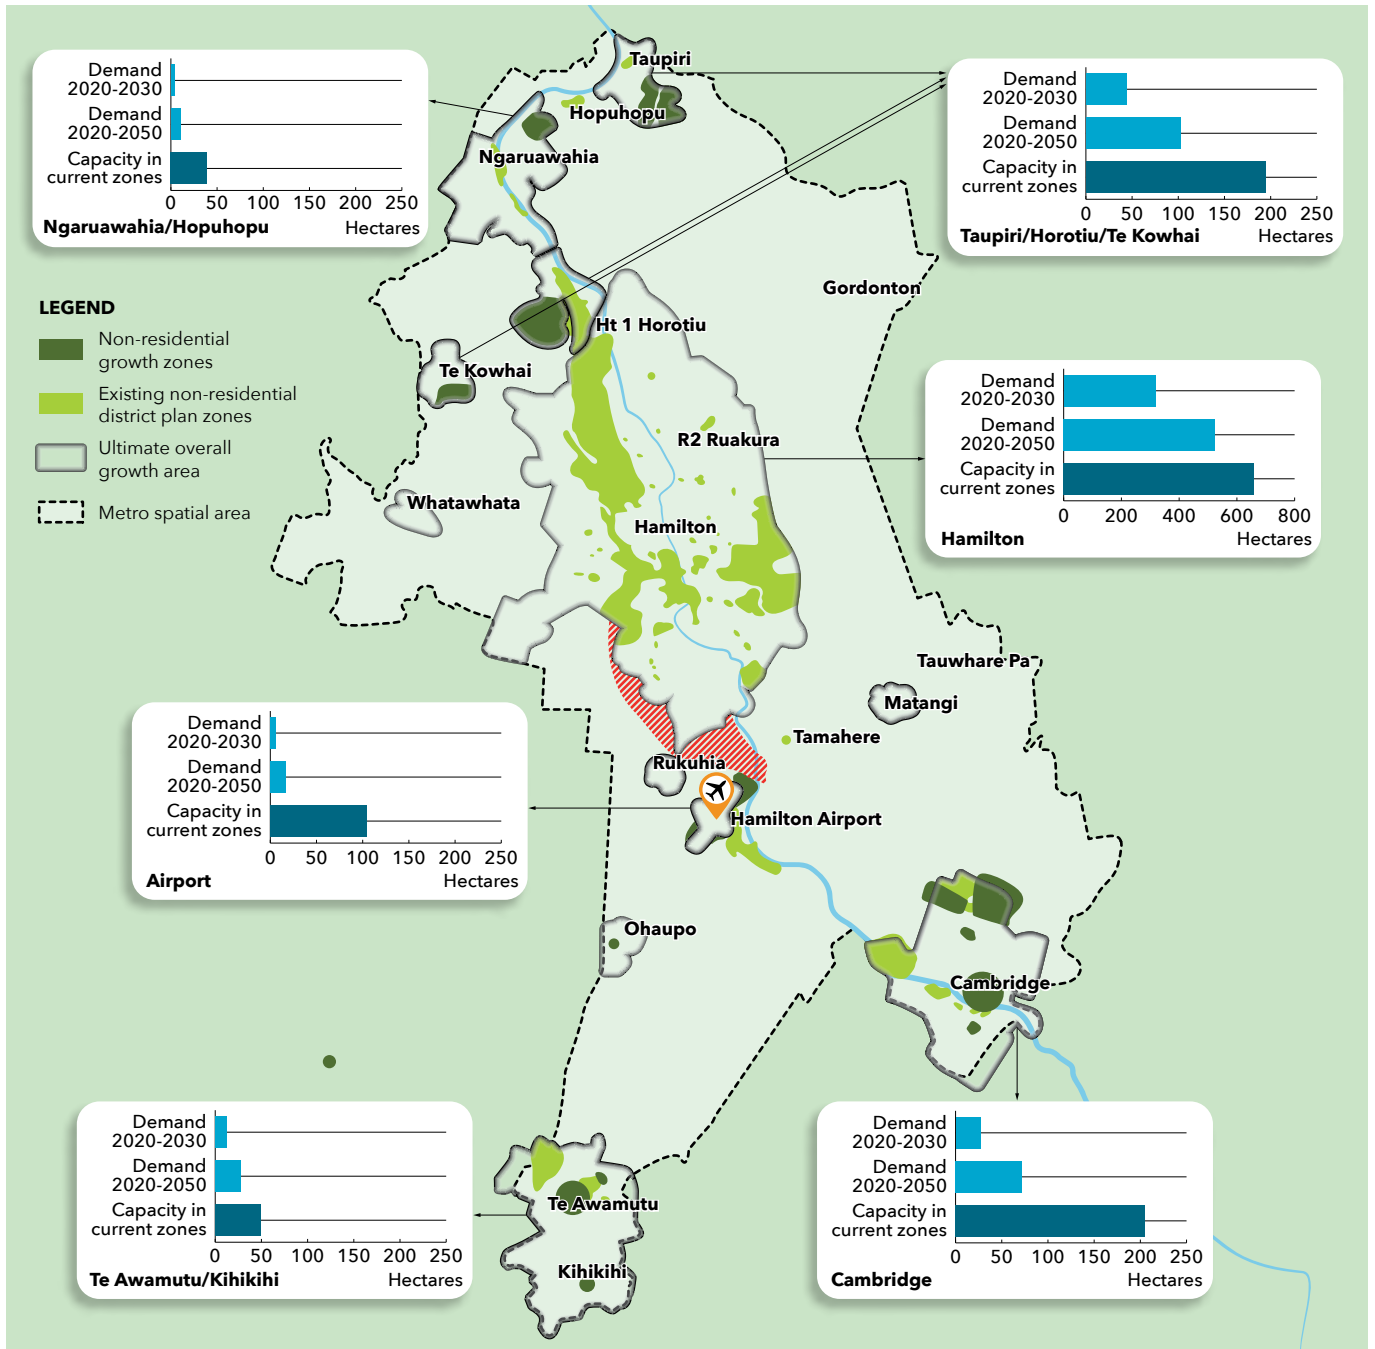

2.7.3 Wet Industrial Activities

At present, the Metro Area local authorities do not specifically plan for, or design infrastructure to include capacity for new wet industrial (or high-water use) activities. This DBC, alongside relevant land-use planning projects, provides an opportunity to implement more integrated and considered infrastructure planning approaches.

While the portion of industrial land capacity to be allocated to wet industries is uncertain, on an area basis it is expected to be small. The servicing of new high-water users (wet industry) will be partially limited by water allocation and WWTP network capacity, rather than land capacity unless there are changes to the water allocation regime under the Waikato Regional Plan.

This DBC has included for wet industrial activities concentrated in:

- Te Rapa North
- Ruakura
- Airport
- Near the existing Cambridge WWTP.

2.7.4 Hamilton City Growth

A more detailed breakdown of population equivalent projections which includes both residential, commercial and industrial inputs within Hamilton City is shown in Figure SC - 12. These have been sourced from the Hamilton City Wastewater Master Plan (Version 3), 2020. The population growth information will be used to determine the expected flows to be treated at the existing Pukete WWTP which, due to the significant growth in Hamilton City is likely to put greater capacity constraints on the Pukete WWTP within the next 5 to 10 years.

Greenfield development areas such as Ruakura, Te Rapa North, and Rotokauri will require additional wastewater reticulation infrastructure for industrial (and potential wet industry) purposes. Without this type of infrastructure, the area will not be able to reach its full development and employment potential. Other greenfields growth areas, such as Temple View and Peacockes, will focus on residential development, increasing population densities.


Table SC - 5: Hamilton City population equivalence growth estimates⁴⁰

Growth Cell	2021	2031	2041	2051	2061	Ultimate
Te Rapa North	1,167	9,073	9,677	10,280	10,884	15,898
Ruakura	6,816	10,127	13,965	17,014	25,697	28,769
Peacockes	1,346	6,532	14,161	18,648	25,489	25,607
Temple View	2,031	2,681	3,550	4,419	5,289	15,860
Rotokauri	2,897	9,129	9,567	19,913	21,570	31,624
Rototuna	10,433	15,165	15,068	14,972	14,875	15,284
WA	0	0	0	0	0	1,000
HT1	0	0	0	0	0	33,591
R2	179	179	179	0	1,048	9,450
East of Ruakura						30,000
Southern Links						35,000
MSP Additional Infill		2,311	6,934	11,557	16,180	72,278
Hamilton (brownfields)	217,377	231,480	239,636	253,447	254,244	339,475
TOTAL	242,246	286,677	312,737	350,250	375,276	653,836

A number of potential future growth areas are not included in the wastewater model currently. These include Southern Links to the south of Peacockes, and R3 to the east of Hamilton. These areas also have an 'ultimate' population equivalence estimate.

⁴⁰ GHD, Beca, Oct 2020. Growth Assumptions for the Waikato Metro Wastewater DBC Memorandum.

Figure SC - 12: Population equivalence growth in the Hamilton City

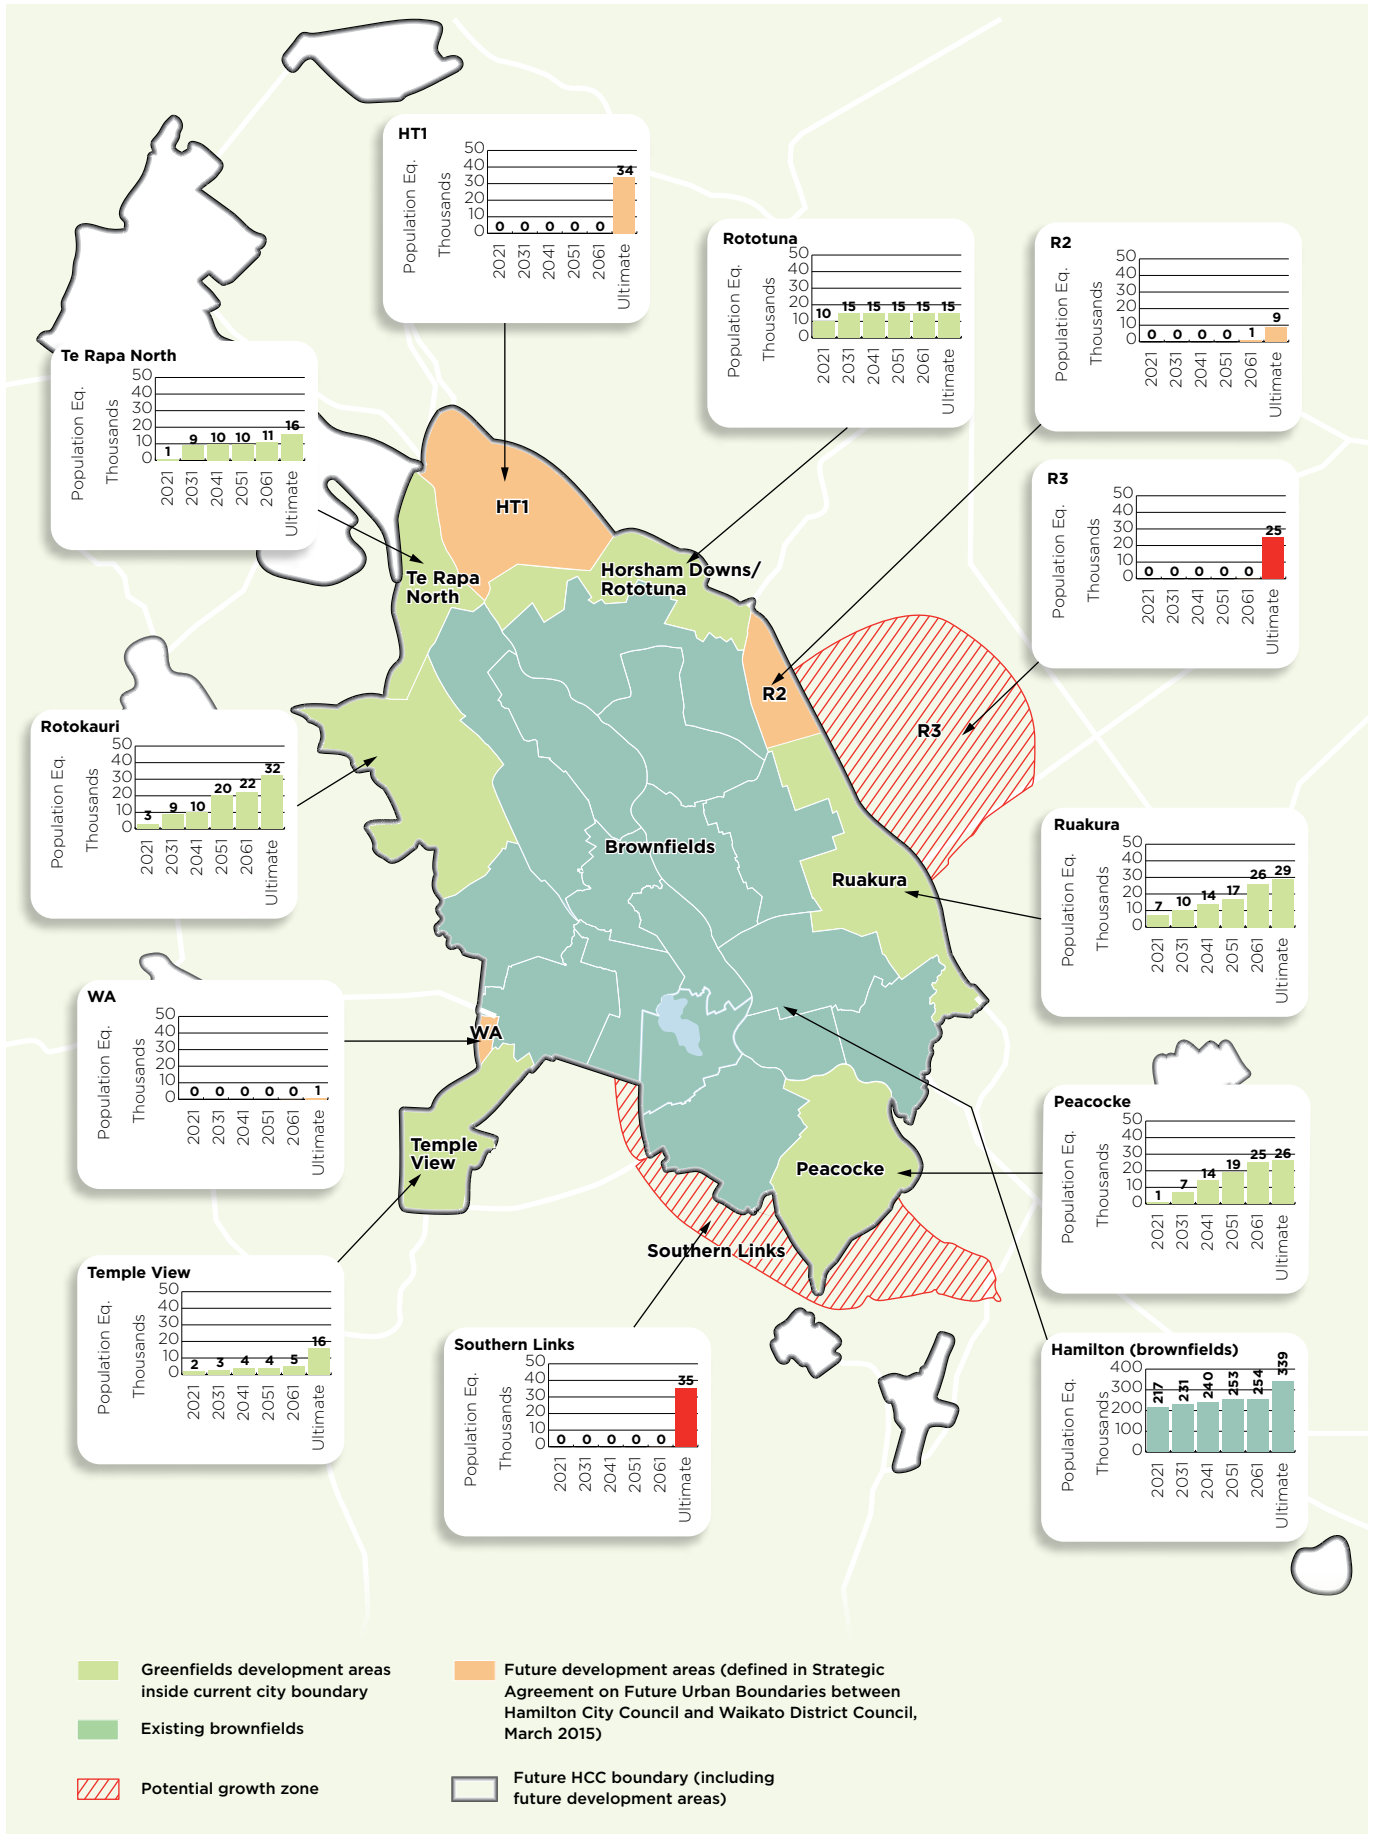

3. Case for Change

This section sets out the case for investment in wastewater treatment services for the Metro Area. It summarises the scale and significance of key problems and drivers for change, including misalignment between the current state and desired future state.

This DBC refines and builds on the Sub-Regional Three Waters case for change, providing more detailed evidence of the specific issues associated with wastewater treatment in the Metro Area and in particular the southern area. The DBC evaluates a long list of strategic wastewater servicing options and identifies an options shortlist for the full (northern and southern) Metro Area. The assessment and evaluation then focuses in on and identifies a preferred option for the Southern Metro Area. A DBC is currently underway to confirm the preferred option for the Northern metro area.

The option development and assessments (refer to the Economic Case) seek to give effect to Te Ture Whaimana o Te Awa o Waikato: The Vision and Strategy for the Waikato River⁴¹ and the growth aspirations of the Metro Area and in doing so deliver 'Best for River, Best for Community' outcomes.

3.1 Problem Development

The issues identified in the Waikato Sub-Regional Three Waters Strategic Case (2019) were consolidated into four programme level problem statements. The programme problem statements are relevant to wastewater management within the Metro Area.

These problem statements have been agreed with partners and stakeholders and have been adopted (endorsed by the Governance Group). The programme problem statements are significant and relate to systemic issues where change is needed to deliver enduring improvements in three waters management and achieve "Best for River" outcomes.

The relevance of each problem statements to wastewater treatment within the Metro Area are summarised below in Table SC - 6. Supporting evidence is also outlined on the next page.

⁴¹ Te Ture Whaimana o Te Awa o Waikato: The Vision and Strategy for the Waikato River is the primary direction setting document for the Waikato River and its catchments. It calls for an integrated, holistic and co-ordinated approach to the management of the natural, physical, cultural and historic resources of the Waikato River, and the restoration and protection of the health and wellbeing of the Waikato River. There are also significant expectations for swimming and fishing in the wider community.

Table SC - 6: Programme problem statement and relevance to the project

Problem	Programme Problem Statement	Relevance to Wastewater Treatment within the Metro Area
Problem One	<p>Lack of integrated catchment management and urban waters long-term planning, founded on:</p> <ul style="list-style-type: none"> • a common vision and agreed future outcomes unconstrained by territorial boundaries • the application of both Maatauranga Māori and conventional science methods, and • appropriate funding provisions <p>is resulting in inefficient near-sighted decision making and degraded health and well-being of the Waikato River.</p>	<p>This problem relates to a lack of consistent and integrated land and water management practices, which has led to reactive and short-sighted wastewater infrastructure decisions.</p> <p>Development and land use changes often occur without full appreciation of the impacts on wastewater infrastructure and the investment needed to provide capacity for long-term growth.</p> <p>As a result, existing wastewater infrastructure is expected to cater for unforeseen or unplanned flows and growth. The impact of these short-sighted and unplanned investment decisions are further evidenced in problem two.</p>
Problem Two	<p>Historic land confiscations coupled with inconsistent, short-term and parochial regulatory, planning and investment decisions on land use and urban water resource management have contributed to:</p> <ul style="list-style-type: none"> • cultural disconnect, • degraded water quality, • poor ecosystem health and over allocated resources. <p>As a consequence, the relationships and aspirations of communities with the Waikato River and the ability of Waikato River iwi to exercise mana whakahaere or conduct their tikanga and kawa have been severely compromised.</p>	<p>Problem two further investigates how short-sighted and reactive investment decisions have affected river water quality, river ecosystems and contributed to the cultural disconnect.</p> <p>Currently individual councils react to wastewater issues as they occur, making it difficult to apply consistency and planned decision making to the wider wastewater treatment network.</p> <p>This means some wastewater treatment facilities are consistently falling short of environmental and cultural standards and impacting the health and wellbeing of the river.</p>
Problem Three	<p>Reactive infrastructure planning practices coupled with:</p> <ul style="list-style-type: none"> • light-handed regulation and compliance • inconsistent management practices, standards and performance expectations <p>has led to variable urban water system performance across the region and has adversely impacted the health and well-being of the Waikato and Waipā Rivers.</p>	<p>Reactive infrastructure planning practices are evidenced in problem statements one and two.</p> <p>This problem focuses on the issues of regulation, compliance and inconsistent and changing practices, standards and performance expectations across the three councils concerning the treatment of wastewater and how this has led to variable performances of WWTPs.</p>
Problem Four	<p>The legacy of under-investment in urban water systems coupled with:</p> <ul style="list-style-type: none"> • infrastructure reaching end of life • increasing regulatory requirements • environmental expectations • climate change impacts • greater growth demands <p>has created a significant investment deficit resulting in unaffordable current and future costs for new infrastructure, maintenance and operations and human capacity and capability challenges within the waters sector.</p>	<p>This problem further investigates issues related to affordability, ageing infrastructure and assets, climate change impacts and growth and capacity impacts. All have led to a wastewater infrastructure deficit across the Metro Area.</p>

The remainder of this section provides evidence to support the scale and significance of the four problem statements related to the Metro Area.

3.1.1 Problem Statement One

Lack of integrated catchment management and urban waters long-term planning, founded on a common vision and agreed future outcomes that are unconstrained by territorial boundaries, the application of both Maatauranga Māori and conventional science methods, and appropriate funding provisions is resulting in inefficient near-sighted decision-making and degraded health and well-being of the Waikato River.

Cause: Lack of integrated catchment management and urban waters long-term planning, founded on a common vision and agreed future outcomes that are unconstrained by territorial boundaries, the application of both Maatauranga Māori and conventional science methods, and appropriate funding provisions.

As highlighted in the national Case for Change: Transforming the System for Delivering Three Water Services⁴², the lack of integrated catchment management and urban waters long term planning is not unique to the Metro Area. The national Case for Change summarises the current situation as:

“While there are pockets of good performance, in many parts of the country communities cannot be confident that their drinking water is safe, that the three waters sector is achieving good environmental outcomes, that it can accommodate population and housing growth, that the rights and interests of iwi/Māori are being upheld, and that climate change and natural hazard risks are being successfully managed.”

The lack of integration can be partly attributed to the number of territorial boundaries, which have limited integrated catchment planning of wastewater activities. This has resulted in variable wastewater system design objectives, standards, performance and consent compliance.

Currently in the Metro Area each individual council provides wastewater management services for their districts largely in isolation from neighbouring authorities. This creates significant inefficiencies within the system for delivering these services, including:

- a lack of strategic and co-ordinated asset planning at a regional or greater level,
- limited opportunities to consider catchment-level outcomes,
- a lack of funding and pipeline certainty to create competitive pressures in the supply chain. The lack of capacity and capability that tends to be associated with larger-scale entities; and
- a wider variation in three waters funding and financing strategies and approaches.

⁴² Transforming the system for delivering three waters services the case for change and summary of proposals, 30 June 2021, Te Tari Taiwhenua Internal Affairs, New Zealand Government

Despite attempts at integrated planning across the Metro Area through partnerships such as Future Proof, each Council has continued to focus investment on the needs of their individual communities in isolation rather than applying a broader sub-catchment level approach. This is evidenced by:

- The numerous previous investigations and studies highlighting the servicing challenges in the Southern Metro area and possible joined up solutions that have not been taken through to delivery (refer to Appendix A).
- The lack of any major cross-boundary wastewater management investment to date, despite it being the most practical approach in some situations. As an example, the township of Horotiu is currently serviced through the Ngaruawahia WWTP despite being located closer to the Pukete WWTP.
- There are some existing connections that cross boundaries for individual customers, but these are a result of legacy issues rather than the result of intentional, integrated planning.
- Differing approaches to overall asset management (including renewals, replacement, design, funding) across the Metro Area.
- Varying levels of pro-active long-term planning (e.g., not starting consenting processes early, or not investing in system upgrades until required for compliance purposes). This DBC represents the first real attempt at implementing a co-ordinated wastewater planning approach.
- Differing requirements and expectations on treatment performance/standards, operation, maintenance, iwi/Mana Whenua and stakeholder engagement, monitoring and reporting across the existing municipal WWTPs.
- Different consent standards and requirements.
- Varying levels of compliance with resource consents and inconsistent enforcement action taken by regulators when non-compliances occur.
- Each of these existing activities (Te Awamutu, Cambridge, Hamilton City, Ngaruawahia) are managed, and their impacts considered separately, despite the rivers hydrological catchment crossing multiple council boundaries.
- Multiple wastewater discharges to the river and environment across a relatively short reach of the Awa.

These issues are likely to be exacerbated in the future with the likelihood of accelerated and high rates of development and intensification within the Metro Area. This results in variable consent conditions and permitting land use activities that can be economical in the short-term, yet potentially harmful to the sub-regional freshwater environment.

This is particularly pertinent to the Metro Area, which has higher population densities and significantly higher demand for industrial land use activities. Without consistent and aligned land use allocations in the future, wastewater treatment will continue to be reactive, addressing short-term, immediate changes to demand within the wastewater network, instead of proactively planning for future demands.

Further, existing wastewater networks and plants are likely to become inundated with unplanned flows. Both outcomes result in the degraded health and wellbeing of the Waikato River and work against the delivery of the Te Ture Whaimana objectives.

Maatauranga Māori and Conventional Science Methods

Māori express a relationship with water as kaitiaki. Māori do not distinguish their rights and interests in freshwater from the three waters; they are viewed as a connection to the water environs and its systems. While Te Ture Whaimana provides the basis for a common vision across the river catchment it is not integrated into TLA planning instruments or strategic documents.

Despite being in place for more than ten years, Te Ture Whaimana does not appear to be used as the primary direction setting document for development in the Waikato River catchment as was intended at the time of the Waikato Raupatu River Settlement.

There are differences in the way individual councils engage with Iwi and Mana Whenua on wastewater activities across the Metro Area. Currently each council engages with Mana Whenua on an individual project basis, at varying levels, despite many of the same groups and individuals being involved in different projects across the whole Metro Area.

Historically, wastewater servicing solutions adopted engineering design standards based on conventional science and have not been informed by Maatauranga Māori science built up over hundreds of years. This has resulted in wastewater solutions that impact the mauri of the environment, including the Waikato River.

There are different views on te mana o te awa, the roles of the Waikato River and the environment and how they are factored into sustaining the needs of people. Historically, a western world view dominated the approach to wastewater management in New Zealand, as evidenced by Te Tiriti o Waitangi Settlement and the guiding principles of Te Mana o te Awa and Mana Whakahaere.

Consequently, municipal wastewater servicing across the Metro Area was designed and implemented to meet a standard acceptable from a western perspective and to achieve varying levels of service. These systems were implemented over many decades and were developed to meet different standards. At that time, there was no common guidance or vision on wastewater management, which has resulted in:

- current treatment plant locations, situated as close to the river as possible for discharge purposes,
- current standards and discharge methods to the Waikato River.
- In 2008 Waikato-Tainui and the government of New Zealand signed the Waikato Raupatu (Waikato River) Settlement and Te Ture Whaimana emerged as a mechanism to provide a common vision and objectives. However, these objectives have not been applied consistently across the different councils when developing individual wastewater management plans. As a result, Maatauranga Māori has not informed the wastewater management approach adopted in the Metro Area.

Appropriate Funding Provisions is Resulting in Inefficient Near-Sighted Decision Making

Constrained funding and conflicting priorities during long term plan processes results in TLA's prioritising other services which leads to underinvestment in capital and operational wastewater costs, as evidenced by a legacy of under-investment in wastewater services across the Metro Area.

Councils also self-impose debt to revenue ratios that are lower than those set out in the Local Government Act (LGA). This results in less funding being available for capital investment in council assets, including wastewater treatment upgrades. As an example, Waipā District Council has self-imposed a debt to revenue ratio lower than the limit set out in the LGA.

As noted above, there is also a disconnect between land use decisions, infrastructure needs and funding decisions. Limited historical funding support for councils from Central Government has made it challenging to effectively implement and enable nationally set policy and priorities. For example, at a national level land use planning directions (such as the NPS-UD) are requiring councils to enable urban land-use intensification without any consideration of the scale of investment needed in wastewater networks (conveyance and treatment) to service the land use change.


Land-use decisions through district planning and RMA processes are also often made without a funding plan in place for the infrastructure needed to service the land use. For example, development contributions collected as part of land use decisions do not cover the level or timing of investment needed to support the approved land-use.

The level of investment needed to support the level of development enabled by current District Plans is not currently funded in council Long Terms Plans. For example, the HCC Infrastructure Strategy (2021-2051) shows the estimated requirement for capital investment over the next 30 years is \$12.8 billion. A large portion of this investment is required in the first ten years however, this is currently unfunded due to budget constraints as shown in Figure SC - 13.

Figure SC - 13: Estimated capital investment – Hamilton City Council Infrastructure Strategy (2021-2051)

Capital investment

The estimated requirement for capital investment over the next 30 years is estimated at \$12.8 billion, as shown in the graph below

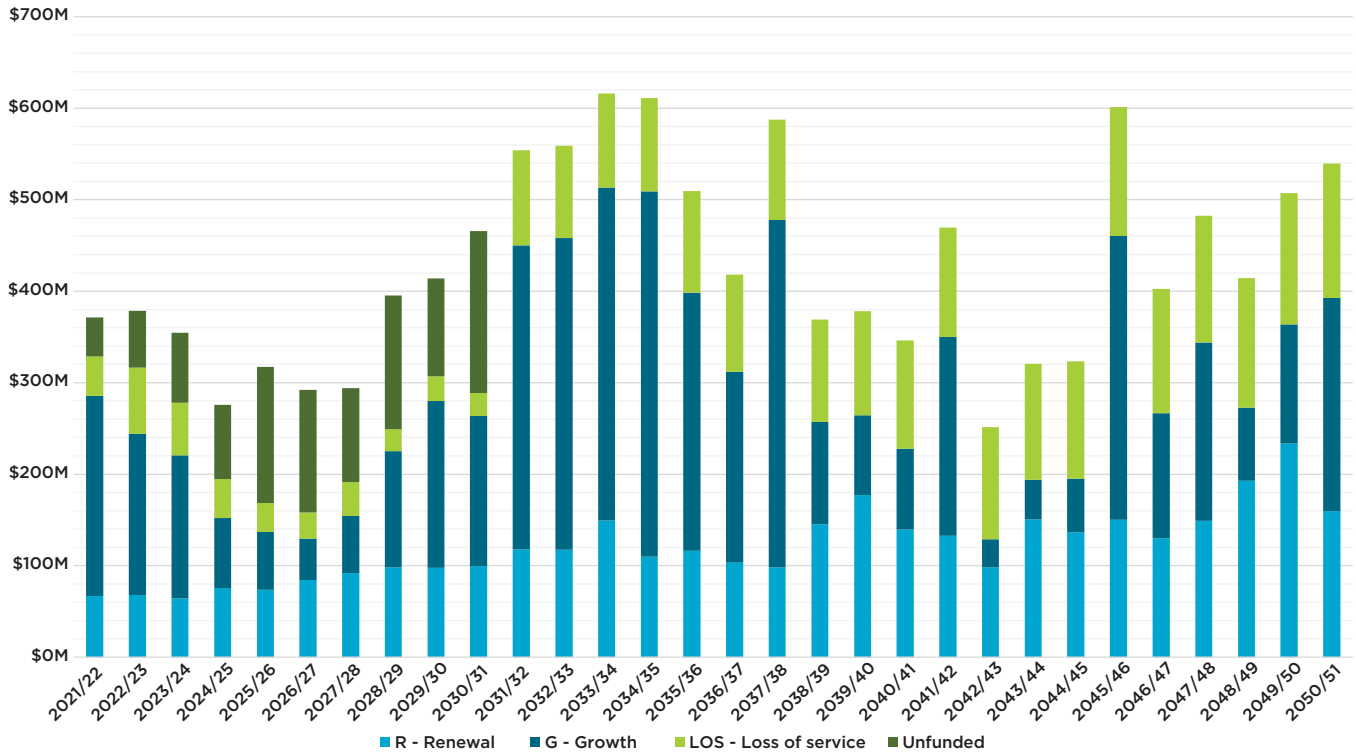

This consequence is inefficient near-sighted decision-making, which is inferred in the evidence above and is expanded on in Problem Statement 3.

Effect: As a consequence, inefficient near-sighted decisions are made, and health and well-being of the Waikato River degraded.

Degraded Health and Well-Being of the Waikato River.

Poor water quality and the current ecosystem health of the Waikato River is evidenced in problem statement two on the next page.

3.1.2 Problem Statement Two

Inconsistent, short-term and parochial regulatory, planning and investment decisions on land use and urban water resource management have contributed to cultural disconnect, degraded water quality, poor ecosystem health and over allocated resources. As a consequence, the relationships and aspirations of communities with the Waikato River and the ability of Waikato River iwi to exercise mana whakahaere or conduct their tikanga and kawa have been severely compromised.

Problem statement two links the historical decisions noted in problem statement one, with the degradation of the Waikato River and environment and the relationships of iwi and communities with the river. As outlined in problem statement one, historical decision-making has been ineffective and short sighted. Historic decisions have had significant consequences to the health and wellbeing of the river.

Cause: Inconsistent, short-term and parochial regulatory, planning and investment decisions on land use and urban water resource management have contributed to cultural disconnect

As noted in problem statement one, the lack of an integrated strategy has contributed to short-term decision- making, which has delivered limited progress towards Te Ture Whaimana outcomes. In addition, short-term decision-making has exacerbated wastewater capacity issues because networks and systems have had to service unplanned growth in residential, commercial and industrial activity ahead of infrastructure investment.

Historically decisions were made based upon current influences and issues, without a full understanding of how growth patterns, land use and environmental standards could change over time. It is therefore important that solutions considered as part of this DBC are based on robust growth forecasts and are adaptable to changing circumstances.

Table SC - 7: summarises several historic decisions related to wastewater treatment in the Metro Area and how these decisions were compromised because of land use, population and regulatory inconsistencies.



Table SC - 7: Previous decision-making issues at existing WWTPs

WWTP	Historical decisions which have led to capacity and quality issues
Hamilton (Pukete)	<p>The current upgrades at Pukete (Pukete 3) is aimed at extending the capacity of the plant to meet demand out to 2028. The upgrades have been designed to meet existing treated wastewater discharge consent conditions (which are load based, and therefore require treatment improvements to accommodate increased discharge volumes). The treatment and discharge approach does not take a holistic approach to urban water management and does not take advantage of the valuable resources (water, nutrients, energy) produced through the process.</p> <p>In addition, the footprint of Pukete WWTP and associated buffers to surrounding land uses is constrained so there is a 'build-out' capacity for the site. While the site has space for some further expansion the build-out capacity will be reached in the future requiring a supplementary treatment solution to help meet the needs of Hamilton.</p>
Cambridge	<p>The Cambridge WWTP was not originally designed for municipal treatment. In 1995 Waipā District Council purchased the Weddel Crown Meatworks wastewater treatment facility and retrofitted the existing ponds and RIBs. This was a more cost-effective solution; however the treatment plant was unable to treat the high flow loads to the quality required to meet its resource consents.</p> <p>As such, the plant did not meet its consenting requirements for almost 20 years until late 2020. Despite the clear violations against the consent conditions, Waipā District Council received no penalty or reprimand from the regulator (in this case Waikato Regional Council) between 1997 and 2017. It was generally accepted that the existing infrastructure at the WWTP could never achieve 100 percent compliance and therefore no significant action was undertaken to address the issue until 2011. The plant now has a new resource consent increasing the allowable limits for Nitrogen and has been compliant since late 2020.</p>
Te Kowhai	<p>The existing WWTP at Te Kowhai will not be sufficient if and when more dense residential development occurs in this area. Waikato District Council has indicated it does not want to operate and maintain a multitude of small package plants. A long-term servicing solution has not been developed or funded to meet the long-term needs of Te Kowhai.</p>
Mātangi	<p>The 50-year Wastewater Strategy (2014) noted the following:</p> <p>“the historic peak discharge flows [for the Mātangi WWTP] have exceeded this [its maximum flow constraints] and is expected to consistently exceed this from 2020. The buffering of peak flows through the plant cannot be estimated due to the lack of WWTP inflow data”.</p> <p>The lack of certainty around population and industrial growth implied from the lack of WWTP inflow data, limits the ability for Waikato District Council to adequately plan for future developments at the plant. Centralised wastewater treatment options were considered; however, both were ruled out due to septicity issues associated with conveyance of low flows over long distance and costs.</p>
Tauwhare Pa	<p>The 50-year Wastewater Strategy (2014) noted the following:</p> <p>“It is not clear what the future design ADWF [Average Design Wastewater Flow] and PWWF [Peak Design Water Flow] (i.e. capacity) for the existing WWTP is, however the resource consent application gives a future ADWF and PWWF of 45 m³/day and 119 m³/day, respectively”.</p> <p>This suggests there is uncertainty around the capacity constraints of the plant. However, the current consent limits the flows to 63 m³/day, and it is therefore assumed that capacity is at least as large as the stated existing design ADWF.</p>

Effect: have contributed to cultural disconnect, degraded water quality, poor ecosystem health and over allocated resources

A lack of effective oversight and stewardship arrangements, and weaknesses in the regulatory environment, have contributed to cultural disconnect. Iwi and Mana Whenua have not historically been involved in, or empowered to, make decisions in relation to wastewater management in the Metro Area as documented in problem statement one.

This includes input into the level of investment that should be made in wastewater services or involvement in proposed discharge methods. Instead councils make all the funding (capital and operational) decisions in relation to the wastewater activities through the LTP process. The Waikato-Tainui Raupatu Claims (Waikato River) Settlement Act 2010 has provided for an Iwi Commissioner to be appointed to the hearings panel for activities that impact the Waikato River, however, this does not resolve the cultural disconnect that exists.

As an example, Waikato iwi do not approve of discharge to waterways of effluent from wastewater treatment plants and view land disposal as the only acceptable option for wastewater. They have a strong cultural

belief that wastewater should be cleaned through contact with land before returning to water bodies and in doing so preserve the mauri of their tupuna⁴³.

Diffuse run-off and leaching of contaminants to groundwater from farms is currently the major source of pollution in the Waikato River (ADD SOURCE). While point source discharges of treated sewage and industrial wastewaters do contribute significant contaminant loadings to the river, in general, the discharge from WWTPs contributes relatively small amounts to the total contaminants.

For example, the Cambridge WWTP short-term consent has a median value of 15 kg/day and a 90th percentile value of 30 kg/day for Total Phosphorus. The Cambridge WWTP short-term consent has a median value of 330 kg/day up to 31 December 2023, and 385 kg/day for Total Nitrogen for the remaining duration of the short-term consent. HCC currently has consent to discharge up to 100 kg of Total Phosphorus per day and 450 kg of Total Nitrogen per day to the Waikato River.

The lack of proactive decision-making regarding wastewater treatment and land use management has contributed to substandard water quality. Water quality trends at key sites along the Waikato River show a general trend of degradation, as the concentration of contaminants has increased.

Results of the 2018 water quality dataset are highlighted in Figure SC - 14. This shows the key contaminants that have contributed to poor water quality in the Waikato River such as Nitrogen, Phosphorus, Turbidity, Ammonia, and Escherichia coli (E.coli).

Six monitoring sites along the Waikato River have been operating over the last five-year period⁴⁴:

- Tuakau Bridge
- Huntly Tainui Bridge
- Horotiu Bridge
- Narrows Boat Ramp
- Waipāpa Tailrace
- Whakamaru Tailrace.

The general containment trends at these sites are presented in the Figure SC - 14: on the next page.

43 Water River Independent Scoping Study, NIWA, 2010

44 LAWA, 2020. Source: <https://www.lawa.org.nz/explore-data/waikato-region/river-quality/waikato-river>

Figure SC - 14: Water quality of the Waikato River⁴⁵


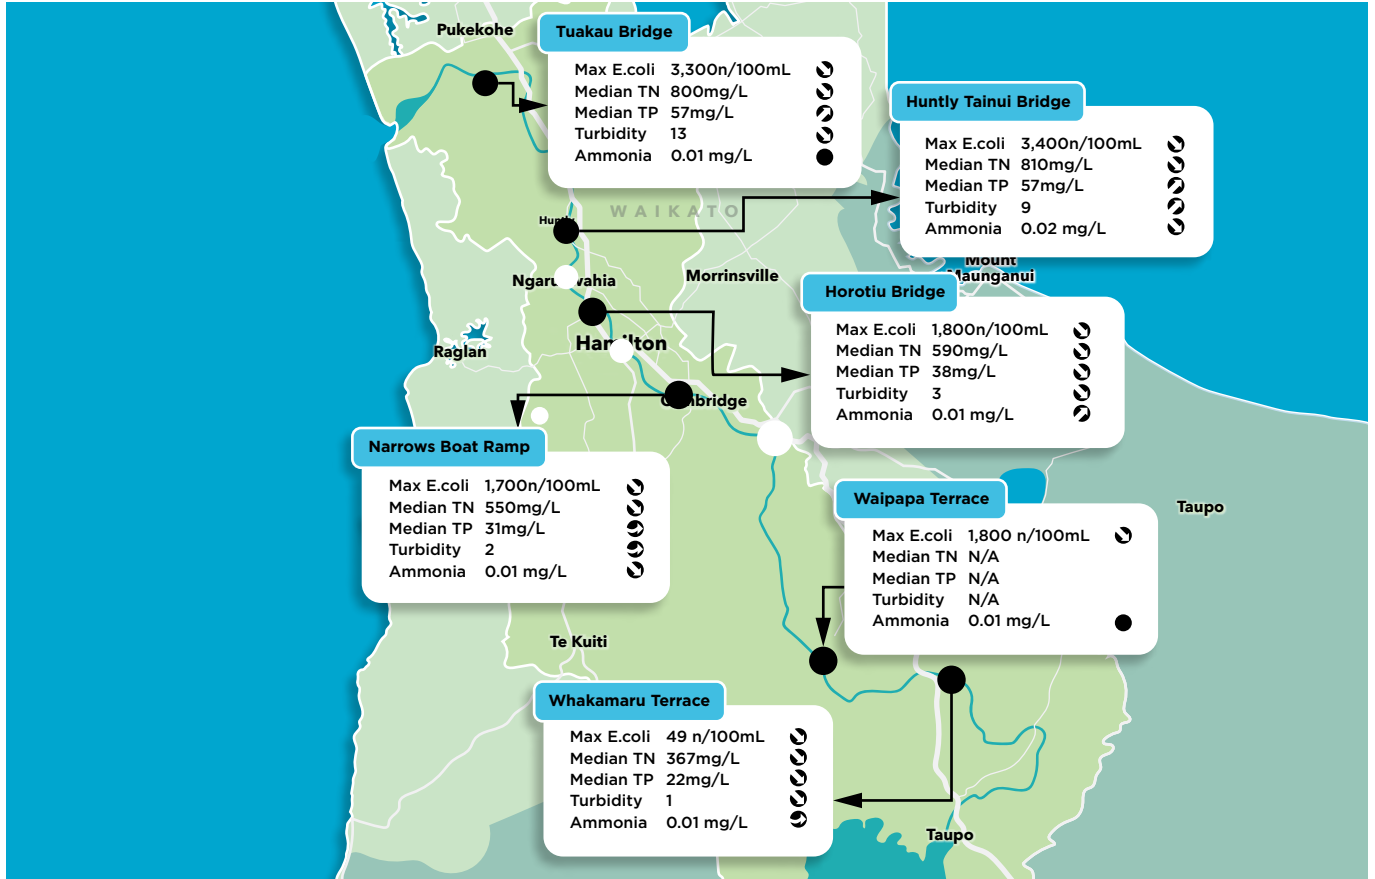


Figure SC - 15: Life of the Waikato River - Macroinvertebrate (MCI) 11

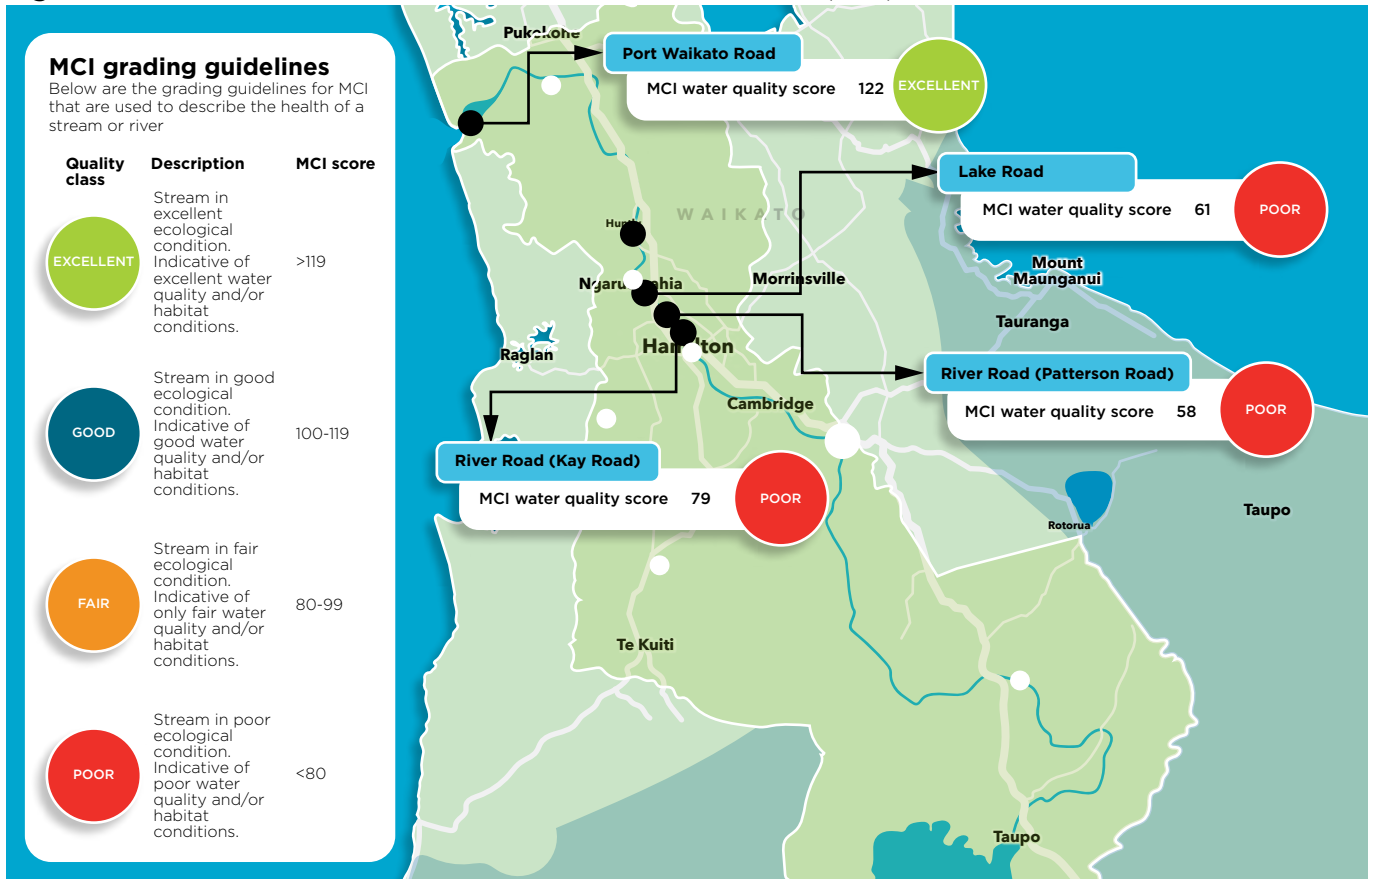

45 LAWLA, 2020. RiverWQMonitoringData_northIsland_2014-18. Source: <https://www.lawa.org.nz/download-data/#river-water-quality>

The results shown in Figure SC - 14: and Figure SC - 15: suggest high levels of E. coli, total nitrogen, total phosphorus and reductions in visual clarity. These measurements indicate poor and degraded water quality and ecosystem health in many locations within the lower catchment of the Waikato River. This is likely to limit the cultural and recreational interactions people have with the Waikato River.

It should be noted the monitoring sites above give an indication of the wider river catchment, which is impacted by numerous point and non-point sources of contaminants. The point source contribution to the low water quality is relatively small compared to the non-point source contribution (i.e., runoff from farms and stormwater). In general, the discharge from municipal wastewater treatment plants contributes relatively small amounts to the total contaminants.

However, because of the population served by the Pukete WWTP, the nutrient loads discharged from Pukete and Cambridge to the Waikato River are some of the highest point source discharges in the entire catchment. The discharges have both localised impacts on the river at the point of discharge, and cumulative impacts downstream.

Effect: As a consequence, the relationships and aspirations of communities with the Waikato River and the ability of iwi to exercise mana whakahaere or conduct their tikanga and kawa have been severely compromised.

Cultural disconnect from the Waikato River

Tāngata Whenua have a unique relationship with the Waikato River which is considered by many to be tupuna (ancestor) or a taonga (treasure). Historically, the river was a key source of food and water, an important transport corridor and a place of healing with its own mauri and spiritual healing.

There are many who consider the water of the Waikato River to be akin to the blood flowing through their veins and the health and wellbeing (mauri or life force) of the river is inextricably linked to that of tāngata whenua who have lived along its banks.

It is believed that this relationship with the river brings with it the responsibility to ensure the wellbeing of the river. As such a co-governance and co-management affiliation was set up for the management of the Waikato River and its catchment which acts under the Waikato-Tainui Raupatu Claims (Waikato River) Settlement Act 2010⁴⁶.

The ongoing development which has occurred along the length of the river over the last century has seen an increase in target nutrients and the contamination of the river from industries, communities and farmland. The discharge of waste, particularly human waste, to the Waikato River or its tributaries, whether direct or diffuse, is particularly abhorrent to Tāngata whenua.

A minimum benchmark has therefore been agreed to achieve the best practicable discharge quality which adheres to objectives as defined within the Te Ture Whaimana o Te Awa o Waikato, Vision and Strategy for the Waikato River. Objectives H and K are the most prevalent to the discharge of wastewater into the river:

- Objective H: The recognition that the Waikato River is degraded and should not be required to absorb further degradation as a result of human activities.
- Objective K: The restoration of water quality within the Waikato River so that it is safe for people to swim in and take food from over its entire length.

Actions (or inaction) taken which move further away from the above objectives (and the other 11 objectives outlined within Te Ture Whaimana o Te Awa o Waikato would be considered unacceptable.

During workshops undertaken as part of the Cambridge Wastewater Treatment IBC and the Waikato Sub-Regional Three Waters Strategic Case, iwi groups reiterated the importance of implementing a solution which seeks to improve relationships with the river. The ability to swim and take food from the river, along with the improved ecological health of the river were identified as key drivers for betterment and positive change. This was not just to improve the cultural relationships with the river, but to also improve the wider community's interactions with the river. The river should be a source of pride for the region, celebrated by all.

46 Cambridge Wastewater Treatment Plant Tāngata Whenua Effects Assessment 2011

3.1.3 Problem Statement Three

Reactive infrastructure planning practices coupled with light-handed regulation and compliance and inconsistent management practices, standards and performance expectations has led to variable urban water system performance across the region and has adversely impacted the health and well-being of the Waikato and Waipā Rivers.

Problem statement three relates to inconsistent and changing regulatory standards, practices and performance expectations that have led to the variable infrastructure performances, particularly wastewater performances within the Metro Area. This affects the ability to achieve Te Ture Whaimana.

Cause: Reactive infrastructure planning practices

The dispersed nature of the roles and responsibilities within the system, spread across many TLAs, means no one entity is currently responsible for monitoring or delivering the performance of the whole system. As evidenced in previous problem statements, long-term population growth and development forecasts across the Metro Area have historically been misaligned and inconsistent, This has contributed to reactive and poorly decision-making regarding wastewater treatment.

The Metro Area includes several areas either zoned for development or with significant development potential located on the periphery of existing urban settlements. Many of these areas, such as Te Kowhai, and the Airport industrial area, currently have limited wastewater services. In some cases, no servicing is planned, despite a lack of wastewater services constraining development. This means the land is zoned for development without sufficient long-term servicing solutions, or it prevents land that could unlock significant economic potential from being zoned and developed.

In many cases, previously projected population growth exceeded forecast projections, leading to discrepancies between what was expected and what was required in terms of key wastewater infrastructure. One example is the 2011-2021 HCC Long-Term Plan, which forecasted that Hamilton City would reach a population of 150,000 by 2021. Hamilton City reached this level by 2016. This growth rate has resulted in additional pressure on the city's infrastructure, including the Pukete WWTP. Further details on future growth areas, capacity limitations and the need for wastewater treatment infrastructure provisioning is outlined in section 3.1.4.

In addition, land use decisions in serviced areas have been made without long-term sustainable servicing solutions that are compatible with the broader needs of the Metro Area. For example, the Airport precinct is undergoing rapid development and is currently serviced through a mixture of small onsite WWTPs and storage and tanked wastewater to the Cambridge WWTP. Other developments in rural zones have been approved based on small, decentralised solutions.

Furthermore, recent asset upgrades have been driven by reactive measures to meet abatement notice requirements, or prosecutions rather than a proactive approach to address known asset deficiencies.

Cause: coupled with light-handed regulation and compliance and inconsistent management practices, standards and performance expectations

Under performing sites are often neglected until enforcement action is taken to provide incentive for upgrades/compliance to occur. Councils are often not proactive in this space, and approaches are inconsistent.

As an example, up until late 2020, the Cambridge WWTP never fully complied with its resource consent conditions. This situation occurred for more than 20 years, primarily because of the lack of regulatory drivers or enforcement and because of Waipā District Council's decisions not to invest in any upgrade.

In addition, plan changes being approved and adopted without funded and planned infrastructure projects often result in 'plug and play' solutions that exceed existing network capacity and result in poor system performance (e.g. network overflows, poor levels of treatment, consent non-compliance). In some instances, this has resulted in short-term, unconnected land development and associated wastewater solutions (e.g. WRAL, Te Kowhai rural-residential, Mātangi and Tamahere rural-residential).

The consenting requirements and levels of enforcement consistency within HCC, Waipā District Council and Waikato District Council differ significantly (refer to Table SC - 9:). The source of misalignment could be attributed to each councils' individual interpretation and approach to Part 2 RMA where it is considered appropriate to trade off or balance economic, societal and environmental matters⁴⁷. This has resulted in varied discharge standards and levels of compliance. In many instances, consent conditions and their enforcement (or lack of enforcement) have resulted in extended periods of non-compliance with environmental standards and mis-alignment with iwi's strategic vision for water quality of the Waikato River.

One example of misaligned performance measures and expectations is the misalignment between the NPS Freshwater Management and the more recent Plan Change 1 requirements.

A plant must legally meet its RMA resource consents but must also comply with the water quality baseline standards as defined by the NPS for Freshwater Management. The NPS guidelines provide a range of targets and categorises them into attributes, with Attribute A being the highest standard. Ideally water quality should stay within Attribute A or B target ranges.

However, in recent years central and local Government regulations around improving the quality of freshwater have been introduced in response to changing community environmental expectations and Te Ture Whaimana. This is seen through the Plan Change 1. Plan Change 1 sets out an 80-year timeframe for achieving water quality that is swimmable and safe for food collection along the entire length of both the Waikato and Waipā rivers and their tributaries. In achieving this, Waikato Regional Council has set a higher standard than the requirements stipulated within the NPS for Freshwater Management for some water quality parameters such as Nitrate, Ammonia and E.coli. This is shown in Table SC - 8: which compares the Plan Change 1 standards against the NPS standards for two locations along the river (one upstream and one downstream)⁴⁸.

It should be noted that the NPS target ranges for Total Phosphorus (TP) and Total Nitrogen (TN) are for lakes. The NPS for Freshwater Standards/Management? does not stipulate a standard for TP and TN for Rivers. As such the NPS target ranges for TP and TN are a higher level of quality (i.e. lower levels of nutrient) than what is recommended in Plan Change 1. These differing requirements make it difficult for local authorities to develop consistent and aligned consenting conditions.

Whilst this misalignment currently exists, recent water reform policies (as described in section O), require NPS for Freshwater Management to be updated to better align with the Plan Change 1 standards. It is assumed this misalignment will be resolved by the end of the 2022.

47 WRC, July 2017. Waikato Freshwater Strategy, 1.7.3 Policy Misalignment. Retrieved 22 August 2019, from <https://www.waikatoregion.govt.nz/assets/PageFiles/40487-lets-talk-water/Fresh-water-strategy-2017-COMBINED-web.pdf>

48 Plan change 1 identifies different quality standards for different monitoring sites.

Table SC - 8: Plan Change 1 and NPS standards comparison at Whakamuru Tailrace and Tuakau Bridge

Parameter		Unit	Waikato at Whakamuru		Waikato at Tuakau		Lakes and/or rivers	
			Short term targets	Long term targets	Short term targets	Long term targets	NPS Target A	NPS target B
Chlorophyll a	Annual Median	mg/m ³	5.0	5.0	10.6	5.0	≤2	>2 and ≤ 5
	Annual Max	mg/m ³	25	25	35	25	≤10	>10 and ≤ 25
Nitrate-N (NO ₄ -N)	Annual Median	mg/L	0.101	0.101	0.325	0.325	≤1	>1 and ≤ 2.4
	Annual 95%ile	mg/L	0.251	0.251	0.890	0.890	≤1.5	>1.5 and ≤ 3.5
Ammonia (NO ₄ -N)	Annual Median	mg/L	0.003	0.003	0.003	0.003	≤0.03	>0.03 and ≤ 0.24
	Annual Max	mg/L	0.01	0.01	0.008	0.008	≤0.05	>0.05 and ≤ 0.40
Total Phosphorus	Annual Median	mg/L	25	25	49	38	≤10	>10 and ≤ 20 ⁴⁹
Total Nitrogen	Annual Median	mg/m ³	329	300	576	500	≤160	>160 and ≤ 350
E. Coli	Annual 95%ile	cfu/100mL	60	60	1388	540	≤540	≤1000
Clarity	Annual Median	m	1.37	2.2	0.48	1.0	N/A	N/A
Clarity	Annual Median	m	1.37	2.2	0.48	1.0	N/A	N/A

This shows that the plants further upstream are expected to achieve higher consenting standards than those further downstream, with the exclusion of Pukekohe which, following the completion of its upgrades will be able to achieve very high quality of discharge (producing less than TN of 5 mg/m³) and therefore meet significantly higher consenting conditions. This reflects the additional quality expectations associated with larger and more sophisticated facilities. Smaller plants struggle to produce higher quality discharges. High quality discharges only become feasible for larger servicing areas (i.e. a larger funding base means larger, more sophisticated plants are more financially feasible).

49 The NPS target ranges for Total Phosphorus and Total Nitrogen are for Lakes. The NPS for Freshwater does not stipulate a standard for TP and TN for Rivers. As such the NPS target ranges for TP and TN are a higher level of quality (i.e. lower levels of nutrient) than what is recommended in Plan Change 1.

Table SC - 9: Quality of discharge consents of WWTPs (for river only discharges)

Parameter	Cambridge WWTP	Pukete WWTP	Ngaaruawaahia WWTP	Te Awamutu WWTP
Flow	Average of 6,000 m ³ /day until 31 December 2023 and an average of 7,000 m ³ /day for the remaining duration of the short-term consent. Max of 10,000 m ³ /day	Max of 224,000m ³ /day		
cBOD5 concentration	Shall not exceed a median value of 20 grams per cubic metre and the 90th percentile shall not exceed 50 g/m ³	Over each calendar month, no more than 8 exceedances over 10 g/m ³ and each quarter no more than 3 exceedances over 50 g/m ³	Median five day shall not exceed 30 g/m ³ and 90th percentile shall not exceed 60 g/m ³	Shall not exceed 10 g/m ³ for more than 10% of samples taken in one year, no sample shall exceed 20 g/m ³
Suspended Solids concentration	Shall not exceed a median value 20 grams per cubic metre and the 90th percentile shall not exceed 50 g/m ³	Over each calendar month, no more than 8 exceedances over 15 g/m ³ and each quarter no more than 3 exceedances over 100 g/m ³	Median suspended solids concentration shall not exceed 30 g/m ³ and 90th percentile shall not exceed 60 g/m ³	Median suspended solids concentration shall not exceed 15 mg/L and the 90th percentile shall not exceed 35 mg/L
Total Nitrogen	Shall not exceed a median value of: a. 330 kg/day median value up to 31 December 2023; and b. 385 kg/day median value from 1 January 2024 and for the remaining duration of the consent.	Over each 26 week period, no more than 50% of the samples shall exceed 450 kg/day in summer and 1500kg/day in winter	Median shall not exceed 20 g/m ³ (summer) Median for Ngaaruawaahia and Huntly combined shall not exceed 57 kg/day (summer)	Annual average total nitrogen load shall not exceed 50 kg/day
Total Phosphorus	Total Phosphorus in the discharge shall not exceed a median value of 15 kg/day and a 90th percentile value of 30 kg/day.	Over each 26 week period, no more than 50% of the samples shall exceed 95 kg/day in summer and 700kg/day in winter	Median shall not exceed 8 g/m ³ (summer) Median for Ngaaruawaahia and Huntly combined shall not exceed 17.3 kg/day (summer)	Annual average total phosphorus load shall not exceed 25 kg/day
E.coli	E. coli levels shall not exceed a median value of 126 Colony Forming Units (CFU) units per 100 millilitres	Over each calendar month, no more than 8 exceedances of E.coli over 126 cfu/100mL. Over each quarter no more than 3 exceedances over 2000 cfu/100mL	Median E.coli concentration shall not exceed 126 cfu/100mL	Faecal coliforms shall not exceed 400 cfu/100mL and the 90th percentile shall not exceed 4,000 cfu/100mL

To achieve the water quality standards outlined within Plan Change 1, WWTPs discharging into the Waikato River should be achieving consistent performance levels. One of the key objectives of the Te Ture Whaimana is to make the entire length of the river safe for swimming and the collection of kai. This means achieving a high water quality standard for the entire length of the river, regardless of plant location.

Each WWTP's resource consents should also be measured against consistent consenting parameters and conditions on the basis of a standard performance standard. In some cases, the parameters and conditions are different across WWTPs, making it difficult to monitor and compare across jurisdictions. All new standards (in both the NPS and Plan Change 1) use Total Nitrogen and Total Phosphorus as the main nutrient parameters for measurement and should be applied throughout the Metro Area.

Waikato District Council, Waipā District Council and HCC are responsible for their respective WWTPs, and the monitoring of discharge parameters undertaken. Each council can propose resource consent conditions (including parameters and limits).


However, Waikato Regional Council is responsible for approval of the resource consents for WWTP discharges, the conditions imposed and their enforcement. Both the regional council and the district (city) councils will therefore be responsible for applying, maintaining and enforcing consistent and aligned monitoring of the WWTP discharges and consent requirements.

The above consents only investigate the discharges to the Waikato and Waipā River. Land discharges are set to a different standard. The performances of these plants is discussed below.

Effect: has led to variable urban water system performance across the region and has adversely impacted the health and well-being of the Waikato and Waipā Rivers.

In addition to the inconsistent consenting requirements, many existing plants in the Metro Area are unable to meet the existing consenting conditions. Figure SC - 16: shows the compliance outcomes of the seven municipal WWTPs operating within the Metro Area. The tables represent the most recent compliance monitoring data available.

Figure SC - 16: Compliance of WWTPs in Metro Area

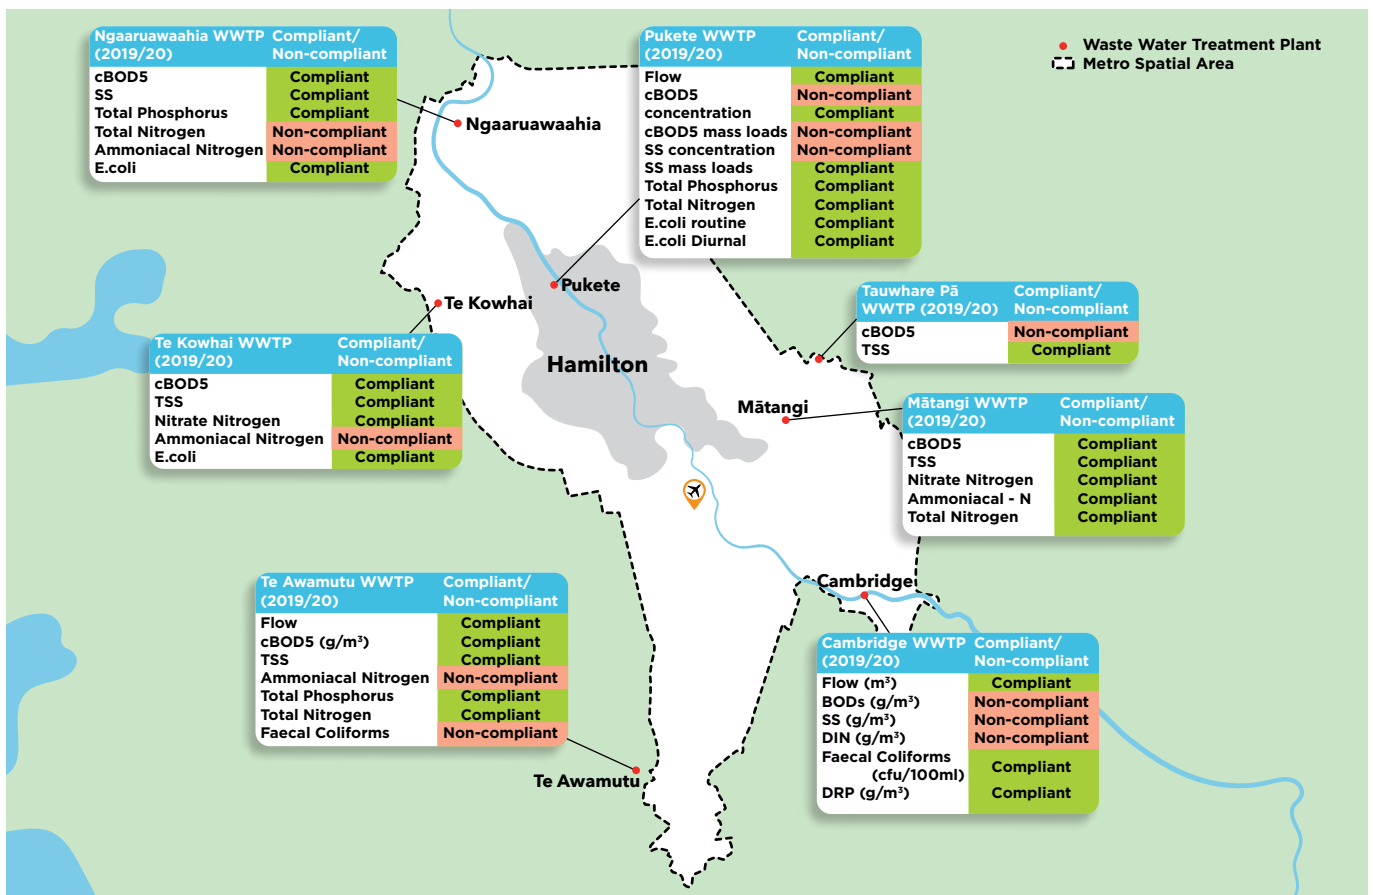

As shown in Figure SC - 16; Cambridge WWTP has been non-compliant since 1997 when its original consent was issued. Up until 2020 (when a new short-term consent was secured permitting a high total nitrogen discharge load) the plant was significantly non-compliant for Total Nitrogen with 100% of all samples exceeding its current consent limit for Dissolved Inorganic Nitrogen, despite its recent short-term improvements. There is also a compliant issue around the water quality as 38% of its actual samples exceeded the required consent limit.

Pukete WWTP and Te Awamutu WWTP are normally compliant and able to perform at a higher level, including higher quality discharges delivery. However, these plants have shown recent non-compliances particularly in relation to Ammoniacal Nitrogen and Total Suspended Solids (water clarity) parameters.

Te Kowhai WWTP and Tauwhare Pā WWTP have land-based discharges and are currently struggling to meet Ammoniacal Nitrogen and cBOD consent requirements respectively.

Mātangi WWTP also relies on land-based discharges. Whilst this plant shows compliance for the 2019/20 year, the plant does not have capability or functionality in reducing Total Nitrogen and Total Phosphorus. This will cause non-compliances in the future as standards are increased.

Operating outside of compliance limits is likely to harm aquatic animals, instream ecology, and may negatively affect a water body's recreational use in the Waikato River. To achieve Te Ture Whaimana, the long-term solution must achieve better consenting conditions by having consistent regulatory standards, practices and performance expectations.

Effect: Adversely impacted the health and well-being of the Waikato and Waipā Rivers.

Problem statement two provides evidence of the impact these issues have on the health of the Waikato and Waipā Rivers.

3.1.4 Problem Statement Four

The legacy of under-investment in urban water systems coupled with infrastructure reaching end of life and increasing regulatory requirements and environmental expectations, climate change impacts and greater growth demands has created a significant investment deficit, resulting in unaffordable current and future costs for new infrastructure, maintenance and operations and human capacity and capability challenges within the waters sector.

Problem statement four identifies a number of issues leading to ongoing operational challenges currently being experienced by three waters infrastructure and management. These include:

- An ongoing trend of under-investment in urban water systems, typically due to a lack of funds and affordability constraints.
- Ageing infrastructure, which has, or is close to reaching the end of its asset life and has not been replaced.
- Increasing environmental expectations leading to a higher standard of regulatory requirement.
- The effects of climate change on water supply.
- Current and future growth demand placing additional pressures on supply and capacity and cost.

Cause: The legacy of under-investment in urban water systems

As noted in problem statement one, appropriate funding provision as a result of competing priorities for council funding have constrained investment in wastewater infrastructure.

Accordingly, there is significant investment required in the Metro Area to upgrade treatment plants discharging into freshwater, to meet the objectives set out in the NPS for Freshwater Management. An estimated investment of between \$240 and \$360 million⁵⁰ is required to achieve the NPS for Freshwater Attribute B targets, with an additional increase in operating costs estimated between \$6.5 and \$9.7 million.

Cause: coupled with infrastructure reaching end of life

Approximately 12 per cent of wastewater pipelines within the Metro Area are assessed as being in poor or very poor condition⁵¹ with an average age of 37.19 years⁵². Pipelines in poor condition carry increased risks of failure, which can lead to water loss and inefficiencies in the network. In some case, pipes are no longer fit for purpose and may have already exceeded the end of their useful life. As a result, operational and capital expenditure costs associated with service delivery are likely to increase unless action is undertaken.

In 2019, HCC was fined \$54,000 for overflow of wastewater including human sewage (a discharge of untreated wastewater) into the Waikato River from the Pukete WWTP⁵³. This issue occurred because the overflow protection system failed.

The national “Case for Change” report recognises that discharges from WWTPs are harming the environment in many parts of New Zealand, particularly where multiple plants are scattered across a catchment or are operating poorly, similar to the Metro Area.

50 DIA, 2018. GHD, Boffa Miskel, Three Waters Review, Cost Estimates for Upgrading Wastewater Treatment Plants to meet objectives of the NPS for Freshwater. Source: [https://www.dia.govt.nz/diawebsite.nsf/Files/Three-waters-documents/\\$file/Costs-of-wastewater-upgrades-GHD-Boffa-Miskel-Final-report-Oct-2018.pdf](https://www.dia.govt.nz/diawebsite.nsf/Files/Three-waters-documents/$file/Costs-of-wastewater-upgrades-GHD-Boffa-Miskel-Final-report-Oct-2018.pdf)

51 WaterNZ, 2020. Pipeline Condition. Source: https://www.waternz.org.nz/Category?Action=View&Category_id=1008

52 WaterNZ, 2020. Pipe Age. Source: <https://www.waternz.org.nz/pipeage>


53 TVNZ, 2019. Hamilton City Council fined \$54k for overflow of wastewater, including human sewage, into Waikato River. Source: <https://www.tvnz.co.nz/one-news/new-zealand/hamilton-city-council-fined-54k-overflow-wastewater-including-human-sewage-into-waikato-river>

Cause: increasing regulatory requirements and environmental expectations, climate change impacts and greater growth demands

In addition to increasing regulatory requirements, community expectations regarding environmental regulations have increased over the past few years.

Figure SC - 17 below shows the percentage of respondents residing within the Waikato Region who indicated they were pro, mid (apathetic) or anti ecological regulation. Since 2008, the percentages of respondents indicating a pro-ecological attitude towards environmental regulation has increased from 16 percent to 40 per cent and the number of those apathetic or anti ecological regulation has decreased.

Figure SC - 17: People’s environmental attitudes to regulation

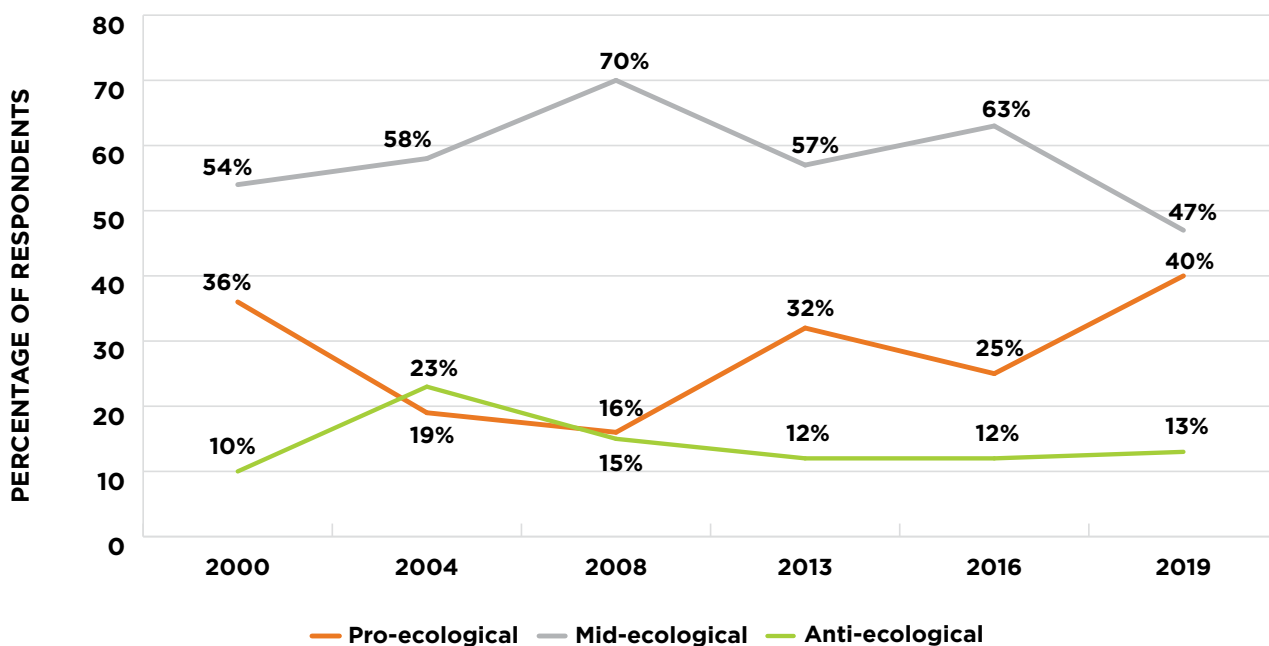

The key climate change risks for the Waikato region, especially the Metro Area, are more severe weather extreme events, such as increased flooding from more frequent and intense rainfall events. A higher risk of drought conditions is also expected due to higher temperatures and less rainfall events.

Storms and flooding increase the inundation and erosion risk to infrastructural assets and the services they provide. To address these risks, wastewater infrastructure must be developed and managed to be sustainable over the long-term and resilient to climate change impacts. These are likely to increase the costs associated with managing and maintaining facilities.

Land drainage and flood protection may not be able to cope with more intense and frequent rainfall events. Consequently, wastewater networks may be overloaded by increased inflow, leading to potential wastewater overflows. This will result in increasing impacts on receiving water environments as wastewater treatment facilities are impacted by changes in baseline conditions.

Longer summers with higher temperatures and less rainfall will increase drought risk and thus decrease water availability. This will have an impact on the performance and maintenance of wastewater systems and treatment facilities as river flows are likely to be lower in summer. Higher water temperature may also cause algae growth which will potentially affect overall water quality in the Waikato River.

Significant population growth, particularly within Hamilton City and the northern communities of Te Kowhai, Ngāruawāhia and Taupiri means wastewater flows will create capacity constraint issues at existing plants. Further details about these anticipated capacity constraints and timeframes are outlined in Table SC - 10.


Table SC - 10: Capacity constraints at existing WWTPs

Serviced Areas	Current Average flows (m ³ /day)	2061 Average projected flows (m ³ /day)	Capacity constraints
Taupiri	1,600	6,700	Actiflo and UV systems have fixed capacity. Pond system has limited capacity to remove nutrients
Ngāruawāhia (incl Hopuhopu)			
Horotiu			
Te Kowhai	7 (part of community only)	500	Treatment and infiltration system at capacity
Mātangi (village only)	30 (part of community only)	90	Land disposal system overloaded
Tauwhare Pā	27	55	Land disposal system at capacity
Hamilton	53,000	90,000	P3 upgrade underway to provide additional secondary treatment capacity. Other processes are nearing capacity (e.g. inlet works, primary sedimentation tanks, digesters)
Cambridge (incl Hautapu and Karapiro)	4,800	9,000	7,800 m ³ /day target average daily flow for short term upgrade recently completed. Limited ability to remove nitrogen in pond system
Te Awamutu & Kihikihi	4,650	7,200	Stage 3 upgrade nearing completion targets average daily flow of 6,200 m ³ /day

Effect: has created a significant investment deficit resulting in unaffordable current and future costs for new infrastructure, maintenance and operations

The required level of investment in wastewater systems is summarised in Hamilton City Council’s Infrastructure Strategy (2021-2051). The graph below highlights the significant amount of investment that is currently unfunded in the first decade.

Figure SC - 18: Forecasted Capital Expenditure for Wastewater – Five Yearly Periods 2021-2051 (Hamilton City Council’s Infrastructure Strategy)

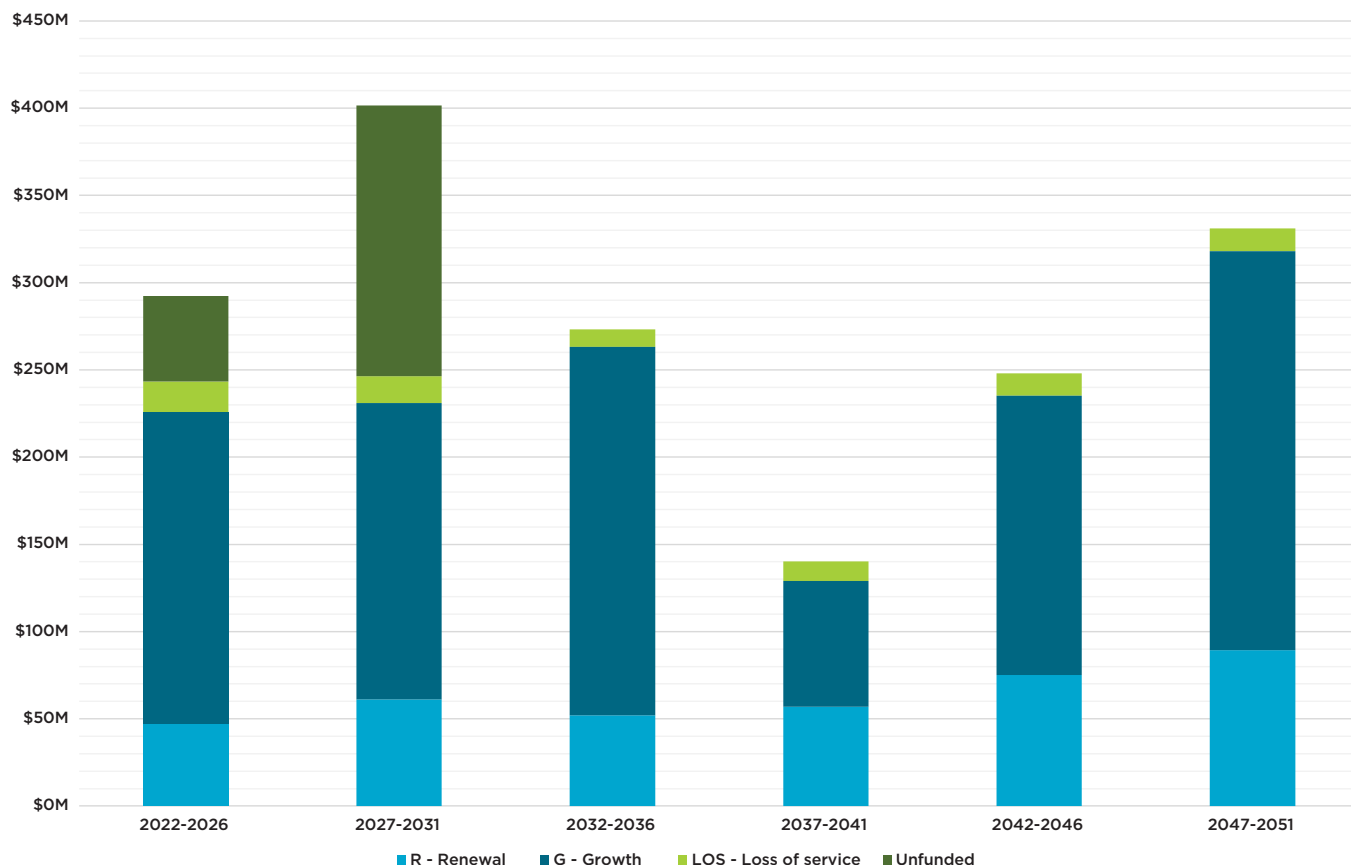

Effect: and human capacity and capability challenges within the waters sector

Operational, human capacity and capability challenges are being experienced across New Zealand’s three waters sector. The Waikato sub-region is no different. The DIA Three Waters Review in 2018⁵⁴ found that the industry experienced capacity, capability and sustainability challenges, particularly in smaller organisations.

The DIA review found that scale plays a role in relation to service quality, compliance, asset management, and governance capability. Smaller local authorities generally have fewer resources, spread more widely across many activities. The large land area and number of water and WWTPs (7) in the Metro Area can lead to occasions where resources are further stretched.

54 DIA, April 2018. Review of three waters infrastructure: key findings and next steps, retrieved 03 Oct 2019, from [https://www.dia.govt.nz/diawebsite.nsf/Files/Three-Waters-Review-Cabinet-papers-April-2018/\\$file/Review-of-three-waters-infrastructure-key-findings-and-next-steps-April-2018-a.pdf](https://www.dia.govt.nz/diawebsite.nsf/Files/Three-Waters-Review-Cabinet-papers-April-2018/$file/Review-of-three-waters-infrastructure-key-findings-and-next-steps-April-2018-a.pdf)

3.2 Benefits, Opportunities and Constraints

3.2.1 Benefits

Three benefit statements were developed as part of the Waikato Sub-regional Three Waters Strategic Case. It is expected that this project, whilst only focusing on wastewater treatment within the Metro Area will work towards delivering these benefits. These benefit statements have been agreed with partners and stakeholders and have been adopted (endorsed by the Governance Group). The benefit statements outlined below have been retained from the Waikato Sub-Regional Three Waters Strategic Case as they align with the investment objectives outlined in Section 3.3 which provide more specific outcomes and measures.

The Benefit statements and supporting evidence is outlined below.

Benefit Statement 1

River health and quality is enhanced and people's connection with the River is restored. 45%

By addressing the problems identified above it is expected the Project will be able to deliver a wastewater treatment solution, which is able to:

- improve the health and wellbeing of the river; and
- improve people's connection to the river.

Water quality, in particular, can be improved by seeking to deliver higher performing WWTPs, which can reduce the level of contaminant in any potential discharges to the environment or directly to the river.

The need to improve the level of discharge quality (or removing discharges to the river altogether) is becoming increasingly urgent as environmental expectations increase, regulatory standards increase, and water resources become scarcer. This approach is consistent with the Three Waters Reform objective of "significantly improving the environmental performance of wastewater systems".

Improving human relationships with the river can also be achieved through this Project. An integrated and planned wastewater treatment solution across the Metro Area can help to reduce the level of E.coli, and other harmful contaminants in the river. Improving the water quality will increase the proportion of the river, which is suitable for swimming and other recreational activities as well as collecting kai. The Waikato River and region's waterways can be used more actively and commonly for customary, recreation and education practices by the community.

This specific benefit stream aims to give effect to Te Ture Whaimana by directly contributing to the following objectives:

- Objective A: The restoration and protection of the health and wellbeing of the Waikato River.
- Objective H: The recognition that the Waikato River is degraded and should not be required to absorb further degradation as a result of human activities.
- Objective G: The recognition and avoidance of adverse cumulative effects, and potential cumulative effects, of activities undertaken both on the Waikato River and within its catchments on the health and wellbeing of the Waikato River.
- Objective K: The restoration of water quality within the Waikato River so that it is safe for people to swim in and take food from over its entire length.

Achieving this benefit will also indirectly contribute to other Te Ture Whaimana objectives including:

- Objective B: The restoration and protection of the relationship of Waikato-Tainui with the Waikato River, including their economic, social, cultural, and spiritual relationships.
- Objective C: The restoration and protection of the relationship of Waikato River iwi according to their tikanga and kawa, with the Waikato River, including their economic, social, cultural and spiritual relationships.
- Objective D: The restoration and protection of the relationship of the Waikato region's communities with the Waikato River including their economic, social, cultural and spiritual relationships.
- Objective I: The protection and enhancement of significant sites, fisheries, flora and fauna.
- Objective L: The promotion of improved access to the Waikato River to better enable sporting, recreational, and cultural opportunities.

Benefit Statement 2

Commitment and dedication to a collaborative and integrated approach to land, water, community planning that is holistic, integrated, aligned with community aspirations, and provides opportunities for involvement by the wider community. 35%

The project is intended to deliver an integrated, holistic and collaborative wastewater treatment solution. The scope of the project (i.e. the Metro Area) considers wastewater treatment as a wider network, as opposed to having solutions considered in isolation by individual councils.

By assessing solutions in a boundaryless way, the Project is well placed to achieve a collaborative response to the wastewater treatment issues in the Metro Area. This approach is also consistent with the Three Waters Reform objective of “improving resource coordination and unlocking strategic opportunities to consider national infrastructure needs at a larger scale”.

Wider land use and development decision-making has also been incorporated into the Project to deliver a fully integrated approach. It is expected that the Metro Spatial Plan (as outlined in Appendix B) will evolve to align with the metro wide wastewater treatment strategy to be developed as part of this project.

A core outcome is to improve consistency across resource consents and operational and management practices for WWTPs. The intention is for treatments plants in the Metro Area to have a singular and aligned vision, monitored against consistent standards and on a consistent basis.

This specific benefit stream aims to give effect to Te Ture Whaimana by directly contributing to the following objectives:

- Objective E: The integrated, holistic and coordinated approach to management of the natural, physical, cultural and historic resources of the Waikato River.
- Objective F: The adoption of a precautionary approach towards decisions that may result in significant adverse effects on the Waikato River, and in particular those effects that threaten serious or irreversible damage to the Waikato River.
- Achieving this benefit will also indirectly contribute to other objectives including:
- Objective A: The restoration and protection of the health and wellbeing of the Waikato River.
- Objective H: The recognition that the Waikato River is degraded and should not be required to absorb further degradation as a result of human activities.
- Objective K: The restoration of water quality within the Waikato River so that it is safe for people to swim in and take food from over its entire length.
- Objective J: The recognition that the strategic importance of the Waikato River to New Zealand’s social, cultural, environmental and economic wellbeing is subject to the restoration and protection of the health and wellbeing of the Waikato River.

Benefit Statement 3

Deliver Best for River solutions and approaches for managing growth and resource sustainability. 20%

This project will seek to deliver Best for River approaches that can sustainably cater for growth and development within the Metro Area. As outlined in Benefit Statement 2, the project will incorporate land use and development considerations to better align with future demands on the wastewater network. The intention is to minimise reactive maintenance by creating more flexible and futureproofed wastewater treatment solutions, which can more easily respond to changing circumstances.

Resource sustainability can be achieved by considering solutions, which consolidate or reduce energy and carbon requirements, reuse treated wastewater and rehabilitate land where possible.

This specific benefit stream aims to give effect to the Te Ture Whaimana by directly contributing to the following objectives:

- Objective M: The application to the above [the other 10 Te Ture Whaimana objectives] of both Maatauranga Māori and latest available scientific methods.

Achieving this benefit will also indirectly contribute to all other Te Ture Whaimana objectives (refer to Appendix B). There are also strong linkages between this benefit and the targets and outcomes sought in the World Future Council, Regenerative Cities Report:

Initiating comprehensive political, financial and technological strategies for an environmentally enhancing, restorative relationship between urban communities and the ecosystems from which they draw resources for their sustenance⁵⁵

⁵⁵ World Future Council, October 2010. Regenerative Cities Report. Retrieved 04 Oct 2019, from <https://www.worldfuturecouncil.org/regenerative-cities/>

3.2.2 Opportunities

Opportunities were identified through the Waikato Sub-Regional Three Waters Strategic Case. These related to the benefits which could be realised through integrating river restoration and infrastructure and resourcing opportunities. Both opportunities can be realised as part of this project and are outlined below.

River restoration opportunities

There is a special relationship between Waikato River iwi and the river, reflected in Te Ture Whaimana. Many of Waikato's communities also have strong connections to rivers in the region. An opportunity exists to strengthen these relationships by contributing to the restoration of the health and wellbeing of the Waikato River (through reducing contaminant loading) and increasing the number of customary, recreation and education interactions.

Investment in three waters servicing practices will be insufficient.

Wider catchment land use management changes and investment in restoration will also be required alongside an investment in three waters servicing practices and the adoption of a more integrated approach between three waters services, land use planning and development practices. This Project will inform and be informed by the spatial planning, blue-green corridor and environmental markets work streams being delivered through the Future Proof⁵⁶. Through combining these workstreams, there is an opportunity to better integrate land and water management, which will assist with identifying and prioritising restoration and enhance investment decision-making. This will deliver better outcomes for the river, accelerate progress towards restoring “the health and wellbeing of the awa” and support growth and economic prosperity within the sub-region.

Specifically, the following opportunities to invest in river restoration are available:

- Rehabilitation of existing plant sites that are no longer needed (if centralised solutions are preferred).
- Offsetting techniques such as vegetation zones and exclusion zones.
- Wetlands as an additional treatment process.

As noted below, the consolidation of wastewater treatment facilities across the Metro Area may deliver efficiencies that reduce the overall expenditure on the wastewater network, and may increase funding availability for restoration projects.

⁵⁶ Waikato Business News, 03 April 2019. Pioneering plan sets out blueprint for Corridor growth. Source: <http://wbn.co.nz/2019/04/03/pioneering-plan-sets-out-blueprint-for-corridor-growth/>

Infrastructure and resourcing opportunities

The state of wastewater infrastructure and Waikato River water quality varies greatly in the Waikato sub-region. Local authorities, iwi, communities and industry face significant challenges in meeting current and future wastewater service needs efficiently, while promoting Best for River outcomes. However, significant opportunities also come with these challenges, including economies of scale, greater network resilience and the opportunity for project partners to set strong environmental examples.

In 2015, the operational cost saving for adopting a holistic approach to three waters infrastructure management was estimated at around 10 per cent or \$91 million net present value (NPV) over a 28-year period (when compared to business as usual activities). Cost efficiencies could be achieved through lower operating costs, savings in capital expenditure and innovative procurement strategies. Specific savings would depend on actual size of communities, scope of services, infrastructure spend, distances, technologies and state of existing infrastructure. The cost efficiencies realised through this approach could be utilised to expedite progress towards Best for River outcomes.

Further opportunities exist to improve overall network resilience. As outlined, the condition of three waters infrastructure in the study area varies across assets and the three councils. If greater collaboration and resource sharing is achieved, funding and resources could be shared and targeted at areas of the network that are most at risk of failure. Approaches that provide backup water servicing solutions could be explored or implemented. This in turn will minimise the likelihood of negative environmental and community health and safety impacts.

A wider network approach to wastewater infrastructure will also provide greater consistency across discharge consents, creating further efficiencies for monitoring and enforcement.

Partnering with private industry

Currently several industries in the Metro Area own and operate private WWTPs. This is typically due to the high strength flows which industries produce and the inability for municipal plants to accommodate these flows. Private facilities include Fonterra Hautapu, Fonterra Te Rapa, Fonterra Te Awamutu, AFFCO and the airport.

However private facilities could benefit by partnering with local authorities and conveying wastewater flows to municipal plants (instead of operating a private facility). It would reduce the treatment requirements onsite, minimise operation and maintenance costs and minimise consenting requirements.

A co-funding arrangement between private and public enterprises benefits local authorities by providing additional funding opportunities and allowing for more consistent quality across plants. It also provides greater opportunities for industrial growth as municipal plants can treat high strength flows.

Fonterra Hautapu located just north of Cambridge, indicated an interest in partnering with HCC, Waipā District Council and Waikato District Council as part of this project (i.e. the Waikato wastewater treatment DBC). The opportunity to service Fonterra Hautapu through municipal wastewater systems was explored as part of this DBC. Refer to the Economic Case for more details.

3.2.3 Constraints, Dependencies

The following constraints, dependencies and risk areas will place certain limitations on the types of solutions identified for wastewater treatment in the Metro Area (see Table SC - 11). These are investigated throughout the other Cases with specific technical risks articulated in the Economic Case (Section 5.10) and all risks are detailed within the Management Case (Section 1.5).

Table SC - 11: Key constraints, dependencies and risk areas

Constraint, Dependency or Risk Area	Description
Funding limitations	Currently each council have planned (LTP) funding available for wastewater treatment infrastructure and upgrades. Based on high level cost estimates undertaken in previous investigations, it is expected a preferred solution may require additional funding sources or a reallocation of funds. Funding limitations and constraints will be further investigated within the Financial Case.
Population growth	As identified in Problem 4, the current wastewater treatment network has limited capacity. Growth and development in the Metro Area will mean upgrades and expansions at existing plants will be necessary regardless of the outcomes of this Project. The DBC will seek to develop an option to meet these expectations, but options will still need to be flexible to ensure the network is resilient enough to respond to changes.
Partner expectations	The options investigated may not meet partner expectations which may impact ability to implement the recommendations, consent the preferred solution. Relationships may also be adversely impacted because of poor engagement and project not delivering on 'best for river' outcomes.
Land use	Current and future land uses across the Metro Area will shape where potential new facilities should be located. More detailed constraints mapping exercises will be undertaken to determine ideal locations for new plants and/or pipes. Land use planning is currently being undertaken across the Hamilton metropolitan area which may influence the demand for wastewater in the southern area.
Resource consents and designations	The options investigated may not be consentable, or the costs to deliver a consentable solution may be prohibitive. Consenting timeframes for plants across the Metro area may not align, resulting in more challenging consenting processes, and un-coordinated overall programme delivery.
3 Waters Reform	Reform of the Three Waters sector may impact the ability or commitment to implement the DBC programme recommendations.
Water quality standards	Increases in national water quality standards will have an influence on the option development and assessment process as well as on the water quality standards considered within the assessment process and specifically potential discharges into the Waikato River.
Integrated delivery	Need for councils to deliver an integrated programme may be challenging and poor integration may result in misalignment of objectives and not achieving 'Best for River' principles.
Carbon emission reductions	Treatment of wastewater creates carbon emissions. These can be offset and the requirements to do so are likely to increase and potentially be included as part of consents.
Environmental / Ground Conditions	There will be a need to consider cultural significance and values, environmental impacts and ground conditions in relation to conveyance corridors, WWTP locations and potential land discharge locations. Some of these matters are outlined in relevant reports and investigations relating to site options, discharge options and conveyance options in the business case and subsequent phases on planning and investigation.
Existing utilities	Existing utilities, such as the power grid network, road network and existing reticulation network will be key constraints when determining a potential location for a new plant. More detailed constraints mapping exercises will be undertaken to determine ideal locations.
Wet industry demand	Need to continually monitor potential wet industry demand in the airport precinct and the potential impact on staging timeframes for development of a southern WWTP.
Geographical constraints	Geographical constraints include soil types and topographical constraints. Energy savings can be achieved if the reticulation network can utilise gravity where possible. More detailed constraints mapping exercises will be undertaken to determine ideal locations for new plants and/or pipes.
Conveyance corridor protection	Need to secure conveyance corridors in advance of implementation to reduce adverse impacts from development and other land infrastructure decisions.
Technology constraints	Currently Pukekohe WWTP represents the best available treatment technology (for liquid streams) in New Zealand which is expected to achieve an effluent total nitrogen of 3mg/L. New solid stream and energy efficient technologies will be further investigated as part of this project. This may go beyond what is currently seen in New Zealand but has been demonstrated in other countries.

3.3 Investment Objectives


3.3.1 Best for River Definition

There is significant room for improvement to achieve the water quality targets and objectives of Te Ture Whaimana, as demonstrated through evidence collated when developing the problem statement.

The Best for River definition provided below, was developed as part of the Three Waters Sub-Regional Strategic Case to ensure progress is made towards current, and proposed, central and local Government regulatory targets. This definition is intended to be used as the basis for all three waters projects and assessments completed in the sub-regional area.

Figure SC - 19 below shows the objectives of Te Ture Whaimana grouped by theme and Best for River statements being assessed against their ability to give effect to those objectives.

Figure SC - 19: Best for River definition statements and their alignment with Te Ture Whaimana o Waikato - the Vision and Strategy for the Waikato River

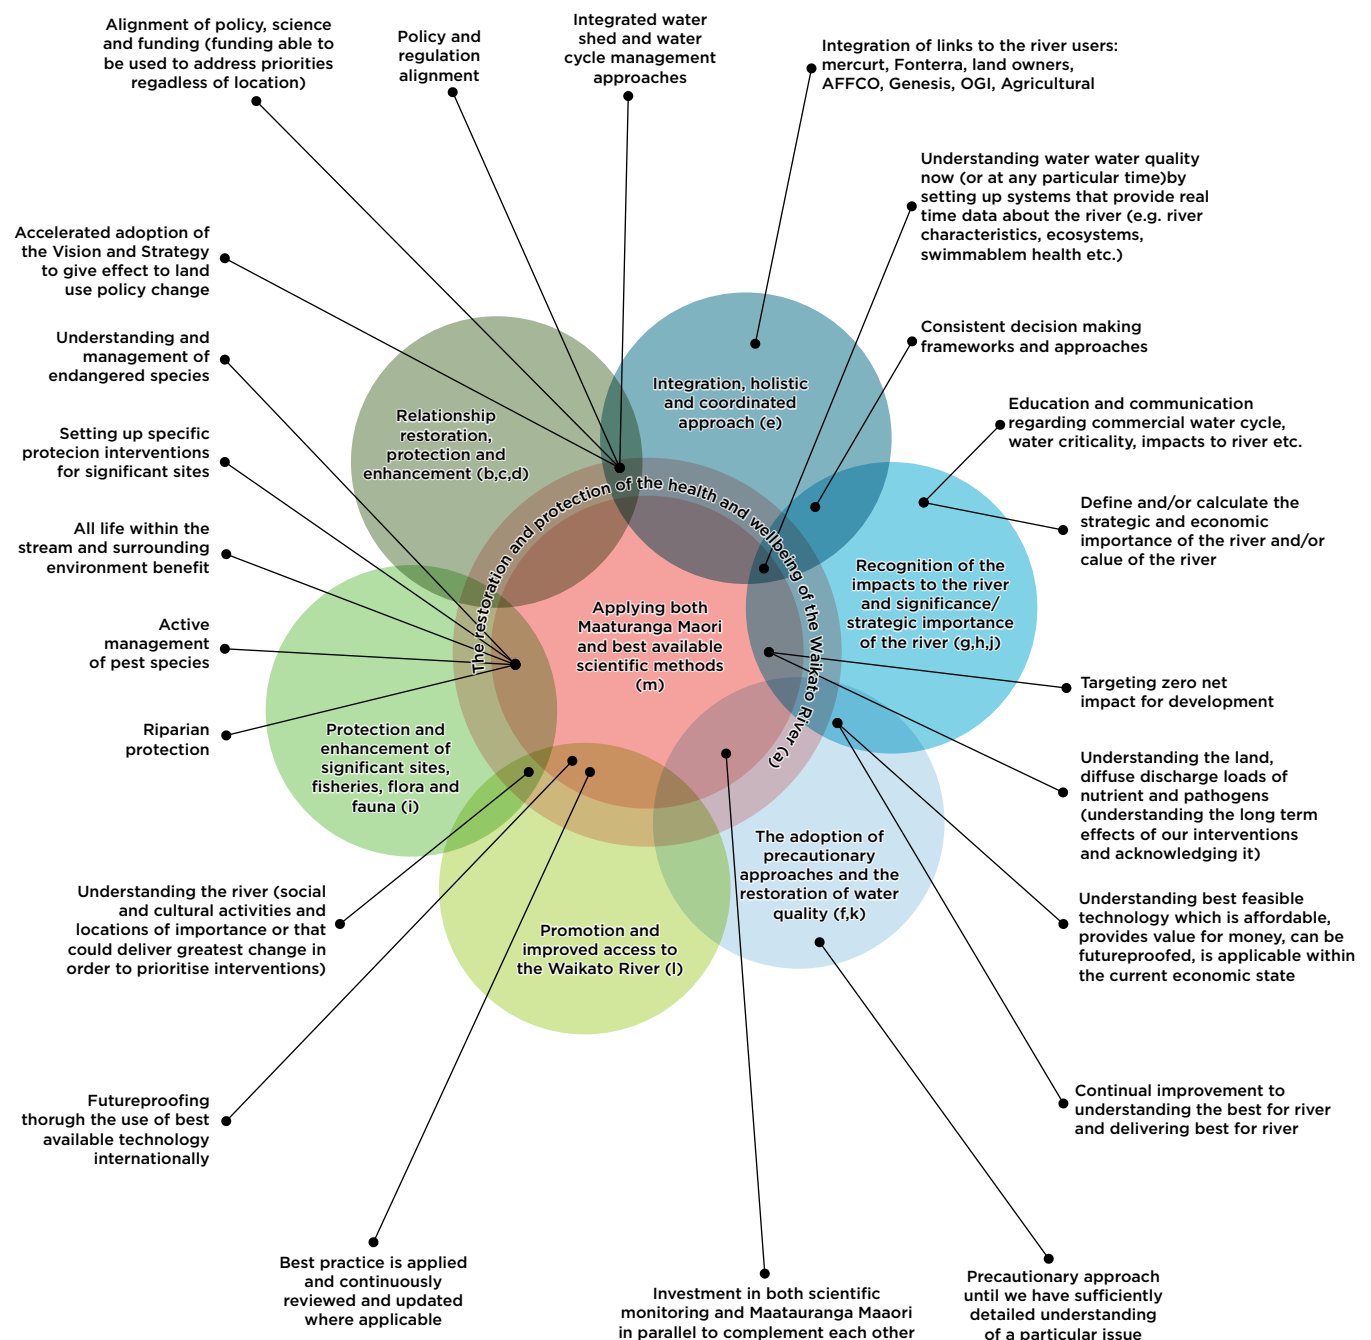

Best for River Statements⁵⁷ were collated into the following 10 draft high level objectives:

The health and well-being of the Waikato River is restored and enhanced.

1. All life within the River (which extends beyond the main stem) and surrounding environment benefit.
2. All of the community (including industry and businesses) understand and are committed to caring for and protecting the River.
3. Cultural connectivity with the River is restored and enhanced.
4. Access to the River to enable customary, sporting, recreational, and cultural opportunities is improved.
5. All water and land resource policy, regulations and decision-making frameworks across the catchment are consistent and fully aligned to achieve Te Ture Whaimana, including RMA instruments and catchment based management approaches.
6. All water and land management decisions are based on robust and comprehensive knowledge and understanding of the river system, including real time and long-term data, sites of significance, social and cultural activities.
7. Achieve net benefit to the environment.
8. Increase the efficient use of resources and maximise resource recovery and contribution toward carbon neutrality and energy neutrality.
9. Apply and maintain best practice to all three waters management and infrastructure which allows for the sustainable future growth of the Waikato region.

3.3.2 Project Objectives

For the purpose of this DBC, the high-level objectives developed from the Best for River Statements need to be tailored and refined to become SMART objectives (Specific, Measurable, Attainable, Relevant and Time bound)⁵⁸. They must be tailored to reflect wastewater-specific issues within the Metro Area, as the project has limited ability to directly influence other three waters issues. The project can indirectly influence water supply, water resilience outcomes through the solutions adopted and through integrated planning and water services. The following objectives have been developed to align with Te Ture Whaimana and the Best for River definition.

Table SC - 12: DBC Objectives and alignment to Best for River

Best for River definition	Corresponding Metro DBC Objective
1. The whole of river water quality is improved	1. Before 2050 municipal wastewater discharges are no longer impacting on the ability of people to swim and collect kai from the river and connected waterways; thereby contributing to the restoration and protection of the health and wellbeing of the river.
8. Achieve net benefit to the environment	
2. All life within the River (which extends beyond the main stem) and surrounding environment benefit	2. The quality and extent of aquatic and terrestrial habitat and biodiversity in and around water bodies is enhanced through the reduction of wastewater treatment and discharge impacts before 2050.
8. Achieve net benefit to the environment	
4. Cultural connectivity with the river is restored and enhanced	3. Wastewater treatment solutions contribute to restoring and enhancing cultural connectivity with the river so that before 2050, marae, Hapuu and Iwi access to the river and other sites of significance for cultural and customary practice within the Metro Area are no longer impeded by wastewater treatment solutions.
5. Improve access to the Waikato River to better enable sporting, recreational, and cultural opportunities.	
9. Increase the efficient use of resources, maximise resource recovery and contribute towards carbon neutrality and energy neutrality	4. Maximise efficient use of resources and resource recovery to contribute to net zero greenhouse gas related emissions from wastewater treatment systems before 2050
3. Apply and maintain best practice to all three waters management and infrastructure which allows for the sustainable future growth of the Waikato region.	5. The wastewater solution provides sufficient capacity to ensure sustainable growth in the Metro Area in accordance with growth projections for the next 100 years.

⁵⁷ Note: Best for River definition statements are displayed around the outside of the Venn diagram. Te Ture Whaimana objectives are grouped by theme and shown in the shaded circles. The lines between the Best for River definition statements and the Te Ture Whaimana objectives demonstrate the linkages between the two.

⁵⁸ As per Better Business Case Guidelines

The Metro DBC SMART objectives capture the majority of the Best for River outcomes with the exception of the following:

3. All of the community understand and are committed to caring for and protecting the River
6. All water and land resource policy, regulations and decision-making frameworks across the catchment are consistent and fully aligned to achieve the V&S, including RMA instruments and catchment-based management approaches.
7. All river and land management decisions are based on robust and comprehensive knowledge and understanding of the river system, including real time and long-term data, sites of significance, social and cultural activities.

It is proposed that these elements are captured elsewhere within the design and assessment process (refer to Table SC - 13:).


Table SC - 13: Additional Best for River considerations.

Best for River Definition	How it is being considered in the Metro DBC
3. All of the community (including industry and businesses) understand and are committed to caring for and protecting the River.	<p>The project itself will have limited ability to influence this outcome. However, Community Acceptability is proposed as part of the MCA criteria. This assesses options from a community perspective, highlighting whether it is likely the community will accept the option.</p> <p>As part of the implementation process, community engagement and consultation are also expected to occur to provide affected communities with a greater understanding of the specific project. This will occur regardless of the option chosen.</p>
6. All water and land resource policy, regulations and decision-making frameworks across the catchment are consistent and fully aligned to achieve the V&S, including RMA instruments, catchment-based management approaches.	<p>This is better placed as a design principle when considering future consenting conditions of the plants (and options). The alignment of consenting conditions to better reflect Te Ture Whaimana will be required for all options. As part of the development of options, consistent standards will be applied. There will be a more specific focus on the preferred option to ensure best for river outcomes are being delivered.⁵⁹</p> <p>Additionally, as part of the formation of Taumata Arowai (the new drinking water regulator), national wastewater standards are expected to be developed which will also assist with the standardisation of consents.</p> <p>An additional criterion has been added to the MCA which assesses the risk of options breaching consenting requirements as this has been identified as an ongoing issue in the region.</p>
7. All river and land management decisions are based on robust and comprehensive knowledge and understanding of the river system, including real time and long-term data, sites of significance, social and cultural activities.	<p>Like above, this will be considered as part of the design process. All options will be developed based on the most up to date information and consider longer-term data sources to allow for future demands. Data capture opportunities as part of the project will be leveraged to enhance the quantity and quality of available data</p>

Figure SC - 20: provides a map of the problems, benefits, best for river definition and objectives.

⁵⁹ Waikato Regional Council is currently in a Regional Plan variation process. The variation is designed to give effect to Te Ture Whaimana and will result in policy that point source and diffuse dischargers will need to respond to.

Figure SC - 20: Investment Logic Map

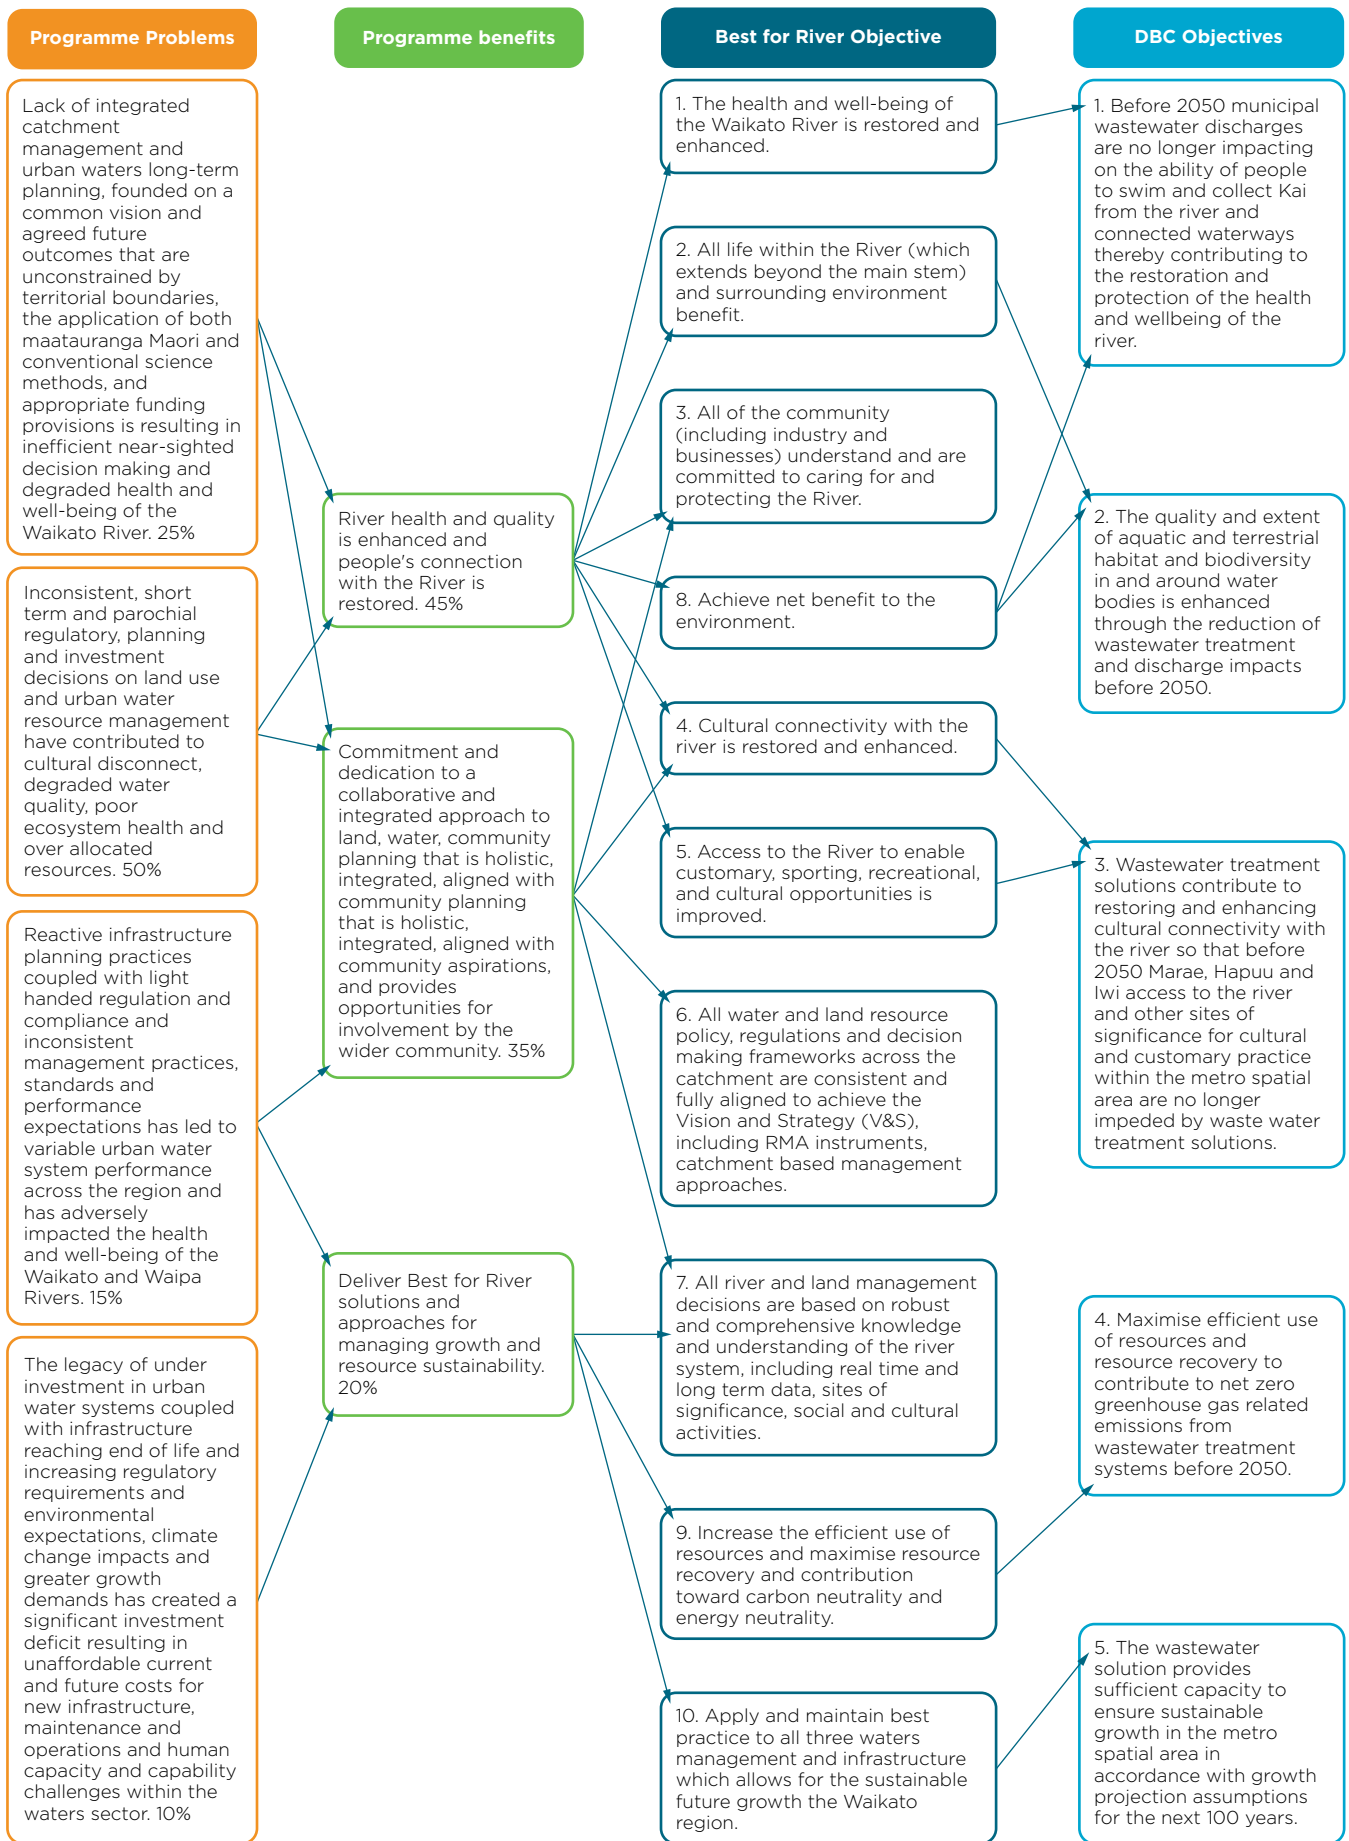

3.3.3 KPIs and Measures

The following Key Performance Indicators (KPIs) were identified as the best measures to reflect Project objectives. These KPIs use the most up to date sources and real time data to ensure baselines and targets are accurate and quantifiable.

Table SC - 14: KPIs and relevant data sources

Objective	KPI	Source
1. Before 2050 municipal wastewater discharges are no longer impacting on the ability of people to swim and collect kai from the river and connected waterways thereby contributing to the restoration and protection of the health and wellbeing of the river	KPI 1.1: Public health risks caused by the concentration of E.coli within the WWTP discharges	Develop monitoring system to measure E.coli, Nitrogen and Phosphorous levels from specific discharges and the associate point source balance for each plant within the Metro Area which we are affecting and compare against Baseline. Indicative values can be estimated based on baseline nutrient assessment.
	KPI 1.2 Concentration of Total Nitrogen contaminants impacting the river and connected waterways from WWTPs	
	KPI 1.3: Concentration of Total Phosphorous contaminants impacting the river and connected waterways from WWTPs	
	KPI 1.4: Proportion of plants which are compliant against discharge quality consent conditions	
2. The quality and extent of aquatic and terrestrial habitat and biodiversity in and around water bodies is enhanced through the reduction of wastewater treatment and discharge impacts before 2050	KPI 2.1: Amount of algal biomass in the Waikato River as measured by chlorophyll a concentration attributable to treated wastewater discharges	Develop monitoring system to measure Chlorophyll a concentration at specific locations along the river.
	KPI 2.2: Health and abundance of mahinga kai species	Surveys of mahinga kai in terms of species health, variety and number. Sites for this will need to be determined based on sites which may be affected most by the current wastewater network.
	KPI 2.3: Number and variety of terrestrial species at specific locations within the Metro Area	Surveys of terrestrial species with regards to their health, variety and number to be developed at sites which are identified for rehabilitation
	KPI 2.4: Area coverage of native riparian vegetation surrounding water bodies and within the catchment area	Native vegetation coverage (hectares) across the Metro Area can be determined using GIS 2018 data sources for land cover. Coverage of wetland vegetation can also be determined using this data source.
3. Wastewater treatment solutions contribute to restoring and enhancing cultural connectivity with the river so that before 2050 Marae, Hapuu and Iwi access to the river and other sites of significance for cultural and customary practice within the metro spatial area are no longer impeded by wastewater treatment solutions.	KPI 3.1: Maatauranga Maaori Cultural Health Index / Cultural impact assessment	To be determined through further engagement and development with iwi and hapu
	KPI 3.2: Number and quality of access points to the river for cultural and recreational activities and quality of the interaction with the river	Waikato Fishing and Game website. Hamilton City River Plan Other sources to be determined Quality of access points to be determined

Objective	KPI	Source
4. Maximise efficient use of resources and resource recovery to contribute to net zero greenhouse gas related emissions from wastewater treatment systems before 2050	KPI 4.1: Water reuse, water allocations and accounting	Currently no plant in the Metro Area which is capable of re-using water. Data sources for capturing this will need to be established as technology is advanced for water re-use.
	KPI 4.2: Carbon footprint / Energy requirements of plant and plant systems (i.e. pumps)	Average energy consumption per plant (including pumping stations) sourced from councils. Carbon accounting systems will need to be developed in the future.
	KPI 4.3 Proportion of biosolids that are able to be safely reused for beneficial purposes	Currently no plant in the Metro Area which is capable of re-using biosolids. Data sources for capturing this will need to be established as technology is advanced.
5. The wastewater solution provides sufficient capacity to ensure sustainable growth in the metro spatial area in accordance with growth projection assumptions for the next 100 years	KPI 5.1: Flexibility and adaptability of solution to be staged / developed over time to meet the needs of the community.	Measures can be taken by assessing the staging attributes of the option and ability to adapt the solution to changing populations and land use.
	KPI 5.2: Proportion of Industrial areas which are serviced by municipal plants sustainably	Baseline the industrial areas in the Metro Area which are currently serviced by municipal plants (and those serviced by private facilities).
	KPI: 5.3 Proportion of residents in the Metro Area serviced by municipal treatment plants sustainably	Baseline the number of households in the Metro Area which are currently serviced by municipal plants

Weightings were discussed and considered for the criteria and in particular the investment objectives. It was agreed that weightings were difficult to apply as various criteria are likely to have different levels of importance at different time horizons. For example, the ability to meet higher growth in the longer term may not materialise for 30 years. Therefore, it was agreed to assess option on the balance of outcomes and the assessments as a whole rather than a weighted score. The options considered to achieve appropriate level of outcomes were identified and progressed.

Baselines and Targets

Many of the above data capture and monitoring sources need to be developed as part of this Project. Baseline and target measures will be developed once the monitoring systems are in place. Nutrient baselines have been developed for each of the existing plants, which can provide indicative measures for water quality. Plan Change 1 targets will form the basis of water quality targets.

3.3.4 Strategic Alignment of Objectives

The following section outlines how the above project objectives align with overarching strategic goals for the Waikato region, Futureproof partners, Iwi and Central Government.

Three Waters Reform Programme

The recently announced Three Waters Reform Programme, co-ordinated by DIA, outlines six key objectives. The Waikato Wastewater Treatment DBC aligns with these objectives in the following way:

- A. Significantly improving safety and quality of drinking water services and the environmental performance of wastewater and storm water systems.
 - Objective 1 and 2 of the DBC directly relate to the improved environmental performance of wastewater infrastructure within the Metro Area, from a water quality and water ecosystems perspective.
- B. Ensuring all New Zealanders have access to three waters services
 - Objective 5 refers to providing wastewater services to maintain sustainable growth within the Metro Area. This objective specifically measures the proportion of residents who are serviced by municipal plants.
- C. Improving resource coordination and unlocking strategic opportunities to consider national infrastructure needs at a larger scale.
 - Objective 5 again refers to providing wastewater services which allow for the sustainable growth of the Metro Area. This includes measuring the ability to unlock additional growth areas for both residential and industrial purposes which align to overarching strategic planning goals. It should be noted that large scale infrastructure is one of the mechanisms for achieving this and that this, itself, is delivered through the collaboration of the DBC partners.
- D. Increasing resilience of three waters service provision to both short and long-term risks, particularly climate change and natural hazards.
 - Resilient wastewater infrastructure hasn't strictly been identified as one of the key five objectives. But it has been identified as a critical success factor to be included as a key criteria for the MCA. Options resilient to climate change and natural hazard risks will be scored more highly.
- E. Moving services to a more financially sustainable footing, and addressing the affordability and capability challenges faced by small suppliers and councils.
 - This has not identified as one of the five key objectives for the Project. However funding potential of options has been identified as a critical success factor. Options will consider larger-scale options and potential co-governance and co-funding systems. Again, the collaboration of the DBC partners provides greater ability to fund and finance the project.
- F. Improving transparency and accountability in cost and delivery of three waters services, including the ability to benchmark performance of service providers.
 - This can be achieved through the better business case process, which provides transparency throughout the decision-making process. Additionally, the benefits realisation plan will ensure performance measures are benchmarked and monitored throughout the lifespan of the project.

Sub-Regional Three Waters Strategy

Table SC - 15: below provides an outline of how this project aligns with the goals identified within Futureproofs Sub-regional Three Waters Strategy.

Table SC - 15: Strategic alignment with Sub-regional Three Waters Strategy

Sub-Regional Three Waters Goals	Alignment to DBC objectives
Proactively protect, promote and improve public health and safety.	Objective 1 refers to improving the quality of the water to make it safe for swimming and the collection of kai. A KPI specifically measures public health risk.
Provide for the water needs of the sub-region for the next 50 years in an efficient and sustainable manner.	Objective 5 refers to providing wastewater services which allow for the sustainable growth of the Metro Area to 2080.
Ensure an understanding of, and the provision for, changing future needs, demands and issues within the sub-region.	
Promote an understanding of, and ensure appropriate planning for, the effects of climate change.	A key criterion of the MCA will consider the resilience of wastewater infrastructure to climate change effects. Options which are more resilient to climate change and natural hazard risks will be scored more highly.
Promote the sustainable and economic use and delivery of Three Waters resources and services.	Objective 4 works towards achieving net zero greenhouse emissions and sustainable use of resources.
Ensure the efficient utilisation of existing assets.	
Co-operatively manage and plan for Three Waters in the sub-region.	Options will consider larger scale options and potential co-governance and co-funding systems.
Provide for the water needs for the sub-region for the next 50 years in an efficient and sustainable manner.	Objective 5 refers to providing wastewater services that allow for the sustainable growth over the next 50 year period.
Promote the sustainable use of resources.	Objective 4 works towards achieving sustainable use of resources, including water and energy
Promote the recognition of cultural values.	Objective 3 refers specifically to enhancing cultural connectivity and improving access to the river. The restoration of the health and wellbeing to the river is core to the overall project.
Give effect to Te Ture Whaimana o Te Awa o Waikato, The Vision and Strategy for the Waikato River	All objectives refer back to the Te Ture Whaimana through Best for River objectives
Promote the restoration and protection of the health and wellbeing of our waterways and their catchments.	Both Objective 1 and 2 refer to improving the quality of water and the quality of water ecosystems.

United Nations Sustainable Development Goals

The Sustainable Development Goals are the blueprint to achieve a better and more sustainable future for all. They address global challenges, including those related to poverty, inequality, climate change, environmental degradation, peace and justice. The 17 Goals are all interconnected, and in order to leave no one behind, it is important that we achieve them all by 2030. Of the 17 goals, this project can actively contribute to eight (see Table SC - 16). The project does not have any objectives that are inconsistent with the UN Sustainable development goals.

Table SC - 16: Strategic alignment with UN Sustainable development goals

UN Sustainable Development Goals	Alignment to DBC
Goal 3: Good Health and Well-Being Ensuring healthy lives and promoting the well-being for all at all ages is essential to sustainable development.	A key objective is to ensure the river is safe for swimming and the collection of kai. This links to ensuring public health objectives are achieved
Goal 6: Clean Water and Sanitation Clean, accessible water for all is an essential part of the world we want to live in	This project focuses on the restoration and improvement of the health and wellbeing of the river and also providing access to the river
Goal 7: Affordable and Clean Energy Energy is central to nearly every major challenge and opportunity.	Objective 4 works towards achieving sustainable use of resources, including water and energy
Goal 9: Industry, Innovation, and Infrastructure Investments in infrastructure are crucial to achieving sustainable development.	The project focuses on improvement of wastewater infrastructure in order to improve the quality of the water and to sustainably cater for growth
Goal 11: Sustainable Cities and Communities There needs to be a future in which cities provide opportunities for all, with access to basic services, energy, housing, transportation and more.	The project focuses on delivering wastewater services to areas which currently do not have access to these facilities.
Goal 13: Climate Action Climate change is a global challenge that affects everyone, everywhere.	Resilience to climate change has been identified as a critical success factor to be included as a key criteria for the MCA. Options resilient to climate change and natural hazard risks will be scored more highly.
Goal 14: Life Below Water Careful management of this essential global resource is a key feature of a sustainable future	Objective 2 focuses on restoring and enhancing aquatic ecological habitats and biodiversity
Goal 15: Life on Land Sustainably manage forests, combat desertification, halt and reverse land degradation, halt biodiversity loss	Objective 2 focuses on restoring and enhancing terrestrial ecological habitats and biodiversity

National Policy Statement (NPS) for Freshwater Management 2020

The objective of this NPS is to ensure that natural and physical resources are managed in a way that prioritises:

- First, the health and well-being of water bodies and freshwater ecosystems.
- Second, the health needs of people (such as drinking water).
- Third, the ability of people and communities to provide for their social, economic, and cultural well-being, now and in the future.

This DBC directly aligns with the first objective given that the restoration of the health and wellbeing of the river is core to the overall project. Ensuring that both water and terrestrial ecosystems are no longer impacted by wastewater treatment also plays a key role within this project. Public health and wellbeing to the community has been identified as a KPI, as has the ability to maintain cultural connectivity and access to the river for the wider community. Therefore there is alignment to all three key objectives.

Waikato-Tainui Environmental Management Plan

The Waikato-Tainui Environmental Plan (the Environmental Plan), Tai Tumu Tai Pari Tai Ao, is designed to enhance Waikato-Tainui participation in resource and environmental management and provides a baseline for approaching environmental matters of importance to Waikato-Tainui. A key strategic objective outlined within the Waikato Tainui Environmental Management plan is to maintain tribal identity and integrity, including “to grow our tribal estate and manage our natural resources.”

The Plan provides is a tool to provide clear high-level guidance on Waikato-Tainui objectives and policies with respect to the environment to resource managers, users and activity operators, and those regulating such activities, within the Waikato-Tainui rohe.

The Plan seeks to have waters that are drinkable, swimmable, and fishable and contains objectives and policies to achieve this. Some of the key objectives from the plan that align with the DBC are included below. This is not a comprehensive analysis of all of the areas of alignment, but provides examples, of how the DBC gives effect to many of the objectives sought through the plan.

Table SC - 17: Strategic alignment with Tai Tumu Tai Pari Tai Ao

Tai Tumu, Tai Pari, Tai Ao Objectives	Alignment to DBC
Alignment with Whakatupuranga 2050	Of the 10 strategic objectives outlined within the Whakatupuranga 2050, this project can work towards the following three: <ul style="list-style-type: none"> • Objective 3: to preserve our tribal heritage, reo and tikanga • Objective 4: to grow our tribal estate and manage our natural resources • Objective 10: to develop and sustain our economic capacity
Strategic objective 10.3.2 Tribal identity and integrity	Sites of cultural significant will be identified and preserved through any land development activities. Additionally, access to sites of cultural significance (including access to the river for customary activities) will be considered for enhancement where possible.
Strategic objective 10.3.4 Tribal Social and Economic Wellbeing	One of the key objectives of the project is to provide wastewater services to support the economic prosperity of the Metro Area in a manner that contributes to the restoration and protection of the Waikato River.
Objective 19.4.1 _ Waikato-Tainui engage and participate in the highest level of decision-making on matters that affect waters in the Waikato-Tainui rohe.	Waikato-Tainui and mana whenua have developed this DBC alongside Council partners. The contribution has been made throughout the project delivery and at all levels from technical input through to project governance and decision making.
Objective 19.4.2 Water quality is such that fresh waters within the rohe of Waikato-Tainui are drinkable, swimmable and fishable in all places (with water quality to the level that Kiingi Taawhiao could have expected in his time).	The DBC seeks to give effect to the enhancement principles outlined in the plan. There is a high level of alignment between the plan and the project, specifically the investment objectives: <ul style="list-style-type: none"> • 1. Before 2050 municipal wastewater discharges are no longer impacting on the ability of people to swim and collect kai from the river and connected waterways thereby contributing to the restoration and protection of the health and wellbeing of the river • 2. The quality and extent of aquatic and terrestrial habitat and biodiversity in and around water bodies is enhanced through the reduction of wastewater treatment and discharge impacts before 2050 • 3. Wastewater treatment solutions contribute to restoring and enhancing cultural connectivity with the river so that before 2050, marae, Hapuu and Iwi access to the river and other sites of significance for cultural and customary practice within the Metro Area are no longer impeded by wastewater treatment solutions • 4. Maximise efficient use of resources and resource recovery to contribute to net zero greenhouse gas related emissions from wastewater treatment systems before 2050
26.3.1 Infrastructure development, upgrade and maintenance within the Waikato-Tainui rohe occurs in partnership with Waikato-Tainui	
26.3.2 Infrastructure development, upgrade and maintenance manages economic, social, cultural, spiritual and environmental effects.	
26.3.3 Liquid, solid and hazardous waste management is best practice and manages social, cultural, spiritual and environmental effects.	

Ngāti Hauā Environmental Management Plan

The Ngāti Hauā Environmental Management Plan expresses the values, aspirations and position statements in relation to taiao (environment), covering topics such as the health and wellbeing of the lands and waters and wetlands, urban developments, cultural heritage and development of Maori land. This DBC aligns with several of the objectives identified within this plan (see Table SC - 18:).


Table SC - 18: Strategic alignment with Ngāti Hauā Environmental Management Plan

Ngāti Hauā Environmental Management Plan	
1. The Plan Purpose - The health and well-being of our lands, air, waters and wetlands and fisheries	This is related to a number of the investment objectives including: <ul style="list-style-type: none"> • for land; investment objective 2 - aquatic and terrestrial habitat and biodiversity • for water and wetlands, investment objective 2 - ability of people to swim and collect Kai from the river and connected waterways
8. Wai – water is considered to be the life blood of Papatuanuku (earth mother), that falls upon her as the tears of Ranginui (sky father)	Related to Investment Objective 1 and reflects the centrality of Wai to this project - Before 2050 municipal wastewater discharges are no longer impacting on the ability of people to swim and collect kai from the river and connected waterways thereby contributing to the restoration and protection of the health and wellbeing of the river
9. Sustainable land use and development Relevant issues identified include impacts on water quality, contaminated soils and increased use of agri-chemicals	Related to problem statements 1 & 2 relating to land and water management practices; specifically that development and land use changes often occur without full appreciation of the impacts on wastewater infrastructure and the investment needed to provide capacity for long-term growth
9.3 Encourages water and energy use efficiency measure	Related to Investment Objective 4 - Maximise efficient use of resources and resource recovery to contribute to net zero greenhouse gas related emissions from wastewater treatment systems before 2050
11. Te Wai Māori – Water This section of the plan has significant detail on the issues, objectives and relevant policies. Some key aspects include: <ul style="list-style-type: none"> • Te Mana o Te Wai is recognised and demonstrated • Develop a way of measuring the health of our rivers, streams and aquifers from a cultural point of view 	There is a high level of alignment between the plan and the project, specifically the investment objectives: <ul style="list-style-type: none"> • 1. Before 2050 municipal wastewater discharges are no longer impacting on the ability of people to swim and collect kai from the river and connected waterways thereby contributing to the restoration and protection of the health and wellbeing of the river • 2. The quality and extent of aquatic and terrestrial habitat and biodiversity in and around water bodies is enhanced through the reduction of wastewater treatment and discharge impacts before 2050 • 3. Wastewater treatment solutions contribute to restoring and enhancing cultural connectivity with the river so that before 2050, marae, Hapuu and Iwi access to the river and other sites of significance for cultural and customary practice within the Metro Area are no longer impeded by wastewater treatment solutions



Economic Case

He Keehi Whakarauora - he tirohanga whaanui

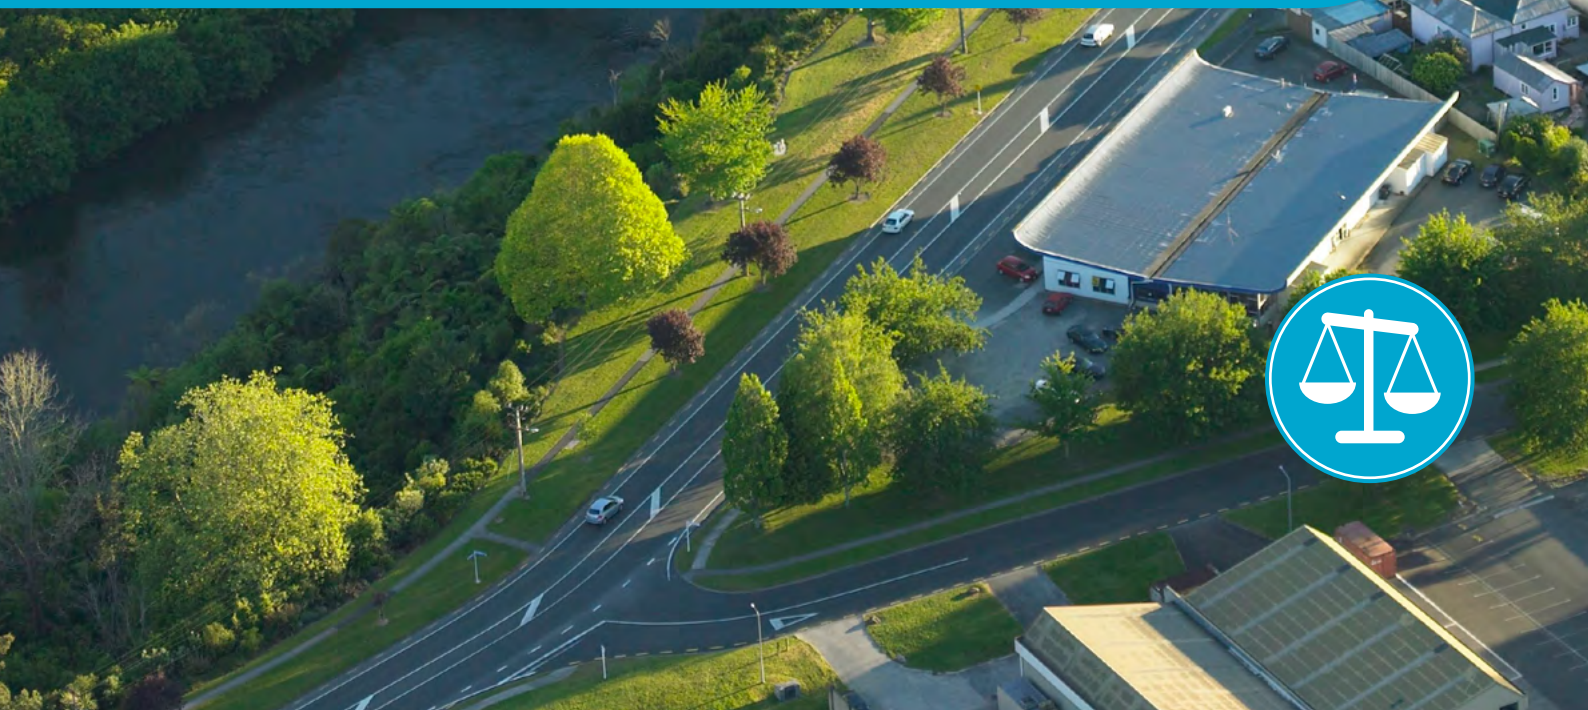

Economic Case Contents

1. Introduction	83
1.1 Purpose	83
1.2 Project Objectives and Outcomes	84
1.2.1 Te Ture Whaimana objectives	85
1.2.2 Metro DBC Project Objectives	86
1.2.3 Growth	86
1.3 Option Development and Assessment Methodology	87
2. MCA Assessment	89
2.1 Multi Criteria Analysis (MCA) Framework	89
3. Longlist Options	92
3.1 Introduction	92
3.2 Longlist Option Development	93
3.3 Longlist Options MCA Assessment Summary	95
3.3.1 Long List Assessment Outcome Summary	98
4. Shortlist Option Development and Assessment	99
4.1 Introduction	99
4.1.1 Pukete WWTP Capacity Assessment	100
4.2 Shortlist Option Descriptions	101
4.3 Shortlist Options Assessment	105
4.3.1 Shortlist Option Assessment – Investment Objective Differentiators	107
4.3.2 Shortlist Options Net Present Value (NPV) Assessment	108
4.3.3 Other Key Risk and Opportunity Considerations	108
4.4 Preferred Option Selection	109
4.4.1 Refinement Opportunities for Selected Preferred Option (Option 4A)	109
5. Preferred Option	111
5.1 Preferred Option Refinement	111
5.2 Overview of the Preferred Option	111
5.3 Treatment Plant Performance Standards	115
5.4 Conceptualised Treatment Processes	116
5.5 Water Discharges	117
5.6 Southern Wastewater Treatment Plant: Staging and Key Considerations	117
5.6.1 Stage 1 – SBR with Discharge to Land	119
5.6.2 Stage 2 – MBR with discharge to Waikato River	120
5.6.3 Stage 3 – MBR with Energy Recovery (Primary Sedimentation and Digestion) with discharge to Waikato River	122

5.7 Conveyance	123
5.8 Nutrient Summary	126
5.9 Other Wastewater Treatment Plant Upgrades	127
5.10 Risks	129
5.11 Recommended Investigation and Design	132
5.12 Cost Estimates	132
5.13 Implementation	136

Figures

<i>Figure EC - 1: Process and key milestones to identify the preferred wastewater option</i>	88
<i>Figure EC - 2: Wastewater treatment plants within the Waikato Metro Area (study area)</i>	92
<i>Figure EC - 3: Diagrammatic Overview of Short-listed Metro Area Wastewater Servicing Options</i>	99
<i>Figure EC - 4: Pukete WWTP Flow Projections</i>	100
<i>Figure EC - 5: Option 2A - 3 Plant Option</i>	102
<i>Figure EC - 6: Option 4A - Five Plant Option</i>	104
<i>Figure EC - 7: Preferred Option Overview - Key features and overview of staging of Southern Sub-Regional WWTP</i>	113
<i>Figure EC - 8: Southern Sub-Regional WWTP Assumed Staging and Capacity (Population Equivalents)</i>	118
<i>Figure EC - 9: Stage 1 Southern Sub-Regional WWTP Configuration</i>	119
<i>Figure EC - 10: Stage 2 Southern Sub-Regional WWTP Configuration</i>	121
<i>Figure EC - 11: Stage 3 Southern Sub-Regional WWTP Configuration</i>	122
<i>Figure EC - 12: Assumed Stage 1 and 2 Service Areas and Stage 2 Conveyance details</i>	124
<i>Figure EC - 13: Assumed Stage 1, 2 and 3 Service Areas and Stage 3 Conveyance details</i>	125
<i>Figure EC - 14: Baseline and predicted nutrient loads for the Cambridge WWTP and Airport Southern Sub-Regional WWTP combined</i>	127
<i>Figure EC - 15: Proposed Project Activities (Management Case - Section 1.2.4)</i>	132
<i>Figure EC - 16: Preferred Option implementation plan</i>	137

Tables

<i>Table EC - 1:</i>	<i>Key Stakeholder Workshop Participants – Metro Wastewater DBC Short List Options Phase.....</i>	<i>87</i>
<i>Table EC - 2:</i>	<i>Scoring definitions.....</i>	<i>89</i>
<i>Table EC - 3:</i>	<i>MCA criteria descriptions.....</i>	<i>90</i>
<i>Table EC - 4:</i>	<i>High level option descriptions²⁰.....</i>	<i>94</i>
<i>Table EC - 5:</i>	<i>Longlist Option MCA Summary.....</i>	<i>95</i>
<i>Table EC - 6:</i>	<i>Option 2A and Option 4A – Smaller Settlement Servicing Assumptions.....</i>	<i>105</i>
<i>Table EC - 7:</i>	<i>Shortlist Options MCA Investment Objective Summary of results.....</i>	<i>106</i>
<i>Table EC - 8:</i>	<i>Shortlist Options MCA Critical Success Factors (Consenting and Implementation) Summary of results.....</i>	<i>107</i>
<i>Table EC - 9:</i>	<i>Shortlist Options – Southern Metro Area Net Present Value.....</i>	<i>108</i>
<i>Table EC - 10:</i>	<i>Summary of Preferred Option WWTPs, Service Areas and Population Equivalents Served over time.....</i>	<i>114</i>
<i>Table EC - 11:</i>	<i>Minimum water quality standards for discharges to water.....</i>	<i>115</i>
<i>Table EC - 12:</i>	<i>Minimum water quality standards for discharges to ground.....</i>	<i>115</i>
<i>Table EC - 13:</i>	<i>Treatment Concept Development.....</i>	<i>116</i>
<i>Table EC - 14:</i>	<i>Southern Treatment Concept Staging (note that these are further refined in the Financial Case).....</i>	<i>118</i>
<i>Table EC - 15:</i>	<i>Option 4A Cambridge WWTP Base Staging.....</i>	<i>128</i>
<i>Table EC - 16:</i>	<i>Technical Risk Summary.....</i>	<i>130</i>
<i>Table EC - 17:</i>	<i>Stage 1 Capital Cost Estimate Breakdown (2026).....</i>	<i>133</i>
<i>Table EC - 18:</i>	<i>Stage 2 Capital Cost Estimate Breakdown (2041 and 2051).....</i>	<i>133</i>
<i>Table EC - 19:</i>	<i>Stage 3 Capital Cost Estimate Breakdown (2061).....</i>	<i>134</i>
<i>Table EC - 20:</i>	<i>Preferred Option Cost Summary (un-escalated and excluding Southern Sub-Regional WWTP).....</i>	<i>135</i>

1. Introduction

1.1 Purpose

This report sets out the Economic Case for the Waikato Southern Metro Area Wastewater Detailed Business Case (Southern Metro DBC).

The purpose of the Economic Case is to evaluate options available to address the problems identified in the Strategic Case. The assessment of these options uses several criteria including the project objectives which have been identified in the Strategic Case and other critical success factors. The Economic Case aims to identify a Preferred Option that delivers best public value including wider social and environmental effects.

This report provides an overview of the preferred option, the approach to the development and assessment of options and the refinement and details of the preferred option.

In the Waikato, there are few fully compliant municipal wastewater treatment plants (WWTPs) and the majority of municipal wastewater discharge consents will expire in the next 10 years. Many Waikato communities require urgent investment in their three waters infrastructure to address existing and future performance requirements and needs.

Territorial authorities are under increasing pressure to provide new and enhanced infrastructure that progress toward achieving Te Ture Whaimana and the objectives set out in the National Policy Statement (NPS) for Freshwater Management; deliver on community expectations for environmental quality; respond to growth pressures and unlock the economic potential of their communities.

Territorial authorities have budgeted for significant investment in their three waters services in their 2018-2028 long term plans (LTPs). However, this level of investment is unlikely to satisfy regulatory obligations (particularly following the establishment of Taumata Arowai), or adequately respond to current and future growth pressures and long-term environmental expectations.

The Waikato Sub-Regional Three Waters Strategic Case was approved in December 2019, which provided a compelling case for change in the way that water, wastewater, and stormwater (three waters) services are planned, managed and delivered in the Lower Waikato and Waipā river catchments. A Waikato Sub-Regional Three Waters Programme Business Case (PBC) is being developed and expected to be completed in 2023. The PBC will incorporate the work undertaken to complete this DBC as well as the work currently being undertaken for the Northern DBC in relation to Wastewater. The PBC will incorporate this information with water supply and stormwater to recommend a sub-regional three waters investment programme.

1.2 Project Objectives and Outcomes

This project seeks to identify long-term wastewater treatment solutions for the Waikato-Hamilton Waipā Metro Area. This report covers the area from the southern part of Hamilton City, through to Cambridge, Te Awamutu and Kihikihi (known as the Southern Metro Area). It evaluates sub-regional solutions that operate across territorial boundaries to deliver higher quality outcomes, community benefits and overall efficiencies compared to solutions constrained by territorial boundaries.

This project vision is derived from Te Ture Whaimana o te awa o Waikato:

Tooku awa koiora me oona pikonga he kura tangihia o te maataamuri

*“The river of life, each curve
more beautiful than the last”*

...a future where a healthy Waikato River sustains abundant life and prosperous communities who, in turn, are all responsible for restoring and protecting the health and wellbeing of the Waikato River, and all it embraces, for generations to come¹⁵.

15 Te Ture Whaimana o te Awa o Waikato



1.2.1 Te Ture Whaimana objectives

The project aims to give effect to Te Ture Whaimana and the Best for River definition by directly contributing to the objectives from Te Ture Whaimana:

1. The restoration and protection of the health and wellbeing of the Waikato River.
2. The restoration and protection of the relationship of Waikato-Tainui with the Waikato River, including their economic, social, cultural, and spiritual relationships.
3. The restoration and protection of the relationship of Waikato River iwi according to their tikanga and kawa, with the Waikato River, including their economic, social, cultural, and spiritual relationships.
4. The restoration and protection of the relationship of the Waikato region's communities with the Waikato River including their economic, social, cultural, and spiritual relationships.
5. The integrated, holistic, and coordinated approach to management of the natural, physical, cultural and historic resources of the Waikato River.
6. The adoption of a precautionary approach towards decisions that may result in significant adverse effects on the Waikato River, and in particular those effects that threaten serious or irreversible damage to the Waikato River.
7. The recognition and avoidance of adverse cumulative effects, and potential cumulative effects, of activities undertaken both on the Waikato River and within its catchments on the health and wellbeing of the Waikato River.
8. The recognition that the Waikato River is degraded and should not be required to absorb further degradation as a result of human activities.
9. The protection and enhancement of significant sites, fisheries, flora, and fauna.
10. The recognition that the strategic importance of the Waikato River to New Zealand's social, cultural, environmental, and economic wellbeing requires the restoration and protection of the health and wellbeing of the Waikato River.
11. The restoration of water quality within the Waikato River so that it is safe for people to swim in and take food from over its entire length.
12. The promotion of improved access to the Waikato River to better enable sporting, recreational, and cultural opportunities.
13. The application to the above of both maatauranga Maaori and latest available scientific methods.

1.2.2 Metro DBC Project Objectives

For the purpose of this project, SMART project objectives have been developed with the purpose of giving effect to the Te Ture Whaimana, based around the following five themes:

- Water Quality
- Ecology
- Cultural outcomes
- Sustainable technology
- Sustainable growth

The final agreed objectives are, as follows:

1. Before 2050 municipal wastewater discharges are no longer impacting on the ability of people to swim and collect kai from the river and connected waterways thereby contributing to the restoration and protection of the health and wellbeing of the river.
2. The quality and extent of aquatic and terrestrial habitat and biodiversity in and around water bodies is enhanced through the reduction of wastewater treatment and discharge impacts before 2050.
3. Wastewater treatment solutions contribute to restoring and enhancing cultural connectivity/relationships with the river so that before 2050 Marae, Hapu and Iwi access to the river and other sites of significance for cultural and customary practice within the metro spatial area are no longer impeded by wastewater treatment solutions.
4. Maximise efficient use of resources and resource recovery to contribute to net zero greenhouse gas related emissions from wastewater treatment systems before 2050.
5. The wastewater solution provides sufficient capacity to ensure sustainable growth in the metro spatial area in accordance with growth projections assumptions for the next 100 years.

Note, some minor wording changes to the investment objectives and key performance indicators were agreed with stakeholders between the longlist and shortlist assessments as part of this DBC. The updates are reflected in the MCA criteria in Table EC - 2 below.

1.2.3 Growth

Growth assumptions have been developed in conjunction with the councils and with reference to relevant strategic planning documents. The growth assumptions have informed development of the preferred option. The growth assumptions, as agreed with the Metro Wastewater Project Partners, used to size the system components for the long list, short list and preferred options include:

- Existing development (residential and non-residential).
- Infill development.
- Planned commercial industrial development (e.g. Ngaaruawaahia, Taupiri, Te Kowhai, Hopuhopu, Horotiu, Te Rapa North, Rotokauri, Ruakura, Airport, Cambridge / Hautapu).
- Planned residential greenfield development (e.g. Taupiri, Hopuhopu, Ngaaruawaahia, Te Kowhai, Rotokauri, Peacocke, Temple View, R2, HT1, WA, Cambridge and Te Awamutu growth cells).
- Additional infill development as noted in the Metro Spatial Plan¹⁶.
- 'Wet industry' allowances at Horotiu, Te Rapa, Ruakura, Airport and Cambridge. While these allowances have been included in the current DBC work, the most appropriate strategic locations for wet industrial activity in the Waikato Metro Area needs to be properly considered and discussed by Future Proof.
- The ultimate design horizon also includes 35,000 Population Equivalent (PE) for the area between the Southern Links designation and the current Hamilton City Boundary, and an additional 30,000 PE in the vicinity of Ruakura.

¹⁶ Hamilton-Waikato Metro Spatial Plan – Future Proof

1.3 Option Development and Assessment Methodology

Development of this DBC is characterised by collaboration including key decision points driven by partners and key stakeholders' input (Refer [Figure EC - 1: Process and key milestones to identify the preferred wastewater option]). The previous feasibility study¹⁷ identified six metro wastewater treatment solutions and recommended four for future investigation as part of this DBC.

Throughout the option development and assessment process, input and feedback was primarily received at key workshops held with the stakeholders shown in Table EC - 1 below.


Table EC - 1: Key Stakeholder Workshop Participants – Metro Wastewater DBC Short List Options Phase

Key Stakeholders	
Hamilton City Council	Waikato Tainui
Waikato District Council	Te Haa o te Whenua o Kirikiriroa – Ngati Tamainupo
Waipa District Council	Te Haa o te Whenua o Kirikiriroa – Ngati Wairere
Waikato Regional Council	Te Haa o te Whenua o Kirikiriroa – Ngati Koroki Kahukura
Te Hauora o Ngati Haua	Te Haa o te Whenua o Kirikiriroa – Ngati Haua
Maniapoto	Te Haa o te Whenua o Kirikiriroa – Ngati Mahanga
Nehenehenui Regional Management Committee	Watercare (Waikato)

Targeted discussions were also held with key stakeholders throughout the DBC development. Milestone recommendations and decisions were made formally by the Project Control and Governance Groups.

The economic case builds on the Strategic Case and involves assessing longlist and shortlist options to develop a preferred option. Figure EC - 1 outlines this overarching methodology, with completed steps to date shown in green.

Figure EC - 1: Process and key milestones to identify the preferred wastewater option

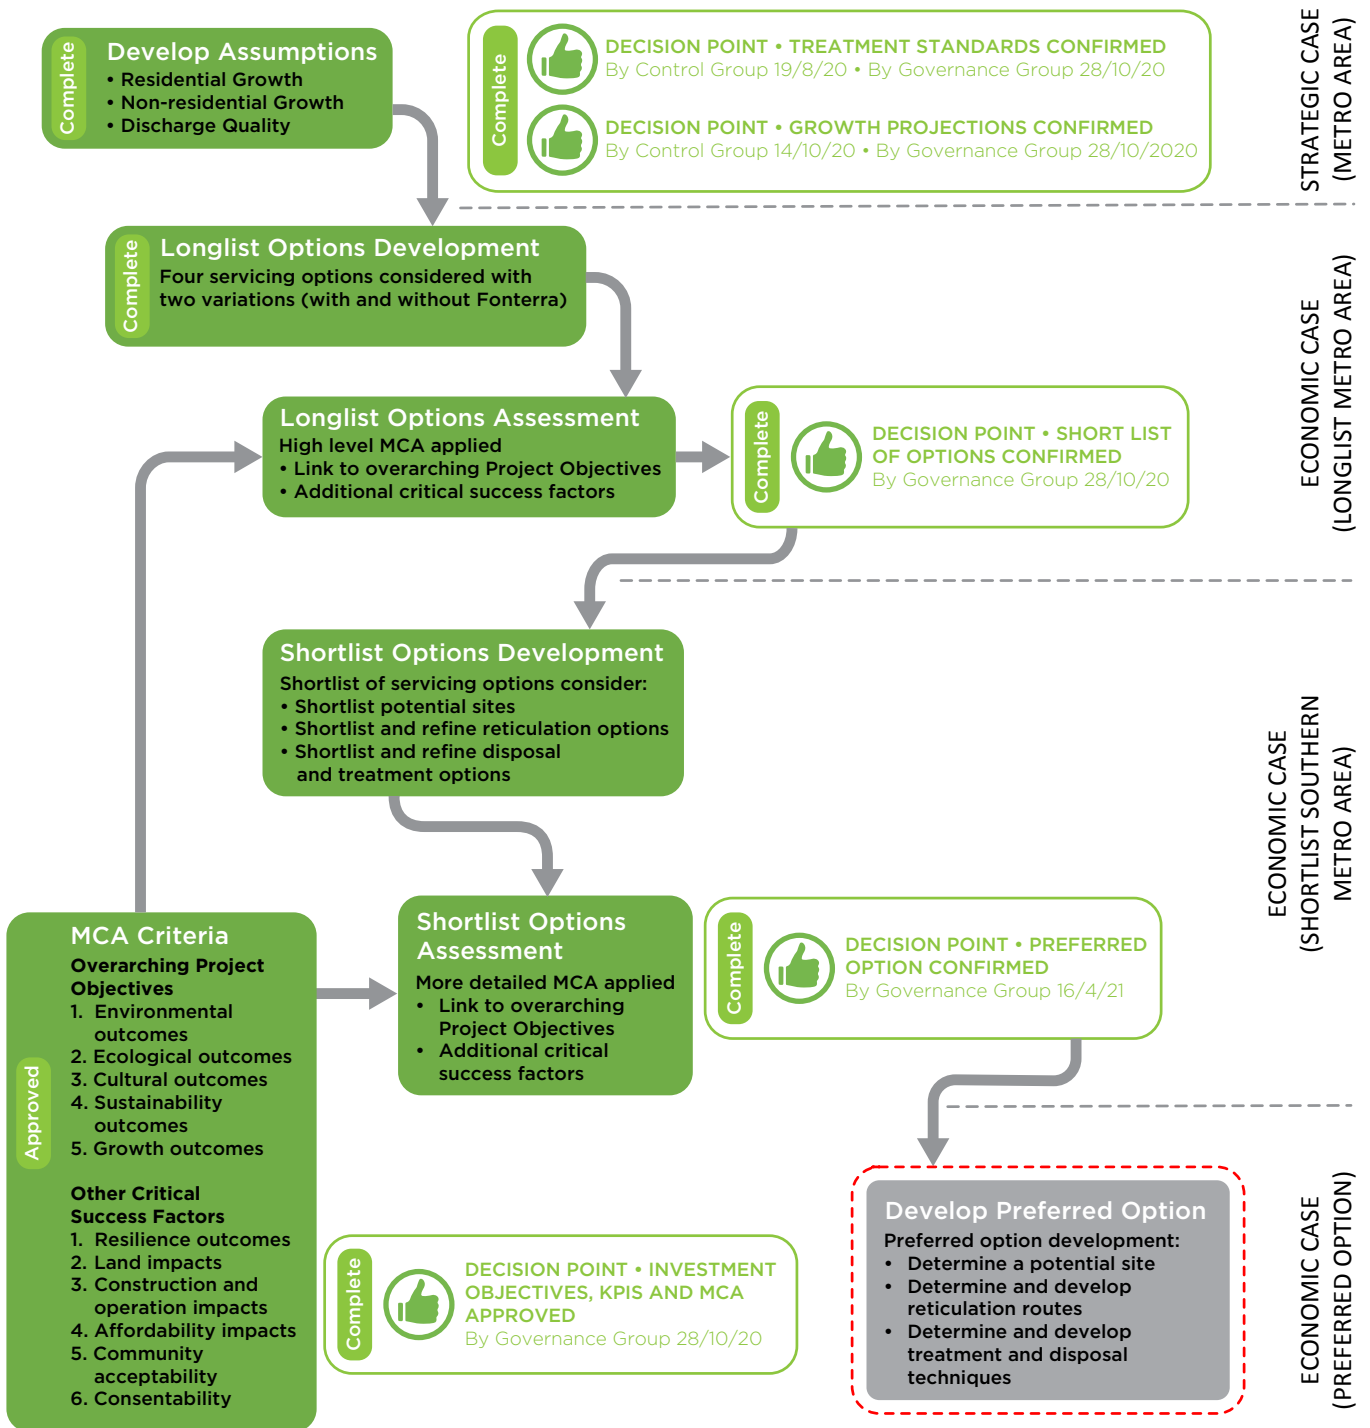

2. MCA Assessment

2.1 Multi Criteria Analysis (MCA) Framework

The servicing options were assessed using an MCA and scoring system. The assessment criteria were developed based on agreed investment objectives and KPIs established through the Strategic Case phase (described in Section 1.2.2 – Metro DBC Project Objectives). Critical success factors were also used as additional criteria for the options assessments. The criteria used for the assessment are outlined below.

Criteria

The following assessment criteria (refer to Table EC - 3: MCA criteria descriptions) was developed based on the project objectives and KPIs described in the Strategic Case.

Additional critical success factors were developed at the shortlist stage to assess other distinguishing features of the options. These criteria were agreed with partners and stakeholders. The critical success factors consider implementation matters associated with the options. These included:

- Constructability
- Operability
- Consentability
- Resilience

Costs were also developed at the shortlist stage; however, they are not scored as part of the MCA assessment.

Scoring

The servicing options were scored in accordance with the scoring definitions outlined in Table EC - 3: Scoring definitions for both the longlist and shortlist assessments.

Table EC - 2: Scoring definitions

3	Significant positive impact compared with other options
2	Moderate positive impact compared with other options
1	Minor positive impact compared with other options
0	Very limited to no positive or negative impact (neutral)
-1	Minor negative impact compared with other options
-2	Moderate negative impact compared with other options
-3	Significant negative impact compared with other options
FF	Fatally flawed

Table EC - 3: MCA criteria descriptions

MCA	KPI Equivalent	Criteria measure / considerations
OBJECTIVE CRITERIA		
Water Quality 1. By 2050 municipal wastewater treatment plant discharges, as part of cumulative discharges to the river, are no longer impacting the ability of people to swim and collect kai from the river	KPI 1.4: Proportion of plants which are compliant against discharge quality consent conditions	Water Quality (TN, TP, Nitrates, Ammonia) To what extent and timeframe does the option reduce the level of Nitrogen, Phosphorus, Nitrates and Ammonia in the quality of the discharge?
	KPI 1.2 Concentration of Total Nitrogen contaminants impacting the river and connected waterways from WWTPs	
	KPI 1.3: Concentration of Total Phosphorous contaminants impacting the river and connected waterways from WWTPs	
	KPI 1.1: Public health risks caused by the concentration of E.coli within the WWTP discharges	Water Quality (E.coli) To what extent and timeframe does the option reduce the E.coli levels of the discharge to the river?
		Public Health To what extent does the option reduce the risk to public health?
Ecology 2. The quality and extent of aquatic and terrestrial habitat and biodiversity in and around water bodies is enhanced through the reduction of wastewater treatment and ecosystem re-entry impacts by 2050	KPI 2.1: Amount of algal biomass in the Waikato River as measured by chlorophyll a concentrations attributable to treated wastewater discharges	River / Aquatic Ecosystems To what extent and timeframe does the option impact or improve river ecosystems and hydrology
	KPI 2.2: Health and abundance of mahinga kai species	
	KPI 2.3: Number and variety of terrestrial species at specific locations within the metro area	Terrestrial Ecosystems To what extent and timeframe does the option provide the ability to improve vegetation coverage around riverbed and terrestrial ecosystems? This will only be applicable if potential riparian areas and other restoration opportunities are included as part of the options. This may have to remain very high level for now.
	KPI 2.4: Area coverage of native riparian vegetation surrounding water bodies and within the catchment area	
Cultural Outcomes 3. Wastewater treatment solutions restore and enhance cultural connectivity / relationships with the river so that by 2050 marae and iwi access to the river and other sites of significance within the Metro spatial area is no longer impeded by wastewater treatment solutions	KPI 3.1: Maatauranga Maaori Cultural Health Index	What potential is there for land discharge vs water discharge? (How much does the option reduce the discharge to the river?)
	KPI 3.2: Number and quality of access points to the river for cultural and recreational activities	This assumes that land discharges are preferred but further assessment is required from Iwi
To what extent does this option enhance and restore cultural connectivity with the river? (Cultural assessment to be determined.)		
Sustainable technology 4. Maximise efficient use of resources and resource recovery to contribute to net zero greenhouse gas related emissions from wastewater treatment systems by 2050	KPI 4.1: Water reuse, water allocations and accounting	Water Reuse To what extent and timeframe does the option allow for water reuse?
	KPI 4.2: Carbon footprint / Energy requirements of plant and plant systems (i.e. pumps)	Energy / Carbon Reduction To what extent and timeframe does the option consider energy and carbon neutral technologies? To what extent do options reduce relative operational carbon associated with conveyance system? What is the biosolid reuse potential?
	KPI 4.3 Proportion of biosolids that are able to be safely reused for beneficial purposes	

MCA	KPI Equivalent	Criteria measure / considerations
Sustainable growth 5. The wastewater solution provides sufficient capacity to ensure sustainable growth in the metro spatial area in accordance with growth projections assumptions for the next 100 years	KPI 5.1 Flexibility and adaptability of solution to be staged / developed over time to meet the needs of the community.	Flexibility To what extent does the option provide flexibility to adapt to growth and land use changes?
	KPI 5.2: Proportion of Industrial areas which are serviced by municipal plants sustainably	Sustainable Growth To what extent does this option provide additional growth opportunities which align with planned future growth of the Waikato Metro area?
	KPI: 5.3 Proportion of residents in the metro area serviced by municipal treatment plants sustainably	
CRITICAL SUCCESS FACTORS		
Constructability	Treatment	Construction Impacts What are the relative constructability benefits, issues and risks (available space, access, existing utilities, watercourse, rail crossings, reinstatement requirements, geotechnical impacts, utility impacts, road and traffic impacts)?
	Reticulation	
Maintenance and operations	Treatment	Operational Impacts What is the relative ease or difficulty of operation and maintenance (includes access, odour treatment, resource availability, monitoring, etc)?
	Reticulation	
Consentability opportunities and risks	Construction	Consentability - Land use and designation What are the risks of delays during the consenting process? Are there any consenting fatal flaws?
	Operation	Consentability - Discharge To what extent does the option improve the consistency of consents applied to discharges to the river? To what extent does the option reduce the risk of breaching consenting requirements?
Resilience	Operation	Resilience To what extent will the option provide resilience against climate change impacts and natural hazards?
Funding Potential	Funding availability	What ability do partners have to fund the option within funding allocations in LTPs and forward expenditures?
COSTS		
Capital costs		High level estimates only
Operating Costs		High level estimates only
Whole of life costs		High level estimates only


Each objective criterion was weighted equally in the MCA assessment. Criteria sensitivity assessments were completed as part of the long-list options assessment (Refer to Long-list options assessment for details). The sensitivity assessments did not alter the outcomes of the evenly weighted MCA assessment. It was agreed that weightings were difficult to apply in a meaningful way as each criterion are likely to have different levels of importance at different time horizons. For example, the ability to meet higher growth in the longer term may not materialise for 30 years. Therefore the options were assessed on the balance of outcomes from the options assessments as a whole rather than through weighted MCA scores.

3. Longlist Options

3.1 Introduction

The purpose of the longlist (and the shortlist) options process is to identify suitable wastewater servicing options for the Waikato Metro Area (shown in Figure EC - 2:) taking a boundaryless, 'Best for River' approach. This longlist options assessment is a comparative assessment to determine whether centralised wastewater servicing solutions for the Southern Metro Area should be considered further and in more detail at the shortlist stage.

Figure EC - 2: Wastewater treatment plants within the Waikato Metro Area (study area)

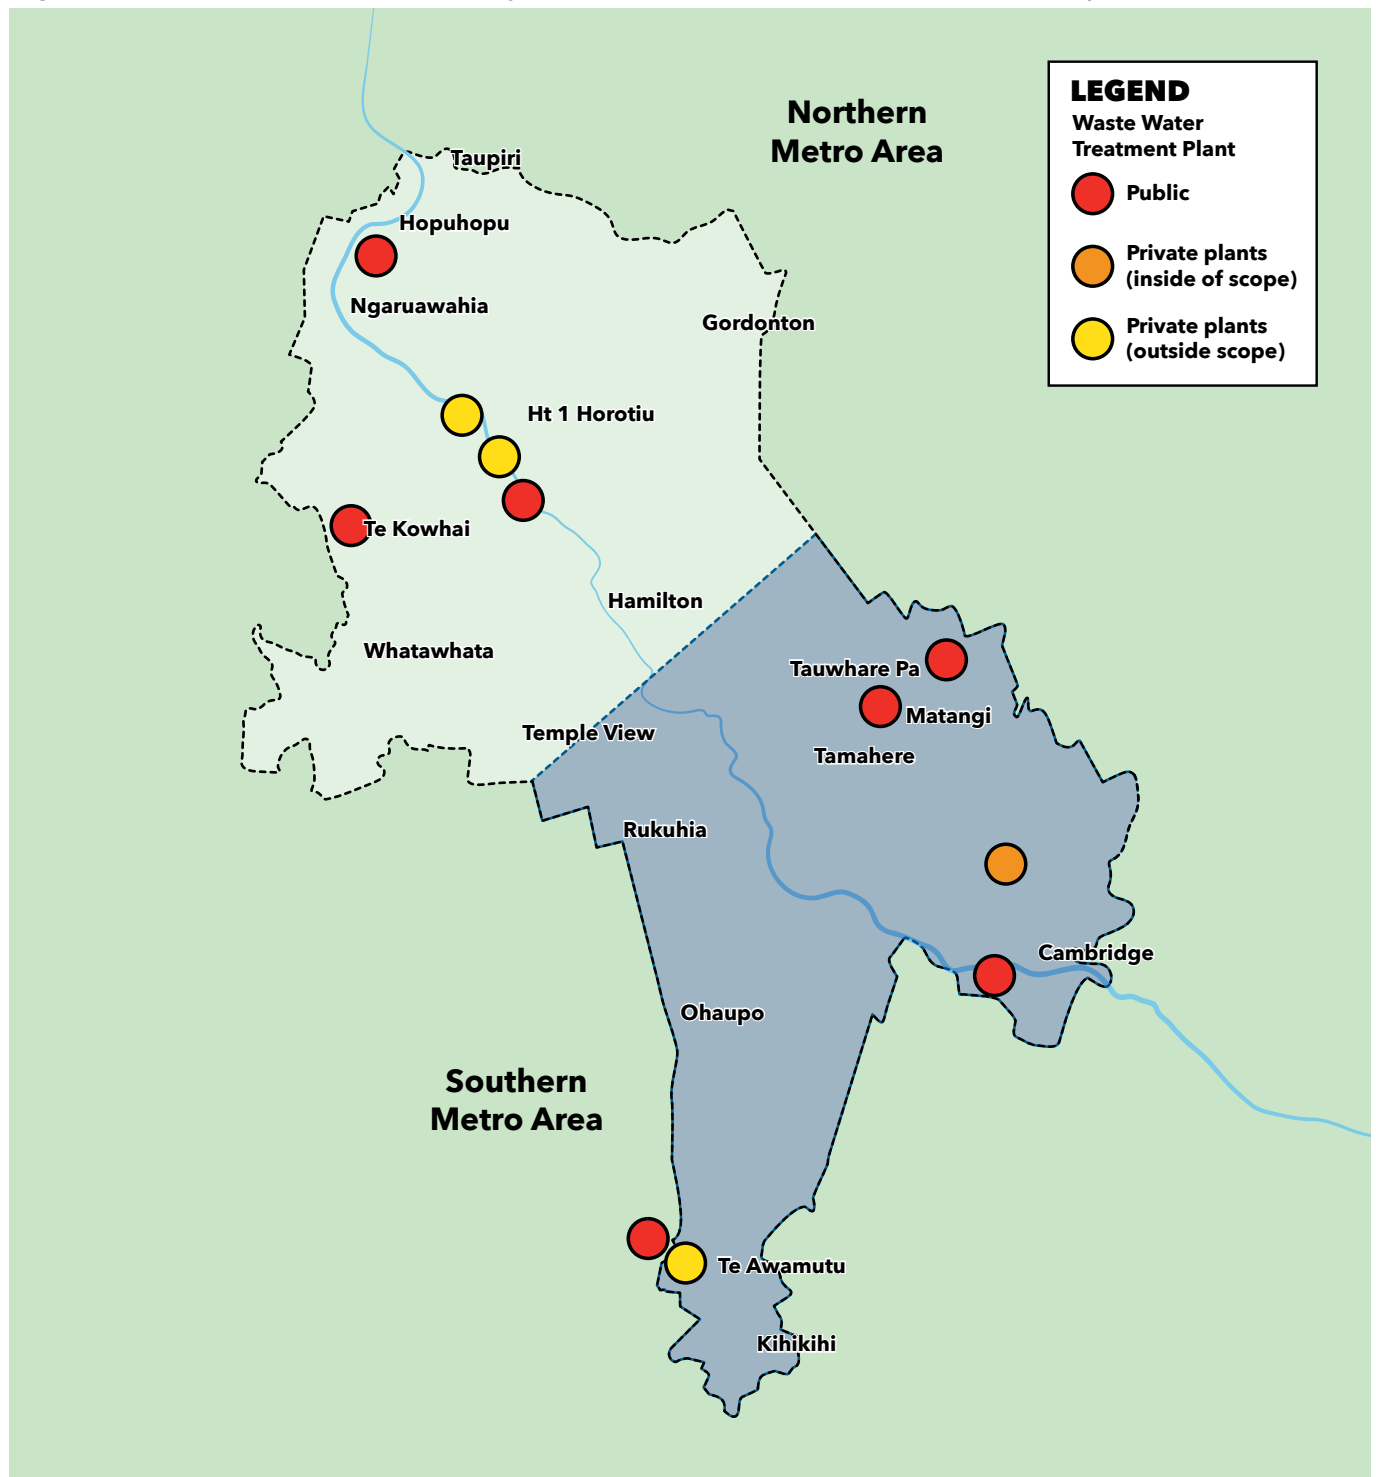

3.2 Longlist Option Development

This project builds on previous wastewater servicing investigations with the most relevant investigations summarised in Table [3] of the Strategic Case.

The most recent and relevant previous feasibility study¹⁸ was a pre-cursor to this DBC which identified a long list of six metro wastewater treatment solutions. The outcome of this study recommended the following options for further development:

- Convey all communities two facilities - a northern and southern centralised facility (new site).
- Convey all communities two facilities - a northern and southern centralised facility (Cambridge site).
- Five wastewater facilities to cater for the whole Waikato Metro Area including a new southern facility.
- Upgrades of BAU including new facilities at Whatawhata, the airport and Ohaupo.

The options outlined above were used to inform and develop more detailed options for the long list of options. A total of eight longlist options were developed for DBC based on the options above plus the inclusion of Fonterra for each option, as detailed in Section 3.2. These options were developed to meet the performance levels and outcomes detailed in the Wastewater Treatment Assumptions Memorandum¹⁹ and outlined further in Section 5.3 of this report.

The longlist options are described in Table EC - 4: and in full in Appendix D: Long List Options Report. It should be noted that treatment and conveyance are considered within the options outlined below and in Section 5 of this report.

¹⁸ Future Proof Partners, 2020. Hamilton Metro Wastewater Treatment Feasibility Study. Retrieved 25 Feb 2021, from https://www.futureproof.org.nz/assets/FutureProof/H2A/Waters/Final-Metro-Area-Wastewater-Treatment-Feasibility-Study_with-Appendices.pdf

¹⁹ Wastewater Treatment Assumptions for Waikato Metro Wastewater DBC, August 2020, included in Appendix F, Preferred Option Technical Report, September 2021.

Table EC - 4: High level option descriptions²⁰

Option	Description
Do Nothing	Operate all facilities as they are currently constructed with no additional capacity or treatment improvements.
Option 1A	Do Minimum - All the existing plants will be upgraded to produce high quality flows (as outlined within the Water Quality Assumptions Memorandum). A new facility will be built to service the industrial growth around the airport and another new facility will be built to service growth in Ohaupo. The existing Cambridge plant will also be upgraded. Fonterra Hautapu would be serviced by a new stand-alone plant. (Subsequent to this assessment process Fonterra has confirmed will construct a new stand-alone WWTP at Hautapu)
Option 1B	Option 1B includes all interventions outlined in Option 1A. However, this option assumed Fonterra flows would be serviced by the proposed new Cambridge facility.
Option 2A	All northern communities will be serviced by a northern plant located at Pukete and southern communities will be serviced by a new southern centralised facility to be built on a new location (to be determined). The new southern facility will service growth at the airport area and environs, Cambridge, Mātangi, Tamahere Hub, Ohaupo and a portion of south Hamilton. Te Awamutu and Tauwhare Pā will continue to operate as standalone plants but will undergo upgrades. Pukete will service flows from Te Kowhai and Ngaaruawaahia. Fonterra Hautapu would be serviced by a new stand-alone plant.
Option 2B	Option 2B includes all interventions outlined in Option 2A. However, this option variation assumed Fonterra flows would be serviced by the proposed new Cambridge facility.
Option 3A	All northern communities will be serviced by a northern plant located at Pukete and southern communities will be serviced by a new southern centralised facility to be built at the Cambridge site. The new southern facility will service growth at the airport area and environs, Cambridge, Mātangi, Tamahere Hub, Ohaupo and a portion of south Hamilton. Te Awamutu and Tauwhare Pā will continue to operate as standalone plants but will undergo upgrades. Pukete will service flows from Te Kowhai and Ngaaruawaahia. Fonterra Hautapu would be serviced by a new stand-alone plant.
Option 3B	Option 3B includes all interventions outlined in Option 3A. However, this option variation assumed Fonterra flows would be serviced by the proposed new Cambridge facility.
Option 4A	A new southern facility will be built near the airport to service flows from the airport area and environs, Mātangi, Tamahere Hub and Ohaupo. Pukete will service flows from Te Kowhai and all of Hamilton. This option will also include upgrades to the existing plants at Ngaaruawaahia, Te Awamutu, and Tauwhare Pā and a new plant at Cambridge. Fonterra Hautapu would be serviced by a new stand-alone plant.
Option 4B	Option 4B includes all interventions outlined in Option 4A. However, this option variation assumed Fonterra flows would be serviced by the proposed new Cambridge facility.

Each of the longlist options were then assessed using a project specific MCA framework. This framework measured longlist option performance against the project investment objectives and critical success factors confirmed in the previous strategic case phase of this project.

²⁰ Following the outcomes of the long-list assessment completed for this DBC, Fonterra re-commenced their investigations and resource consent application process to pursue a standalone solution for the Hautapu plant. In early 2022 Fonterra secured long term discharge consents for a standalone solution.

3.3 Longlist Options MCA Assessment Summary

A summary of the longlist option MCA results is in Table EC - 5.

Initial assessments were undertaken individually by project team members. The project team members include civil and wastewater engineers, environment scientists, planners and economists. Moderation workshops were then held with the project team members to agree on the initial assessments and to document the rationale behind the scoring. The initial assessments were then workshopped with project partners and stakeholders for review and feedback before being finalised.

Results show both Option 2A and Option 3A as the highest overall scoring options. The rationale for the scoring is detailed in the Long List Options Assessment report (Appendix D: Long List Options Report).

Table EC - 5: Longlist Option MCA Summary

OBJECTIVE CRITERIA	Do Nothing	Option 1A (Do Minimum)	Option 1B	Option 2A	Option 2B	Option 3A	Option 3B	Option 4A	Option 4B
Water Quality - TN and TP	-3	3	2	3	2	3	2	3	2
Water Quality - E. coli	-2	2	2	2	2	2	2	2	2
Water Quality - Public health	-1	1	1	1	1	1	1	1	1
Aquatic Ecology	-2	1	1	1	1	1	1	1	1
Terrestrial Ecology	0	1	1	1	1	1	1	1	1
Discharge location	Not scored at this time								
River vs land discharge	Not scored at this time								
Cultural Connectivity	Not scored at this time								
Access to river	0	1	1	2	2	2	2	1	1
Water reuse potential	0	1	0	3	2	2	1	1	0
Carbon neutral potential	0	-1	0	1	2	1	2	-1	0
Flexible and adaptable	-3	1	0	3	2	2	1	1	0
Meeting growth	-3	2	2	3	3	3	3	2	2
CRITICAL SUCCESS FACTORS									
Constructability (treatment)	0	-2	-3	-1	-2	-2	-3	-2	-3
Constructability (reticulation)	0	0	-1	-2	-3	-2	-3	-1	-2
Operability (treatment)	0	0	-2	1	0	1	0	0	-2
Operability (reticulation)	0	0	0	-2	-2	-3	-3	-1	-1
Land impacts	Not scored at this time								
Community acceptability	Not scored at this time								
Consentability opportunities and risks	-4	-3	-3	-1	-2	0	-1	-2	-3
Resilience	-2	1	0	0	-1	0	-1	1	0
Funding Potential	0	-2	-1	1	2	1	2	0	1
	3	2	2	-2	-2	-2	-2	0	0
COSTS									
Capital costs (\$m)		\$481	> \$481	\$588	>\$588	\$612	>\$612	\$494	>\$494
Operational costs (\$m)		\$30.2	>\$30.2	\$30.8	>\$30.8	\$30.7	>\$30.7	\$30.6	>\$30.6

A number of MCA sensitivity assessments were completed to support the long-list assessment process. The sensitivity assessments applied different weightings to the criteria. The approach and outcomes of the sensitivity assessments are documented in the long list report (Appendix E). The Do-Nothing option was deemed to have a fatal flaw in relation to the ability to consent the option due to water quality issues and performance of WWTP against current and future standards. The Do-Nothing option was retained as a comparator.

Option 1A performed lower than Option 2A and Option 3A for the objectives but had comparatively better scores for a number of the critical success factors. The relative merits of Option 1A compared to Option 4A are discussed below.

Option 2A was the highest performing option and shortlisted under the MCA scoring process. The benefits associated with building a new plant on a new site were considered to outweigh the risks involved in consenting and approving a new site. A new site offers the opportunity to masterplan a treatment facility to achieve the greatest long-term operational efficiency and provide flexibility to adapt to changes in demand over time, technology advances and resource recovery opportunities. A central location between Cambridge and Hamilton South reduces the length of large diameter conveyance pipework and allows for greater development opportunities when compared against Option 3A.

Additionally, a new location south of Hamilton is closer to the airport industrial area. This area has significant industrial growth potential, providing greater opportunities for industrial water reuse.

Option 3A (building a sub-regional plant on the Cambridge site) was the second highest scoring option. This option utilises the site of the existing Cambridge WWTP which is already consented for this type of land use and as an existing discharge location, however was not identified for the shortlist because of the following issues:

- Requires long conveyancing/pumping lengths from Peacocke and south Hamilton
- Constructing on an existing site that includes expansive, low intensity process units, whilst trying to keep the existing plant operational is logistically difficult. It will require additional time and strict planning during construction.
- Limited space on the existing Cambridge site will make it very difficult to masterplan the site efficiently and respond to changes and growth
- Whilst located within an industrial precinct, significant residential development is occurring around the precinct. Reverse sensitivity may become an increasing challenge into the future.
- There are geotechnical risks on the existing site, particularly the potential for lateral spread during construction and consequential impact on the river.
- If geotechnical, master planning and other space constraints around operational logistics dictate a move to partial siting on adjacent land (e.g., the quarry site), designation work will be required to provide for the expanded site.
- There is limited ability to reuse any of the existing assets at the Cambridge site.

Both Option 1A and Option 4A performed lower than Option 2A and Option 3A for the objectives but had comparatively better scores for a number of critical success factors. A modified Option 4A was recommended for short listing and refinement.

For comparative purposes, it was agreed that further development of an option that contained aspects of the current servicing arrangements be carried through to the shortlisting stage. Option 4A was considered more appropriate than Option 1A for the following reasons:

- For the Northern Metro Area (from North Hamilton region to Taupiri), the servicing of Te Kowhai through the Pukete WWTP is considered more practicable than building a new plant at Te Kowhai for whole-of- life cost and efficiency reasons. A new plant for Te Kowhai would very likely require a new site. It would also place a high rating burden on a small community to invest in a high-quality plant (to meet appropriate water quality standards). It is recommended that the Northern

Metro Area pursue Option 4A over Option 1A. Conveying Te Kowhai to Horotiu and then onto Ngaaruawaahia is a considerably longer distance than conveying directly to Pukete WWTP.

- For the Southern Metro Area (from south Hamilton to Te Awamutu), it is proposed that a new plant (south of Hamilton) is master planned to allow for the inclusion of Mātangi, Tauwhare, and Ohaupo. However, conveyance from these communities should only be considered when flows are large enough to avoid excessive retention times. Within the short to medium term, both Mātangi and Ohaupo will continue to operate as per BAU with Mātangi investing in short to medium term improvements in its standalone plant. The connection of Ohaupo is not expected to be needed until at least 2050. Developer interest within these areas may trigger the inclusion of the communities to a more centralised plant sooner. At this stage it has been assumed that these communities would connect to a centralised plant in 2050
- This approach also allows for the potential to stage centralisation in the future and is flexible enough to adapt to changes and development opportunities as they occur.

Fonterra options:

The MCA shows that the benefits of servicing Fonterra through a municipal system do not outweigh the risks. The key risk of including Fonterra options into any municipal service relates to the risks of liability and additional consequences of an operational failure. It would also likely increase the footprint of a new plant.

These risks are most significant when considering the inclusion of Fonterra with a standalone Cambridge plant. Servicing Fonterra through a sub-regional facility is likely to have lower operational risk than if serviced through a Cambridge standalone facility.

It was acknowledged during the long list options assessment that inclusion of Fonterra flows could potentially improve the ability to use advanced biosolids recovery technology. This would have the potential to partially offset the operational costs for the plant (and support moves toward achieving energy neutrality).

However, it is considered unlikely these benefits will offset the costs and risks associated with the options including Fonterra. It was agreed with all parties (including Fonterra) that the servicing solutions and short list options would not include Fonterra.

Following the outcomes of the long-list assessment Fonterra re-commenced their investigations and resource consent application process for pursue a standalone solution to meet their needs. In early 2022 Fonterra secured long term discharge consents for a standalone solution.

3.3.1 Long List Assessment Outcome Summary

The recommended shortlist options following the long-list options assessment are provided in more detail in the next section and summarised below as being:

- **Do Nothing** (for comparative purposes).
- **Option 2A - Three Plant Option** - Involves upgrades and expansion of the Pukete WWTP to service the Northern Metro Area (including Taupiri, Ngaaruawaahia, Te Kowhai, Horotiu and majority of Hamilton); a new southern plant to service the Southern Metro Area (including Hamilton South, airport area and environs, Cambridge) and the Te Awamutu WWTP.
- **Option 4A - Five Plant Option** - Involves treatment plant upgrades at Ngaaruawaahia, Pukete, Cambridge and Te Awamutu and a new southern plant to service the airport area and environs.

Option 2A was recommended for the shortlist. It was the highest scoring option from the raw MCA assessment and the MCA sensitivity assessments. The benefits associated with building a new plant on a new site were considered to outweigh the risks involved in consenting and approving a new site.

Option 4A was recommended for shortlisting over 1A, as servicing the smaller communities collectively (e.g. Mātangi, Airport) or via existing municipal facilities (e.g. Te Kowhai) is considered more pragmatic and efficient than having many smaller plants. This option also has the potential to deliver more cost-effective and resilient solutions, offered the ability to stage investment and could enable a transition to include a larger a sub-regional WWTP in the future.

The sensitivity tests are detailed in the Long List report (Appendix D) and did not change the relative assessments or selection of the options for short listing.

4. Shortlist Option Development and Assessment

4.1 Introduction


Between October 2020 and February 2021 all three shortlist options were subjected to detailed assessments against the MCA criteria, with results used to inform the selection of a preferred option.

A preliminary shortlist option assessment occurred in October- November 2020, followed by a more robust re-assessment in February 2021. This was based on more detailed information being available, including the capacity assessment of the Pukete WWTP outlined in section 4.1.1 below.

The shortlist assessments are summarised in Section 4.2 and are provided in full in the Shortlist Options Report included in Appendix E.

The service areas of the short-listed options are in Figure EC - 3 below and are diagrammatic.

Figure EC - 3: Diagrammatic Overview of Short-listed Metro Area Wastewater Servicing Options

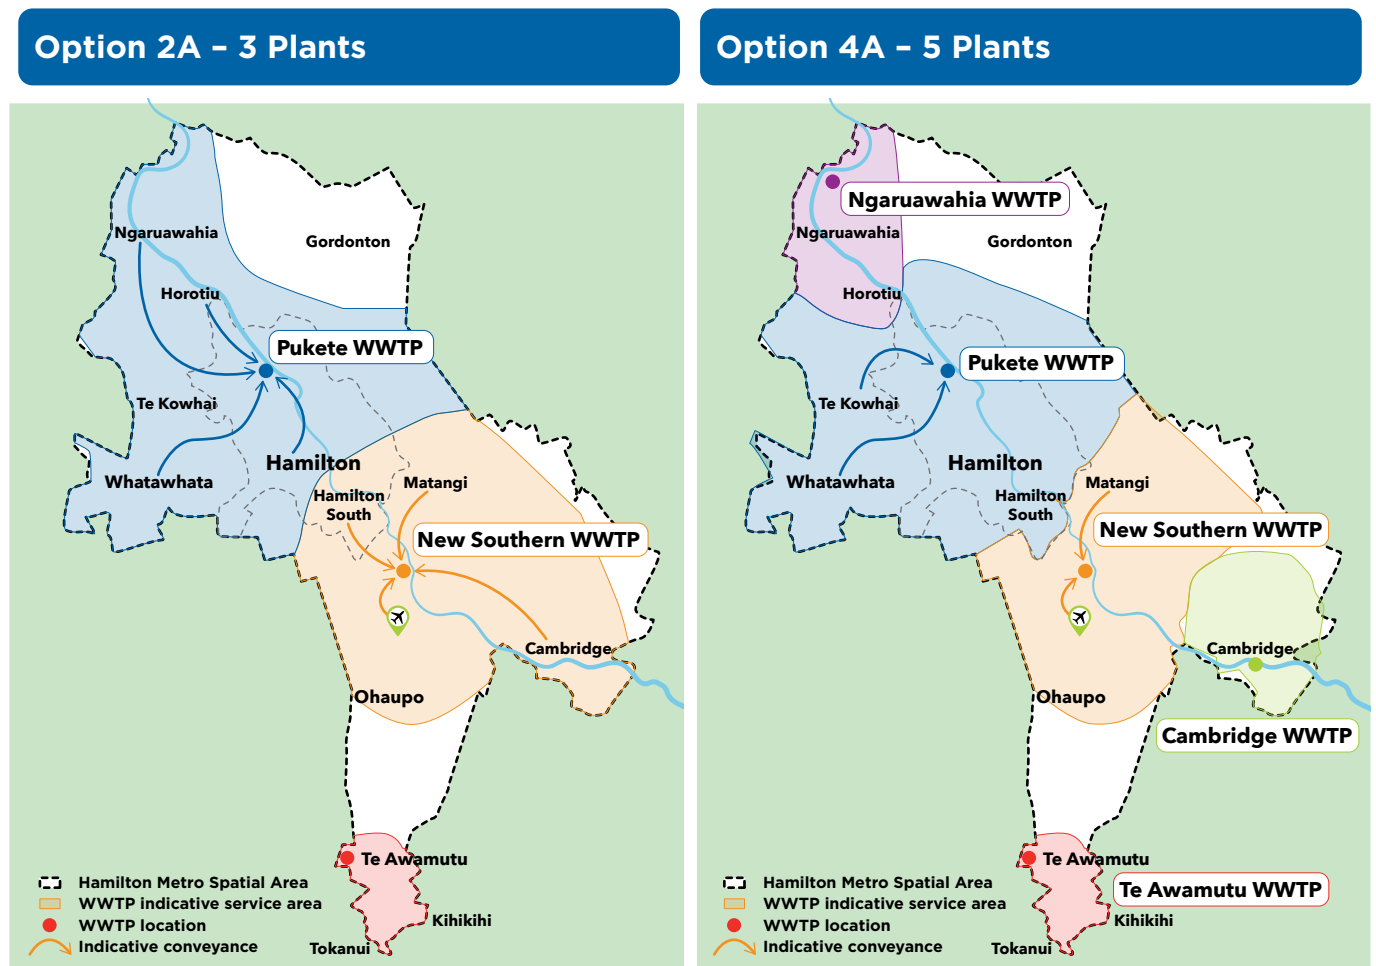

4.1.1 Pukete WWTP Capacity Assessment

An assessment of the Pukete wastewater treatment plant’s build out capacity (space requirements) was undertaken by Beca in February 2021 and documented in the Pukete Buildout Capacity Review Memorandum²¹.

This work has confirmed the Pukete site has sufficient space available to construct processes for predicted demand to at least 2061²² (See below). This assessment assumes:


- Conversion of treatment processes to MBR to achieve the necessary performance standards.
- Installation of additional treatment capacity to service growth.
- Expansion of the plant is limited to the existing footprint.

Achieving additional capacity and improved discharge standards at Pukete will require considerable investigation and investment. The requirements are being considered in more detail as part of the Northern Metro Wastewater DBC. Some existing assets at Pukete WWTP are reaching the end of their lives and require renewal. Treatment process changes will need to consider how both new assets and renewals could be staged and practically implemented.

The capacity of Pukete WWTP and timing of upgrades has an influence on the ability to service the Hamilton urban area and therefore the requirements and timing of a Southern Sub-Regional WWTP to service the southern areas of Hamilton.

Alternative technologies will need to be considered for Pukete WWTP such as enhanced primary sedimentation, MABR, Anammox and advanced sludge processes to meet performance standards and resource recovery aspirations. The MBR process will require either additional network or onsite peak wet weather flow (PWWF) attenuation to reduce the amount of influent needing to be treated during peak periods.

Figure EC - 4: Pukete WWTP Flow Projections

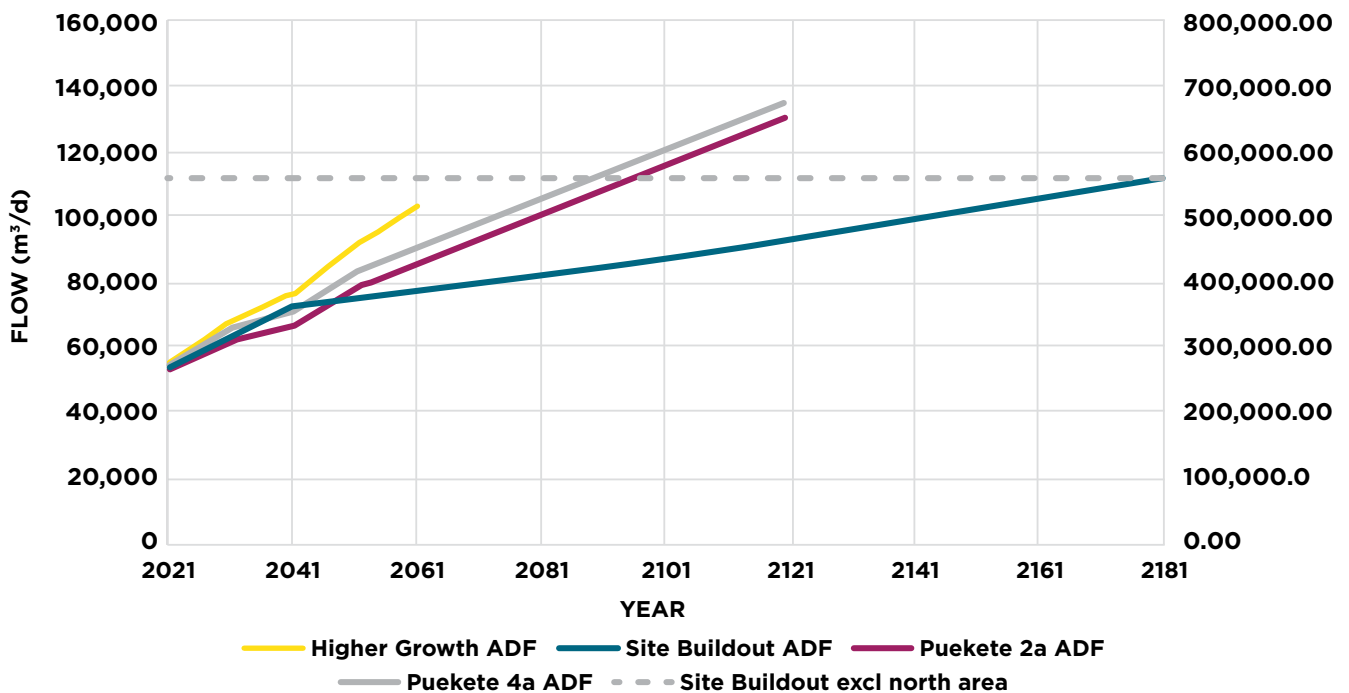

²¹ Included as Appendix F in the Short list Options Report (which is E of this report)

²² This date assumes that the build out of the site is limited to the current plant footprint, and that growth may occur faster than the base population and growth assumptions used for this DBC. Note that the base assumptions do not specifically provide for the level of growth contemplated through recent policy reforms such as the NPS-UD or the RMA Housing Supply Amendment Bill. The implications of these reforms and accelerated growth could result in Pukete site capacity being built out and expended earlier than predicted and bring forward the need to divert flows to a new plant.

4.2 Shortlist Option Descriptions

The short list options are described below.

Option 1: Do Nothing - has been brought forward for comparative purposes. This option includes:

- Ngaaruawaahia WWTP continues to service:
 - Hopuhopu
 - Horotiu
 - Ngaaruawaahia
 - Taupiri
- Hamilton (Pukete Plant) continues to service:
 - Hamilton (north)
 - Hamilton (south)
 - Te Kowhai
- Hamilton airport industrial area- as current (ad-hoc on-site servicing)
- Mātangi – continue current local WWTP
- Ohaupo – continue on-site servicing
- Cambridge WWTP continues to operate
- Te Awamutu/Kihikihi (standalone plant) to be upgraded as planned.


Option 2A: Three Plant Option – The treatment plant locations, and areas of service for each along with the key conveyance routes developed for this option are shown in Figure EC - 5: Option 2A – 3 Plant Option. This option consists of the following three main WWTPs as described below:

- Pukete WWTP as the centralised northern plant to service northern communities
 - Hamilton (North)
 - Hopuhopu
 - Horotiu
 - Taupiri
 - Te Kowhai.
- One centralised southern plant to service the southern communities (plant located south of Hamilton)
 - Cambridge
 - Hamilton Airport industrial area and environs
 - Hamilton (South)
 - Matangi
 - Ohaupo.
- Te Awamutu/Kihikihi (standalone plant) to be upgraded

For the purpose of the assessment, it is assumed Tauwhare Pā will continue as a small standalone plant.

The longlist assessment identified Option 2A as the most preferred technical solution under various weightings and sensitivity assessments (excluding a detailed cost assessment). This option provides the flexibility to masterplan an efficient facility on a new site, take advantage of water re-use and waste-to-energy opportunities due to its size and scale. Some benefits of this option are related to a centralised location between Hamilton and Cambridge. The reticulation alignment and cost may change depending on the location of the site. For the purposes of this assessment, it has been assumed the site is as shown in Figure EC - 5: Option 2A – 3 Plant Option.

Figure EC - 5: Option 2A - 3 Plant Option

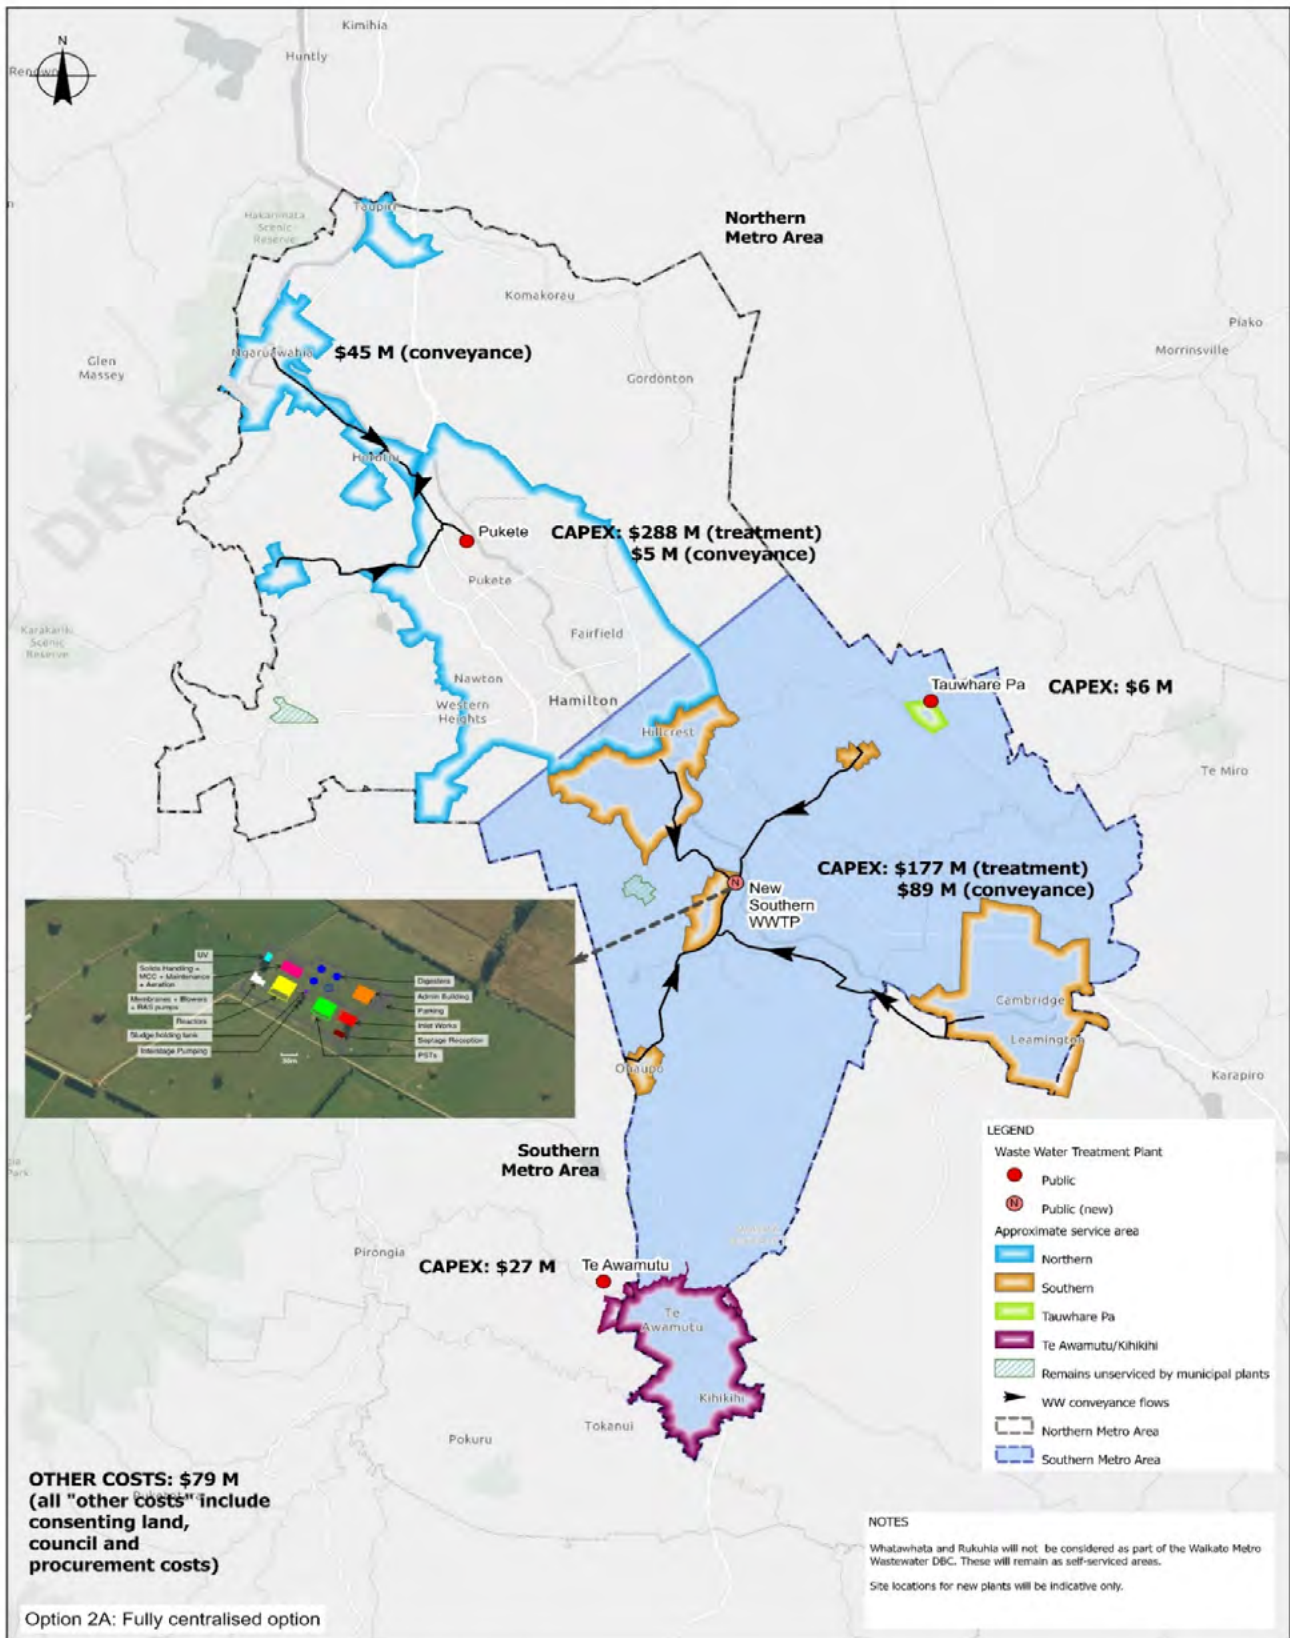

OPTION 4A: Five Plant Option - This option is shown in Figure EC - 6: Option 4A - Five Plant Option consists of the following five main plants:


- Ngaaruawaahia standalone plant to service:
 - Hopuhopu
 - Horotiu
 - Ngaaruawaahia
 - Taupiri.
- Hamilton (Pukete Plant) to service:
 - Hamilton (north)
 - Hamilton (south)
 - Te Kowhai.
- Southern plant to service small southern communities (plant located south of Hamilton):
 - Hamilton Airport Business Zone
 - Mātangi
 - Ohaupo.
- New plant at Cambridge (standalone plant)
- Te Awamutu/Kihikihi (standalone plant) to be upgraded

As with Option 2A, for the purposes of the long-list assessment, it is assumed Tauwhare Pā will continue as a small standalone plant which will be upgraded.

This option consists of seven plants in total to service the Waikato Metro Area (refer to Figure EC - 6: Option 4A - Five Plant Option). A new southern plant to service the airport area will be master planned to cater for Mātangi, Tauwhare and Ohaupo. If selected as the preferred option, it can be refined over time to allow for growth. In the interim, the Mātangi plant is likely to require short to medium-term upgrades.

It is also expected that the connection of Te Kowhai to Pukete is more economical than building a new plant in Te Kowhai. This connection is likely to be required in the next 10 years. This option also assumes existing council boundaries.

Figure EC - 6: Option 4A - Five Plant Option

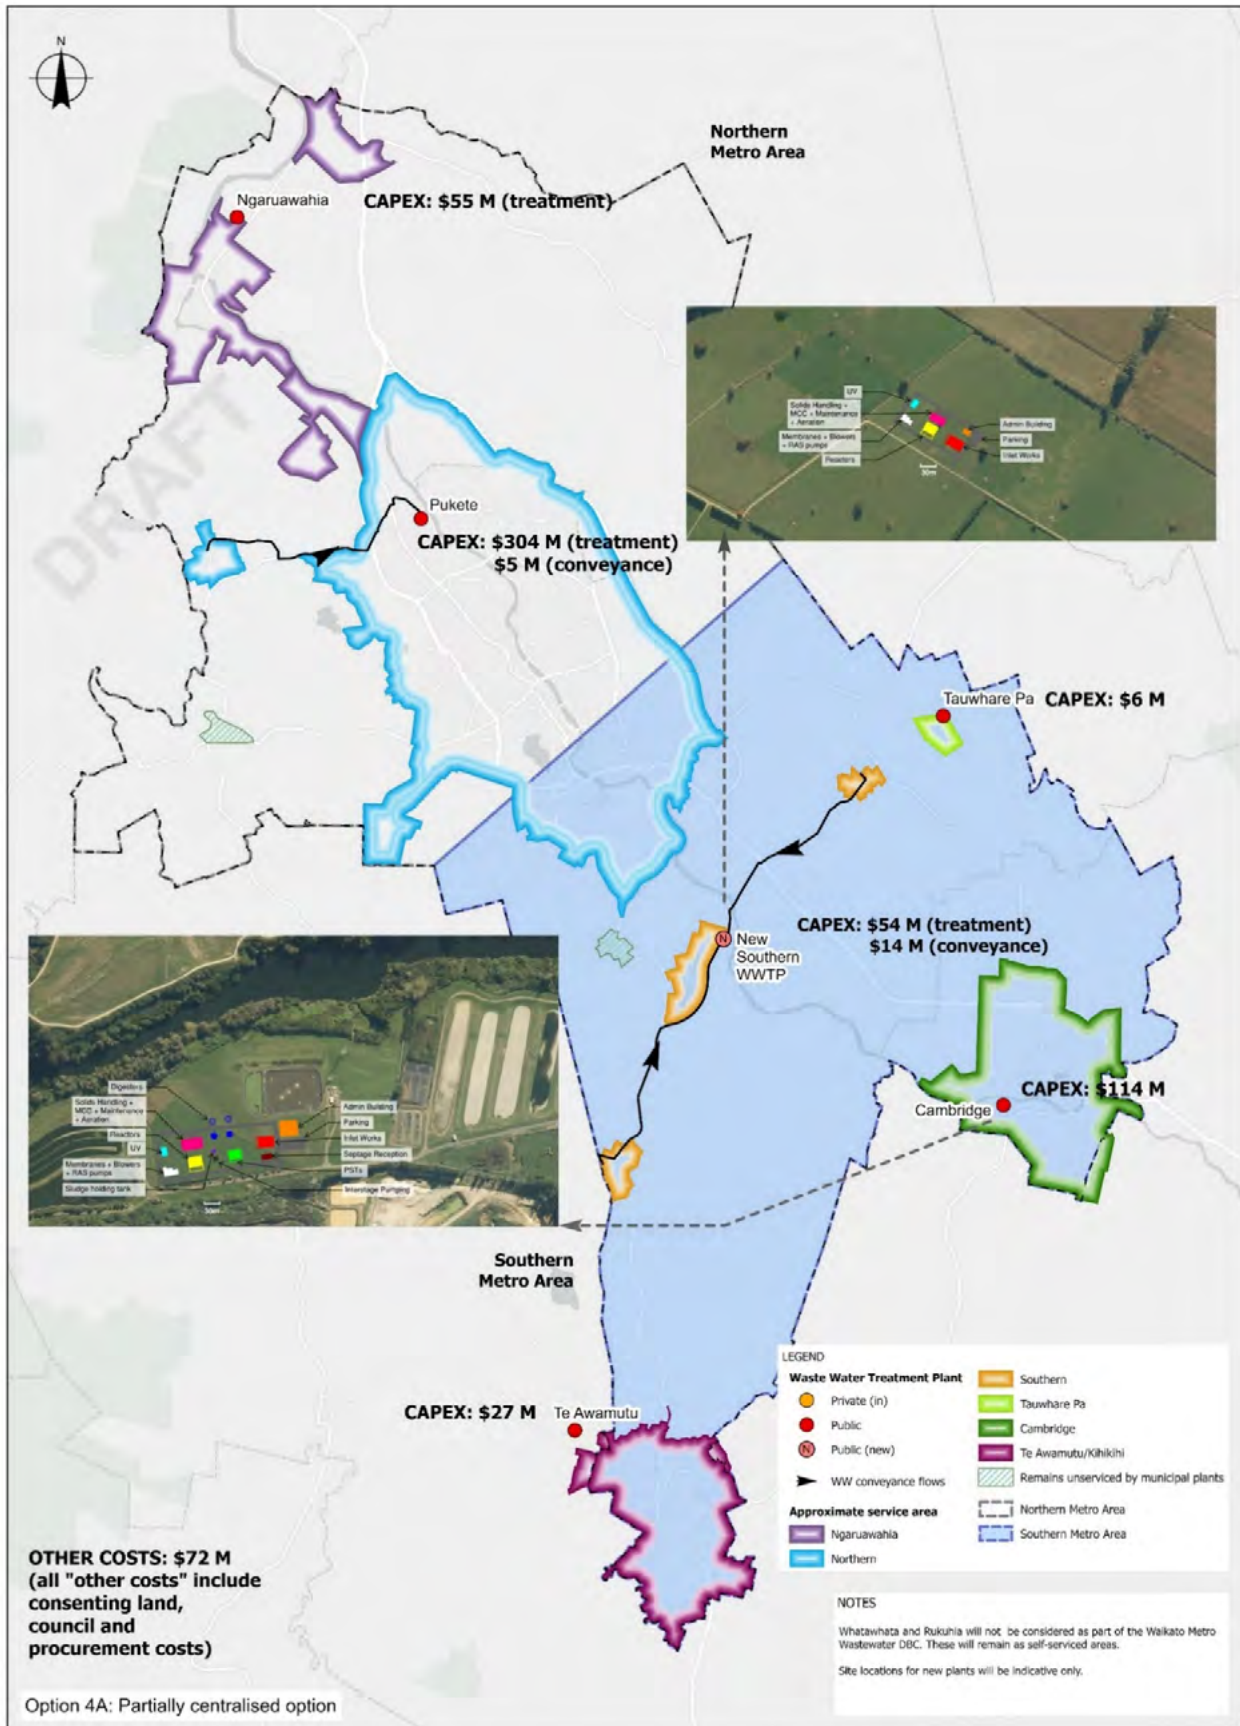

Common assumptions: Option 2A and Option 4A

Both shortlist options 2A and 4A assume the smaller communities of Mātangi and Ohaupo will be serviced by a new southern sub-regional WWTP, while the Tauwhare Pa WWTP will remain a stand-alone. The rationale informing these shortlist option servicing assumptions for Mātangi, Ohaupo and Tauwhare Pā is in Table EC - 6: Option 2A and Option 4A – Smaller Settlement Servicing Assumptions.

Table EC - 6: Option 2A and Option 4A – Smaller Settlement Servicing Assumptions

Settlement / catchment	Servicing solution	Rationale
Mātangi	Transfer to southern sub-regional WWTP	Limited land available for expansion of WWTP. Current compliance issues for WWTP. Opportunities for more dense development around Mātangi Village and to include Tamahere commercial hub on route to southern sub-regional WWTP.
Ohaupo (from 2051)	Transfer to southern sub-regional WWTP	Limited well-drained land available for on-site systems. Potential impacts of on-site systems on sensitive environments e.g., peat lakes. Opportunities for more dense development.
Tauwhare Pā a	Stand alone	Small flows would be difficult to transfer without septicity issues. Low level of certainty around growth. Land likely to be available/suitable for expansion of existing WWTP.

These smaller catchment shortlist option servicing assumptions were further tested and refined at the preferred option stage.

4.3 Shortlist Options Assessment

Between October 2020 and February 2021 all three shortlist options were subjected to detailed assessments against the MCA criteria, with the results used to inform the selection of a DBC preferred option. A preliminary shortlist option assessment occurred in October- November 2020, followed by a more robust re-assessment in February 2021 based on more detailed information being available. Assessments were undertaken by the project team including technical specialists with inputs from stakeholders and project partners.

Work on the Management, Commercial and Financial Cases of this DBC was carried out concurrently. This work informed some of the assessments such as the Net Present Value, constructability, operability and resilience assessments.

A summary of the shortlist option MCA assessment results are in Table EC - 7: Shortlist Options MCA Investment Objective Summary of results and Table EC - 8. The tables show the 'scores' of each option against each investment objective and critical success factor criteria. Initial assessments were undertaken individually by project team members. The project team members include civil and wastewater engineers, environment scientists, planners and economists. Moderation workshops were then held with the project team members to agree on the initial assessments and to document the rationale behind the scoring. The initial assessments were then workshopped with project partners and stakeholders for review and feedback before being finalised.

Sensitivity tests of the MCA assessment were completed, as detailed in the Short List report (Appendix E) and did not identify any notable influence on the Preferred Option Selection. The MCA assessments provided a method to systematically evaluate the short-listed options against agreed objectives. Preferred option selection also considered financial implications, risks and opportunities associated with each of the options. The key points of difference between the short-listed options are described in the following section (Section 4.4) as well as the Shortlist Report (Appendix E). The recommended preferred option was identified on the balance of outcomes from the options assessments as a whole rather than the highest total MCA score.

Table EC - 7: Shortlist Options MCA Investment Objective Summary of results

OBJECTIVE CRITERIA		Do Nothing/BAU	Option 2A	Option 4A
Water Quality	To what extent does the option reduce the level of Nitrogen, Phosphorus, Nitrates and Ammonia in the quality of the discharge?	-3	3	3
	To what extent does the option reduce the E.coli levels of the discharge to the river?	-2	2	2
	To what extent does the option reduce the risk to public health? Measure by assessing risks associated with contamination of groundwater and the location of the discharges. E.coli has been captured above	-1	1	1
Ecology	To what extent does the option impact or improve river ecosystems and hydrology	-2	1	1
	To what extent does the option provide the ability to improve vegetation coverage around riverbed and terrestrial ecosystems? - This will only be applicable if we are including potential riparian areas as part of the options? This may have to remain very high level for now	0	2	1
Cultural Connectivity / Relationship	What potential is there for land discharge vs water discharge (How much does the option reduce the discharge to the river?)			
	To what extent does this option enhance and restore cultural connectivity with the river?			
	To what extent does the option increase the opportunity to improve the number of access points to the river and/or other waterways, lakes and wetlands? - measure by considering the potential to rehabilitate existing sites/ riparian activities of options/location of site	0	2	1
Sustainable Technology	To what extent does the option allow for water reuse?	0	3	1
	To what extent does the option consider energy and carbon neutral technologies? To what extent do options reduce relative operational carbon associated with conveyance system?	-1	1	1
Sustainable Growth	To what extent does the option provide flexibility to adapt to growth and land use changes?	-3	1	2
	To what extent does this option provide additional growth opportunities which align with the sustainable and planned future growth of the Waikato Metro area?	-3	1	2

**Table EC - 8: Shortlist Options MCA Critical Success Factors (Consenting and Implementation)
Summary of results**

CRITICAL SUCCESS FACTORS CRITERIA		Do Nothing/ BAU	Option 2A -	Option 4A
Constructability (treatment)	What are the relative constructability benefits, issues and risks (available space, access, existing utilities, watercourse, rail crossings, reinstatement requirements, Geotechnical impacts, utility impacts, road and traffic impacts)	-1	-1	-2
Constructability (conveyance)		0	-2	-1
Operability (treatment)	What is the relative ease or difficulty of operation and maintenance (includes access, odour treatment, resource availability, monitoring, etc.)?	0	2	0
Operability (conveyance)		0	-2	-1
Consentability risks - land use and designation	To what extent will the option require consents for a new site (that require land use consent)??	0	-2	-1
Consentability risks - Discharge	To what extent will the option have discharges that are likely to meet discharge parameters acceptable to the consent authority	-4	-1	-2
Resilience	To what extent will the option provide resilience against potential failures, climate change impacts, natural hazards and labour skill.	-2	0	1

It should also be noted that the Do-Nothing Option was fatally flawed as it is considered un-consentable but has been included for comparative purposes.

4.3.1 Shortlist Option Assessment - Investment Objective Differentiators

Some of the specific and key differentiators between Option 2A and Option 4A outlined below.

Ecology - Terrestrial Ecosystems

Whilst both options will consider riparian vegetation and rehabilitation of the natural ecosystems, Option 4A assumes individual councils will continue to act independently. This reduces the pool of resources and potentially the scale of these projects. Option 4A (score of 1) therefore has a lower score than Option 2A (score of 2).

Cultural Connectivity / Relationship - Access to the River

Option 2A (score of 2) provides the ability to provide improved access through pathways and dual-purpose pipelines and also allows for the opportunity to repurpose the current Cambridge WWTP site. Under Option 4A (score of 1) councils will operate more independently and it is assumed there will be less opportunity to develop access to the river.

Sustainable Technology - Water Reuse

Option 2A (score of 3) by its nature has a large, centralised facility which provides a far greater opportunity for water reuse than Option 4A (score of 1). Option 2A would potentially be able to reuse water at an industrial scale rather than for irrigation. This would be possible under Option 4A.

Flexibility

Option 2A (score of 1) requires greater levels of intervention to re-distribute wastewater from the southern suburbs of Hamilton to the proposed sub-regional plant in the near future. It is also more difficult to stage to meet current projected growth under high growth scenarios. Option 4A (score of 2) has the flexibility to adapt to changing demand. Stages can be delayed or accelerated to meet needs including accommodating wet industry in the medium-term if required.

Sustainable Growth

The funding level required to implement Option 2A (score of 1) would have made subsequent changes to meeting the demand changes across the sub-region more difficult. This is due to the large initial outlay from councils. The funding requirements of Option 4A (score of 2) are comparatively lower than Option 2A; thus access to funding to respond to land use changes will be comparatively easier.

4.3.2 Shortlist Options Net Present Value (NPV) Assessment

During the long list assessment, a score was applied to each option under the 'funding potential' criteria. This assessment was replaced by the NPV Assessment used in the decision-making process.

The NPV assessment identified that Option 4A had an NPV estimate of -\$1,096 million compared with Option 2A (-\$1,212 million). Assumptions included capital cost inflation of 3%, operating cost inflation of 2%, costs modelled to 2071 and 5% discount rate).

At the time of the Preferred Option decision Option 4A was considered more affordable. It gives project partners the potential to defer capital costs in the first and second decades (2031 and 2041) with a smaller WWTP near the airport or through a different servicing arrangement for this catchment.

Through closer examination of the Preferred Option, further refinements to the capital and operational costs have been undertaken and subsequently NPV calculations have been updated. These updated NPV results for the short list options are in Table EC - 9: Shortlist Options – Southern Metro Area Net Present Value below (and are also provided in the Financial Case).

The costs have been discounted using a 5% real discount rate (i.e. no inflation has been applied to costs). The key difference is changing from a real to a nominal discounting methodology to align with Treasury's approach. This change in calculation has resulted in a minor differential change between the two short listed options but does not change the rationale for the decision to confirm Option 4A as the preferred option.

Table EC - 9: Shortlist Options – Southern Metro Area Net Present Value

	P50 Capital Costs	Renewal capital costs	Operating costs	Total
Option 2A	(\$375.5 m)	(\$9.1 m)	(\$326.5 m)	(\$711.1 m)
Option 4A	(\$341.5 m)	(\$10.3 m)	(\$314.4 m)	(\$666.2 m)

4.3.3 Other Key Risk and Opportunity Considerations

In addition to the MCA assessment there were other key risk and opportunity considerations for the two short listed options. On review, these did not change the options assessment against the criteria. But they were key considerations of the Preferred Option decision-making process. They included:

- **Staging opportunities for the Airport Precinct** - Further analysis identified that the capital cost - 'developer share' for a new wet industry to locate to the Airport precinct in Option 4A would be significantly higher compared to other existing industrial areas in Hamilton. Retaining this area for light industry only, with a much smaller Stage 1 WWTP, would reduce the initial capital and operational cost associated with Option 4A.
- **The risk of lower than planned growth impacts** - If growth is lower than currently assumed²³, Option 4A could better cater for the level of servicing need and the additional capital expenditure required for Option 2A would not be required.
- **Opportunity Cost of Option 4A** - There would be some opportunity cost associated with the selection of Option 4A over Option 2A for refinement as the Preferred Option. This includes more restricted potential wet industry development.

²³ Note: Which includes the additional growth allowance above NIDEA low for HT1, R2, Southern Links and further infill development.

4.4 Preferred Option Selection

The key outcomes of the shortlist option MCA re-assessment and cost estimate comparisons were:

- Option 4A and Option 2A achieve similar outcomes in relation to the investment objectives and Best for River outcomes.
- Option 4A and Option 2A were assessed as having a similar ability to be successfully consented and implemented.
- Option 4A had a capital cost estimate²⁴ of \$652 million compared with Option 2A (\$716 million²⁵). These included capital costs for wastewater plant investments for the Northern and Southern Metro Areas to accommodate projected growth out to 2061. Conveyance networks to new treatment plants as well as consenting, procurement, land purchase, make good and council construction overheads were also included.
- Option 4A was considered to be more adaptable to demand over time with the Southern Sub-Regional WWTP able to be staged overtime. Option 2A whilst able to respond to high levels of growth near the airport is not as flexible as Option 4A which (through refinement and future proofing) would be better able to respond to land use changes (type, space and location of growth) across the sub-region.

Option 4A, subject to significant refinements, was accepted as the Preferred Option of the DBC at the Governance Group meeting on 16 April 2021.

Further information regarding the selection of Option 4A and the refinements proposed to this option are in the Metro Wastewater DBC Preferred Option Memorandum which is an appendix to the Short List Report (Appendix E).

4.4.1 Refinement Opportunities for Selected Preferred Option (Option 4A)

The key areas for refinement of Option 4A included:

- The service area (and subsequent infrastructure investment) for the Southern Sub-regional WWTP being modified to include Hamilton South.
- Assuming that wet industrial activities serviced by the Southern Sub-regional WWTP would be deferred until an adequate proportion of municipal wastewater was serviced by the plant.

Updated scoring of Option 4A was not undertaken. The project team was instructed to detail a refined option that met the same standards and outcomes of Option 4A. The refined option needed an improved ability to stage development to meet demand for capital expenditure to occur as the demand occurred.

Development of a refined Option 4A as the Preferred Option included:

- Building a standalone facility to service Cambridge.
- Securing a site (c 15 – 20 ha) for a southern sub-regional plant in the vicinity of the airport to meet servicing needs for the Airport area and environs, Hamilton South and beyond as demand necessitates.
- Staged development of a new Southern Sub-Regional WWTP to respond to demand including servicing of Hamilton South, and the Airport area and environs.
- Developing servicing solutions in the vicinity of the Airport area and environs to meet its immediate and short-term needs.
- Improved servicing for Mātangi, including consideration of alternative solutions:
 - upgrading the existing Mātangi WWTP and renewing the discharge consent.
 - seeking a connection to the existing Hamilton wastewater network (with appropriate upgrades).
 - servicing via a centralised facility.

²⁴ Capital Cost estimates for WWTP and Conveyance are estimated by Beca and are P50 AACE Class 5 cost estimate; expected accuracy of -30% to +50%. In addition, other costs including procurement, consenting, council resources, land acquisition have also been included and are provided by others.

²⁵ Total dollars out to 2061 and unadjusted for inflation

- Improved servicing to meeting growth demand at Tauwhare Pā, including consideration of alternative solutions:
 - Expanding and upgrading the existing Tauwhare WWTP facility as required.
 - Conveying Tauwhare Pā to an upgraded Mātangi WWTP.
 - Connecting to the existing Hamilton system with Mātangi.
- Servicing Ohaupo in the future when need arises, with treatment capacity is in place via the southern facility or at Te Awamutu.
- Review potential for servicing Tamahere by conveyance to other WWTPs.

Servicing the Northern Metro communities is being considered as part of Northern Metro Area DBC investigations.

5. Preferred Option

5.1 Preferred Option Refinement

Refining the Preferred Option included additional specification and conceptual design of the Southern Sub-Regional WWTP. Specifically, the refinement investigated a staged approach for the Southern Sub-Regional WWTP. This would provide more flexibility to respond to demand and would allow for parts of south Hamilton and southern links to be serviced by this plant in the future. The refined preferred option was confirmed and approved by the Governance Group on the 16th of April 2021.

Sensitivity assessments have been used to further refine and conceptualise the preferred solution including the form, size and staging of conveyance and treatment process components.

5.2 Overview of the Preferred Option

The preferred option for the Southern Metro Area is a refinement of Option 4A and was selected through assessments of the two short-listed options (Option 2A and 4A) risk and opportunity considerations and additional investigations. The two short-listed options for the Northern Metro Area (i.e. conveying all flows to an upgraded Pukete WWTP or upgrading both Ngaaruawaahia and Pukete WWTPs) will be evaluated and a preferred option identified as part of the Northern Metro DBC.

The Preferred Option does address the problems identified in the Strategic Case and the investment objectives as outlined above. The adoption of minimum treatment performance standards across all plants (refer to Section 5.3 below) over time along with other outcomes is critical to this and contributes toward achieving the Water Quality, Ecology and Cultural Connectivity investment objectives.

An overview of the key features of the preferred option (i.e. indicative treatment plant locations and areas served) is shown in Actual demand and timing of servicing from each area will likely vary from the assumptions used in the DBC. The triggers used to inform staging and implementation of the new plant will need to be refined to reflect updates to the Hamilton and Metro Growth Strategies currently under review, and through more detailed assessment of network capacity constraints.

For example, the actual demand from the airport area and environs may be significantly lower than that used for the DBC, which has assumed some wet industrial activity post 2051. The timing and extent of Hamilton (and other areas such as Southern Links Area) diverted to the new plant will likely vary from the assumptions used in the DBC. The diversion may occur much earlier than 2061 and the extent may vary based on growth, network and Pukete WWTP constraints.

It is recommended that demand assumptions are revisited and confirmed as part of implementing the new Southern Sub-Regional WWTP in the immediate- short term.

Figure EC - 7 Specific details of the areas and population are included in Table EC - 10.

The preferred option for the Southern Metro Area consists of:

- The adoption of minimum treatment performance standards across all plants (refer to Section 5.3 below) over time.
- A new Southern Sub-Regional WWTP to service the airport industrial precinct, Mātangi/ Tamahere commercial area and southern Hamilton. Development of the plant will be staged to meet demand. Land discharge is proposed for Stage 1 with a move toward a discharge to water in Stage 2 and beyond as flows increase.
- Retaining and upgrading the Tauwhare Pā WWTP and land discharge to service local growth with the potential to be reticulated to the new Southern Sub-Regional WWTP or HCC network in the future.
- A new WWTP at Cambridge with discharge to the Waikato River to meet the long-term needs of Cambridge.

- Retaining and upgrading the Te Awamutu WWTP to achieve improved treatment standards and cater for growth. Continued discharge via rock channel to the Mangapiko Stream is assumed.
- Improvements to the existing Mātangi WWTP until the wastewater is conveyed to the new Southern Sub-Regional WWTP in around 2040.
- Tamahere commercial hub to continue to utilise on-site wastewater treatment and discharge systems until 2040 when Mātangi is diverted to the Southern Sub-Regional WWTP.
- Ohaupo continuing with private on-site wastewater systems given there are no known environmental concerns with existing systems and development is expected to continue to be low density.

Actual demand and timing of servicing from each area will likely vary from the assumptions used in the DBC. The triggers used to inform staging and implementation of the new plant will need to be refined to reflect updates to the Hamilton and Metro Growth Strategies currently under review, and through more detailed assessment of network capacity constraints.

For example, the actual demand from the airport area and environs may be significantly lower than that used for the DBC, which has assumed some wet industrial activity post 2051. The timing and extent of Hamilton (and other areas such as Southern Links Area) diverted to the new plant will likely vary from the assumptions used in the DBC. The diversion may occur much earlier than 2061 and the extent may vary based on growth, network and Pukete WWTP constraints.

It is recommended that demand assumptions are revisited and confirmed as part of implementing the new Southern Sub-Regional WWTP in the immediate- short term.

Figure EC - 7: Preferred Option Overview – Key features and overview of staging of Southern Sub-Regional WWTP

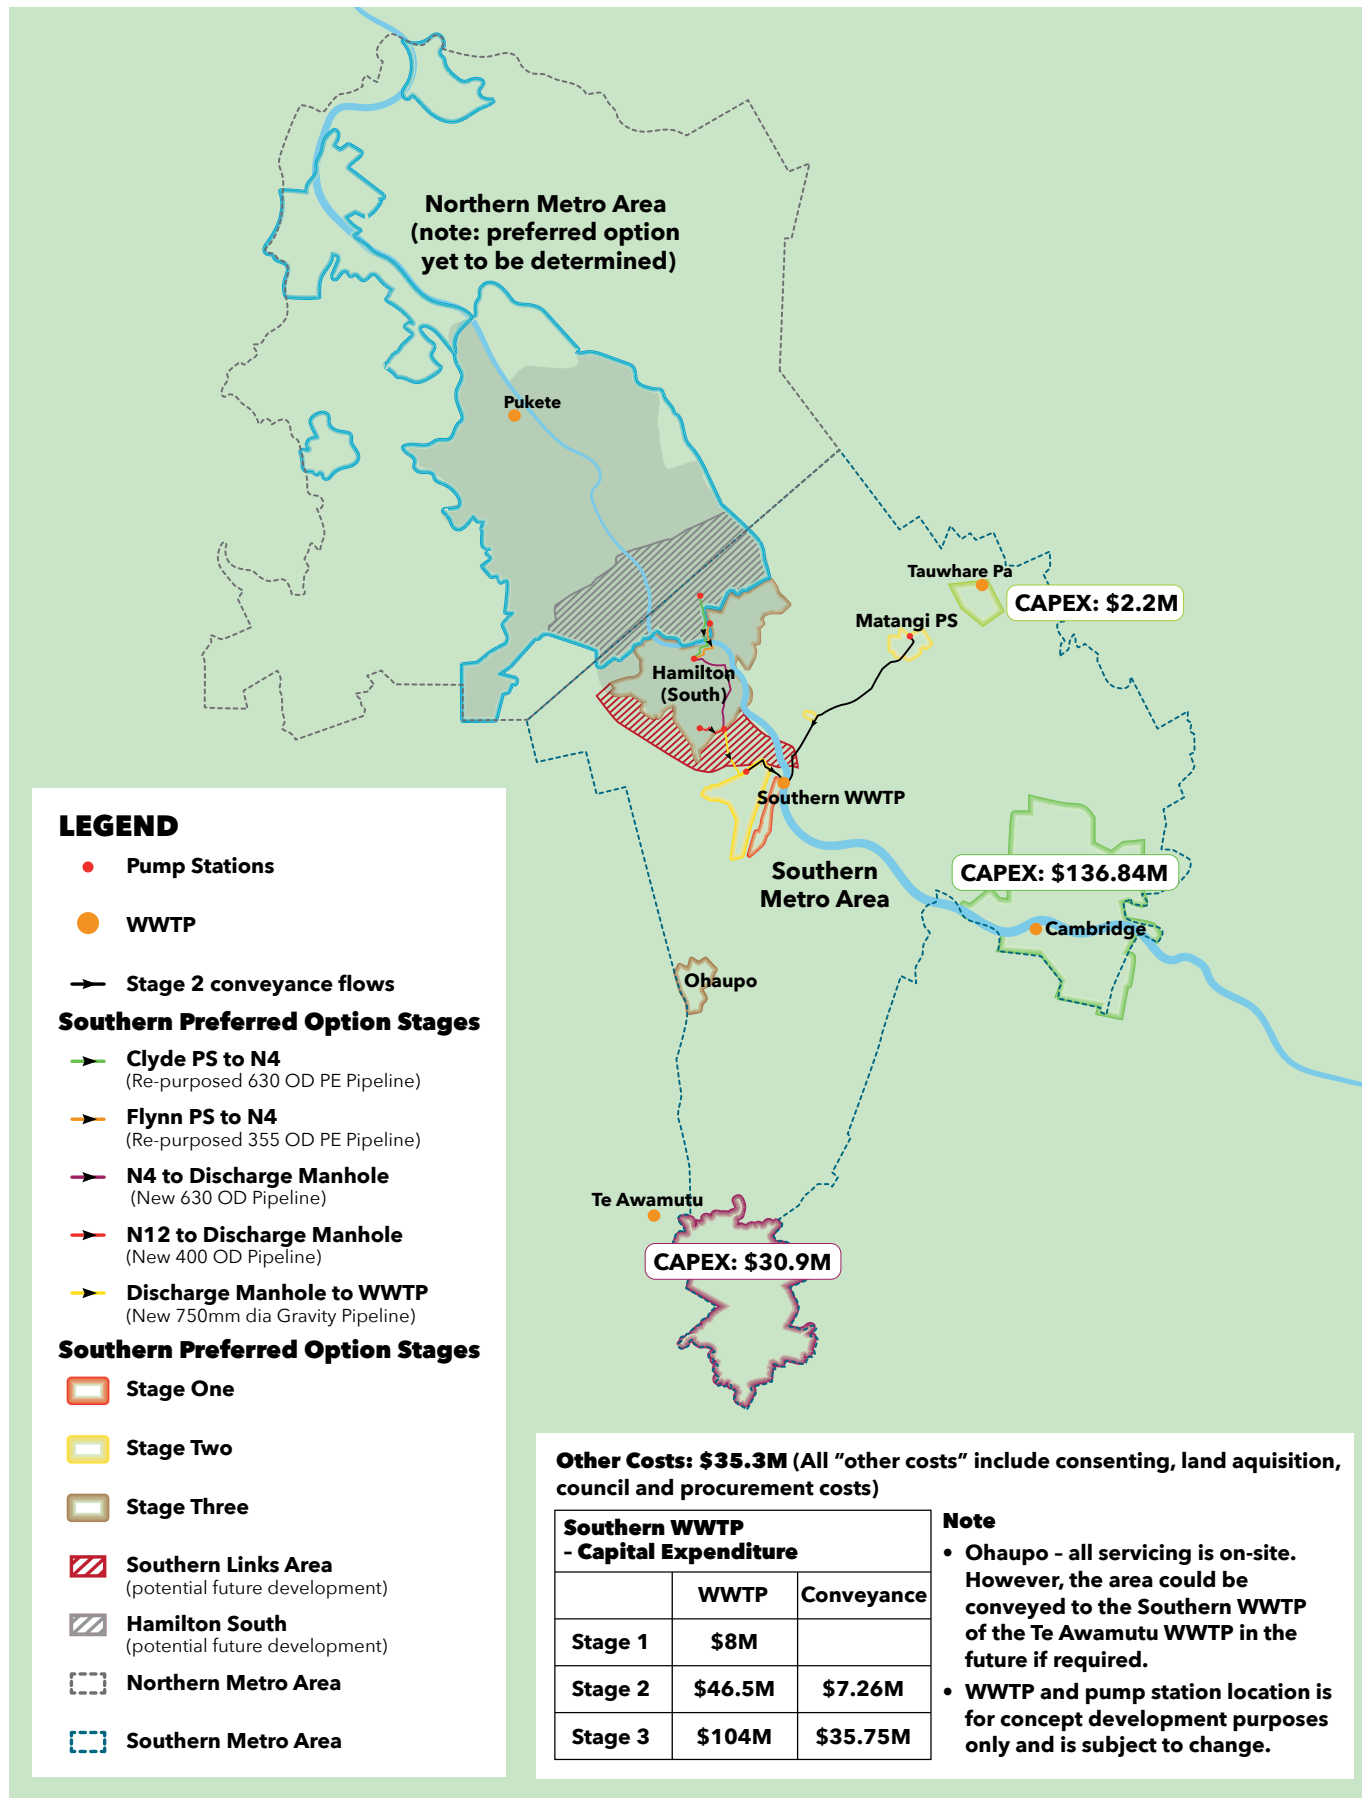


Table EC - 10: Summary of Preferred Option WWTPs, Service Areas and Population Equivalents Served over time

WWTP	Locations served	Population equivalent serviced by capacity available at the following dates					Notes	
		2031	2041	2051	2061	Ultimate		
Mātangi WWTP	Mātangi Village	150	Transfer to Southern Sub-Regional WWTP					
Tauwhare Pā WWTP	Tauwhare Pā	619	619	619	619	889	2031 projection includes for additional 500 PE at Tauwhare Pā from current estimates. Ultimate includes allowance for Tauwhare Village (270 PE)	
New Southern Sub-Regional WWTP	Airport & environs	4,000	6,000	17,852	17,852	17,852	Assumptions are based on ~85 ha of developed dry industrial land being serviced at 2031; ~140 ha of dry industrial land being serviced at 2041. Assumptions includes flows from wet industrial land use from 2051*	
	Mātangi/Tamahere	Existing standalone facility	464	464	464	1,035	Includes servicing Tamahere commercial area (does not include Tamahere residential area)	
	Hamilton South: Hillcrest, Riverlea, Glenview, Peacocke.	Serviced through Pukete WWTP			59,626	75,366	DBC assumes diversion to new WWTP at 2061. Additional PE in "ultimate" horizon is based on infill in these areas from 2020 Metro Spatial Plan.	
	Southern Links Area	Not Serviced				35,000	Ultimate forecast includes allowance for Southern Links	
	Sub-Total	4,000	6,464	18,316	77,942	129,253	The Stage 3 WWTP can operate from 40,000 Population equivalent demand level	
Cambridge WWTP	Cambridge	32,940	37,801	42,892	45,031	57,649	Assumptions includes for flows from wet industrial land use for small area	
Te Awamutu WWTP	Te Awamutu	27,989	30,905	34,982	36,001	42,011		
No WWTP	Ohaupo	Not serviced					All servicing is on-site. However, the area could be conveyed to Southern Sub-Regional WWTP or Te Awamutu in future if required.	

* Wet industrial flow assumptions based on 50 ha (~20% of airport industrial land) producing an addition 2 litres per second per hectare of wastewater flow.

5.3 Treatment Plant Performance Standards

The minimum treated wastewater quality standards adopted are very high. They are based on current best practice and delivering 'Best for River' outcomes which include having a river that is swimmable and safe to gather food from. Minimum performance standards for all treatment plants are in Table EC - 11: Minimum water quality standards for discharges to water and Table EC - 12.

Table EC - 11: Minimum water quality standards for discharges to water

Parameter	Minimum Performance Standards for Discharges to Water
Total Nitrogen	Less than 4.0 milligrams per litre (as annual means)
Total Phosphorus	Less than 1.0 milligrams per litre (as annual means)
Escherichia coli (E.Coli)	Less than 14 cfu per 100 millilitres (as a 95th percentile)
	Noting that the future consents for any water based discharges will likely specify daily limits on nutrient mass loadings based on parameter concentrations and projected discharge volumes.

Table EC - 12: Minimum water quality standards for discharges to ground

Parameter	Minimum Performance Standards For Discharges To Ground
Total Nitrogen	Less than 20 milligrams per litre (as annual means)
Total Phosphorus	No specific limit
Escherichia coli (E.Coli)	Less than 500 cfu per 100 millilitres (as a median)
	Noting that actual parameters will depend on nitrogen and phosphorus loads able to be sustainably discharged to land irrigation systems, and appropriate microbial parameter limits will be dependant on the method and location of discharge to ground.

The treated wastewater quality standards would be introduced by 2031 or when the existing discharge resource consent for each wastewater treatment plant expires. Achieving these targets may need to be staged over time within resource consents to provide sufficient time to upgrade and transition existing plants (i.e., Pukete WWTP) to meet these minimum standards. During any resource consent process the form of the water quality standards will be further refined and may include ranges to take into account normal expected system variation and other location specific factors. These refinements will not degrade the basis and/or adopt a lower water quality standard than that of the adopted standards for this DBC.

For the purpose of completing the DBC, assumptions have been made regarding discharge methods to be employed at each plant. Appropriate discharge methods will need to be considered and evaluated in detail as part of each Project to support resource consenting of any discharge activities.

In order to give effect to Te Ture Whaimana, alongside these quantitative minimum performance standards, further methods will be required to protect the mauri of the water and land from adverse effects. These requirements will need to be determined as part of implementing the Projects.

Appropriate management of solids from treatment processes is an important consideration in any treatment strategy. In line with the agreed treatment performance standards for the Waikato Metro Area, solids management complexity, extent of solids destruction and energy potential realisation will increase in steps with population equivalent served.

Proposed provisions for atmospheric emissions are reasonably general but all would require best practice to be implemented.

In all process plant development, life cycle emissions will be given due consideration. It is anticipated that each council will consider The Climate Change Response (Zero Carbon) Amendment Act 2019 aspirations and optimisation of life cycle emissions generally. These will be drivers for initiatives, particularly in the larger plants, and for processes that drive the plants towards energy neutrality and emissions minimisation.

More detailed information is contained in the Wastewater Treatment Assumptions Memorandum²⁶ which is included in the Preferred Options Report (Appendix F).

5.4 Conceptualised Treatment Processes

The conceptualised treatment processes adopted for this DBC for the purpose of staging and cost estimating are outlined below in Table EC - 13.

Table EC - 13: Treatment Concept Development

Site	Population Equivalent (rounded)	Flow range (m ³ /d) (rounded)	Liquid Processes	Solids Processes	Discharge
Mātangi WWTP	150	30	Local and communal septic tanks and recirculating sand filter (until 2040). UV if there is a risk of bypass flow	Periodic clean out of septic tanks	Sub-surface drip irrigation to land (until 2040)
Tauwhare Pā WWTP	275	55	Package secondary treatment with land disposal	Periodic clean out of septic tanks	Sub-surface drip irrigation to land
Southern sub-regional WWTP (Airport) Stage 1	2,000-5,000	400 - 1,000	SBR	Transfer thickened sludge to Pukete or Cambridge WWTP	Sub-surface drip irrigation to land
Southern sub-regional WWTP (Airport) Stage 2	5,000-18,000 ²⁷	1,000-3,600	Secondary BNR reactor Membrane separation UV	Screw press dewatering	Discharge to water, wetland restoration and/or reuse. Stage 1 land discharge could continue for part of flow
Southern sub-regional WWTP (Airport) Stage 3	78,000 ²⁸	- 15,500+ ²⁹	Primary Sedimentation Secondary BNR reactor Membrane separation UV disinfection Centrate treatment	Digester ³⁰ centrifuge dewatering	Discharge to water, restoration, or reuse. Stage 1 land discharge could continue for part of flow
Cambridge WWTP	25,000-45,000	5,000-9,000	Primary Sedimentation Secondary BNR Reactor Membrane separation UV Disinfection Centrate Treatment Installation of primary sedimentation and digesters could be delayed with extra reactor capacity required	Digester Centrifuge Dewatering	Discharge to water, restoration or reuse.
Te Awamutu WWTP	20,000-36,000	4,000-7,200	Reactor Clarifiers UV	Filter Press (existing)	Discharge to water via rock filter

26 Wastewater Treatment Assumptions for Waikato Metro Wastewater DBC, August 2020, included in Appendix F, Preferred Option Technical Report, September 2021.

27 WWTP at this stage can operate up to 40,000 Population equivalent demand level, however, DBC demand projections for Southern Sub-Regional WWTP prior to Hamilton South being connected reach a maximum of 18,000 PE.

28 WWTP at this stage can operate from 40,000 Population equivalent demand level, however DBC assumes that all of the Hamilton South area (Hillcrest, Glenview, Peacocke) will be diverted at the same time in 2061.

29 This WWTP can be upgraded further by adding additional process units such as reactors and membrane systems as needed to service additional growth post 2061.

30 The solids stream management ultimately chosen for this population and beyond is likely to be heavily influenced by that ultimately selected for Pukete WWTP.

5.5 Water Discharges

A range of discharge options have been identified as part of the options development and evaluation and is included in Section 3.2.3 of the Shortlist Options Report (Appendix F). For the purpose of this DBC, assumptions have been made regarding discharge methods to be employed at each plant. Appropriate discharge methods will need to be considered and evaluated in detail as part of each Project to support resource consenting of any discharge activities.

5.6 Southern Wastewater Treatment Plant: Staging and Key Considerations

Staged development of the Southern Sub-Regional WWTP is a key element of the Preferred Option. The staging and related demand trigger points have been identified using sensitivity analysis which takes into consideration urban growth across the Southern Metro Area catchment, including demand for wet industry. The timing of the proposed staging can be adjusted to meet these demand changes and is outlined in the Preferred Option Report (Appendix F). The proposed capacity of Stage 1 is based on the extent of land currently developed or consented in and around the airport and is proposed to be operational in Year 5 (2026) to:

- Avoid investment in short-term servicing solutions that do not achieve the agreed investment objectives, including many package treatment plants, or storage and tankering options that do not provide long-term sustainable solutions.
- Provide certainty for land use planning and development.
- Provide for wastewater reticulation and conveyance systems in and around the Airport that support land development and are compatible with the medium to long-term wastewater servicing solution for the Waikato Metro Area.

Stage 2 upgrades will be triggered by growth and are currently based on servicing future development areas around the Airport precinct and surrounding communities (including Mātangi), and the need for improved treatment and alternative discharge methods. Stage 2 provides for an interim upgrade to provide for wet industrial activity at around 2051.

Stage 3 represents a step-change in capacity and treatment processes to service Hamilton South. Timing of the Hamilton South diversion included in this DBC is based on an assessment of build-out capacity of the Pukete WWTP site. (Refer Section CC for details). However, the timing of the diversion may be required earlier than assumed, due to conveyance network constraints and/or growth occurring at a greater rate than assumed.


Further upgrades will be required as flows increase, for example, if Southern Links areas develop.

A summary of Southern Sub-Regional WWTP staging is provided in Table EC - 13: Treatment Concept Development above, Table EC - 14: Southern Treatment Concept Staging (note that these are further refined in the Financial Case) and illustrated in Figure EC - 8 below. Servicing catchments and conveyance is detailed further in Figure EC - 12 and Figure EC - 13.

Table EC - 14: Southern Treatment Concept Staging (note that these are further refined in the Financial Case)

Year	Date	Stage	Description	Assumed Areas Served	Total Stage Built Capacity	Capital Cost Estimate	Starting Demand
1 - 3	2022-2024	Stage 1	Pre-Implementation: Land acquisition, designation, consenting, master planning	Land and designation assumed to serve all stages		\$20 m	
3-5	2024-2026	Stage 1	WWTP: SBR with discharge to land including procurement and Council overheads and land discharge extension	Airport precinct (no allowance for wet industry)	1,000 m ³ /day (5000 PE)	\$9.9 m	400 m ³ /day (2,000 PE)
19 - 21	2040-2042	Stage 2	WWTP & Discharge: MBR with discharge to Waikato River. Includes conveyance from Matangi to plant, outfall pipeline and structure to river, operator building, sludge dewatering facility.	Airport precinct growth (excluding wet industry) and Mātangi/Tamahere Commercial areas	1,900 m ³ /day (9500 PE)	\$39.6 m assumes all Stage 1 plant can be reused	1,200 m ³ /day (6,000 PE)
29-31	2050-2052	Stage 2	WWTP Upgrade: Additional reactors and membrane equipment	Airport precinct growth, wet industry and Mātangi/Tamahere Commercial areas	3,600 m ³ /day (18,000 PE)	\$16.5 m	3,600 m ³ /day (18,000 PE)
39-41	2060-2062	Stage 3	WWTP: MBR with Energy Recovery (Primary Sedimentation and Digestion) with discharge to Waikato River. Includes conveyance from Southern Hamilton, major increase in treatment capacity.	Airport precinct (with wet industry), Mātangi/Tamahere Commercial, Southern Hamilton	15,600 m ³ /day (78,000 PE)	\$150.15 m (assumes 60% Stage 2 plant can be reused)	15,600 m ³ /day

Figure EC - 8: Southern Sub-Regional WWTP Assumed Staging and Capacity (Population Equivalents)

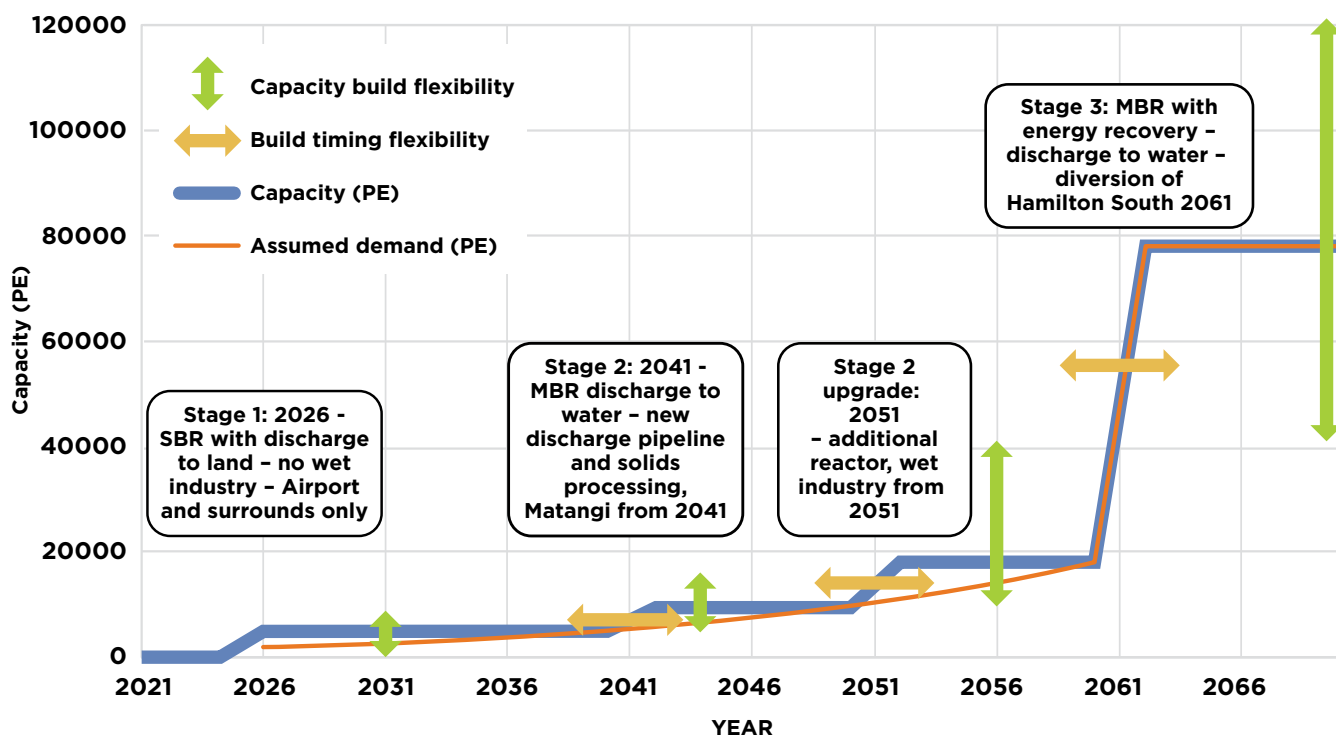

5.6.1 Stage 1 – SBR with Discharge to Land

Servicing areas

This stage services the airport precinct only and does not have an allowance for wet industry. The areas assumed to be serviced by the Stage 1 Southern Sub-Regional WWTP are shown in Figure CC. Cost of conveyance to the plant is assumed to sit with the developer and is not included in the DBC.

Assumed starting date and plant flow

The plant would be operational in 2026 with 400 m³/day (2,000 PE) operating flows assumed for start-up. Flows less than 400 m³/day could be accommodated, although treatment efficiency would be reduced. Stage 1 can service up to 1,000 m³/day (5000 PE) without further upgrades or expansion.

Assumed configuration

A two tank Sequenced Batch Reactor (SBR) in IDEA configuration, configured for biological nitrogen removal followed by ultra violet (UV) disinfection is proposed for Stage 1. IDEA is a hybrid of SBR and Modified Ludzack Ettinger (MLE) technology. All three are commonly used technologies in New Zealand and are shown in Figure EC - 9 below.


The IDEA plant can cater for a wide range of flows and loads, providing the flexibility needed.

Reactor sizing and zone sizing will be configured with future reconfiguration (to MBR technology) in mind so the reactors can be re-used in future stages.

The decant tank would be sized and shaped for future reconfiguration as a membrane and or flow equalisation tank when the MBR conversion happens.

Discharge to land via sub-surface drip irrigation is proposed for Stage 1. The DBC assumes that 8 -10 ha would be required for sub-surface drip irrigation, and that the irrigation fields would be located on the WWTP site. However, further area may be needed depending on soil conditions and flows. For example, first installing the discharge to land system for up to 500 m³/day then, when necessary, adding incremental blocks of 250 or 500 m³/d capacity. No additional land acquisition beyond that assumed for the WWTP has been included.

Figure EC - 9: Stage 1 Southern Sub-Regional WWTP Configuration

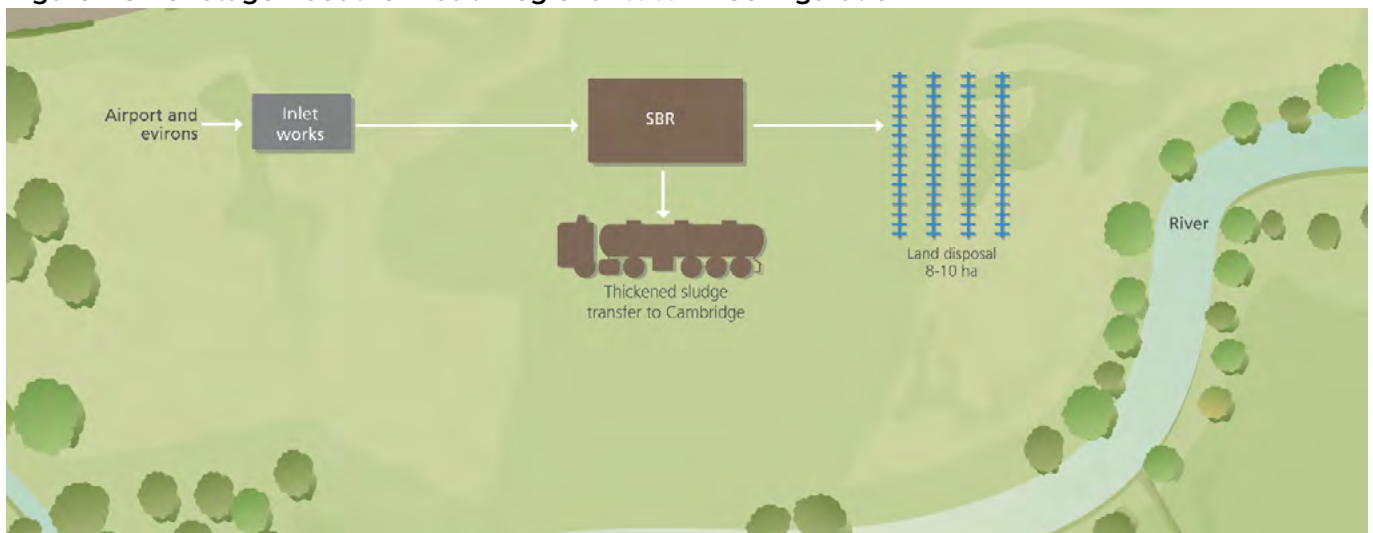

Interim upgrades or additional requirements

No upgrades should be required for this WWTP unless some of the UV modules are omitted to start with.

Theoretical trigger and estimated date to start next stage

Commencement of Stage 2 will be triggered once flows exceed 1,000 m³/day (5000 PE). Based on projections this is assumed to be around 2041. Implementation of Stage 2 will probably require two years. The connection of Mātangi and the Tamahere commercial area is assumed to occur when Stage 2 is commissioned.

Timing of the wet industry growth for the airport industrial precinct has been assumed to occur post 2051.

The current proposed staging provides flexibility as there is no planned wet industry. If wet industry was planned and agreed, the timing of Stage 2 could be progressed earlier to meet servicing requirements. Including wet industry will need to take into account the variability of flows and loads that will occur.

All or part of the land disposal system developed for Stage 1 could potentially be retained for Stage 2.



5.6.2 Stage 2 – MBR with discharge to Waikato River

Servicing areas

Stage 2 services the Airport precinct and Mātangi/ Tamahere commercial areas. The areas assumed to be serviced by the Stage 2 Southern Sub-Regional WWTP, and the conveyance system concept details are shown in Error! Reference source not found.. No provision is included for wet industrial activity at the Airport precinct until 2051.

Assumed starting date and plant flow

This stage would be operational in approximately 2041. Starting flows of 1,200 m³//day (6,000 PE) are assumed, however the initial Stage 2 build capacity is 1,900 m³/day. The plant could be down rated by delaying the installation of individual membrane cassettes to match the actual flow growth profile.

Assumed configuration

For Stage 2, it is proposed the original Stage 1 IDEA plant is reconfigured into a Membrane Bioreactor (MBR) treatment plant based on either the 4 or 5 stage Bardenpho activated sludge process Figure EC - 10. Stage 2 assumes a discharge to water and therefore requires a higher standard of treatment than Stage 1.

The MBR provides solids separation using membranes (rather than gravity settlement) and in so doing, also essentially removes all bacteria (not viruses) from the effluent.


The membrane configured plant has a significantly higher biomass carrying capacity than a conventional gravity separation plant and so the treatment capacity of a given reactor size is greater as an MBR than as an SBR/IDEA (i.e. a reactor sized for a maximum of 1,000 m³/day ADF, could cater for over 2,000 m³/day in MBR configuration). The number of air diffusers consequently has to be increased to support the increased biomass. The Pukekohe WWTP has recently been reconfigured from an SBR to an MBR treatment plant.

One objective of the transformation from IDEA to MBR is to reuse most, if not all, of the existing infrastructure.

The existing reactors would be provided with additional aeration diffusers with one tank at a time retrofitted. The Stage 1 Decant tank would be configured into the membrane tank and scouring diffusers added. It is possible a portion of this tank could also be configured as the new influent flow equalisation tank.

This new set-up would provide a redundant reactor for a period of time. This would also allow for more rapid diversion south of flows from parts of the southern suburbs of Hamilton City if appropriate.

Figure EC - 10: Stage 2 Southern Sub-Regional WWTP Configuration

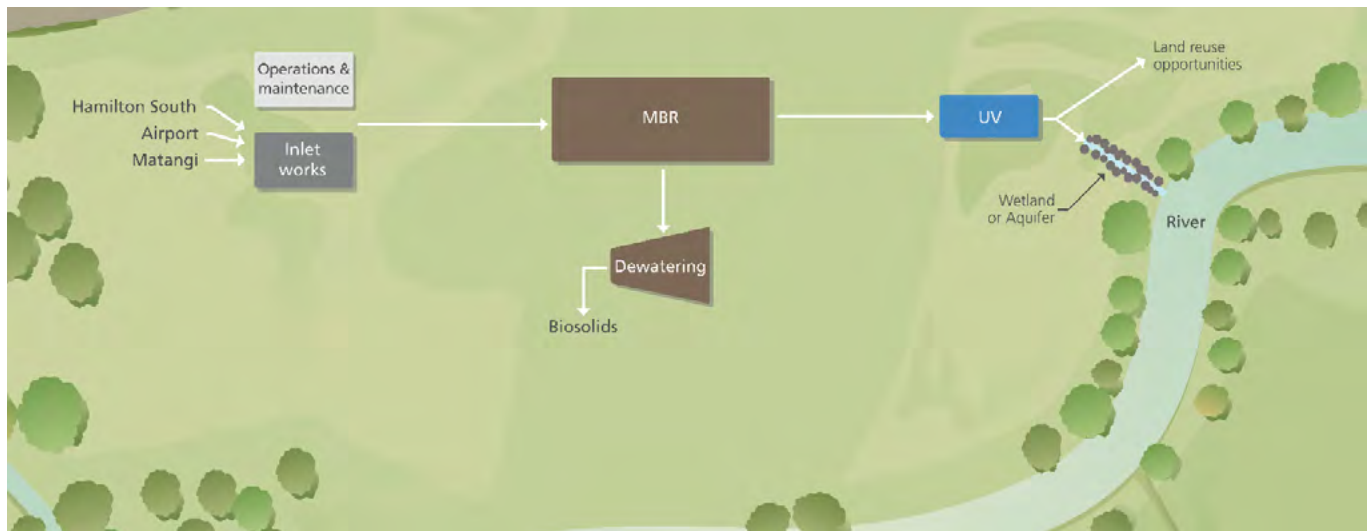

Interim upgrades or additional requirements

The staging plan provides for an interim upgrade in 2051 for additional reactor and associated membrane equipment. This upgrade will expand capacity to 3,600 m³/day and allow for servicing of wet industrial activity or additional growth. At 3,600 m³/d, a three-reactor plant would have limited spare capacity but could tolerate limited duration shut-down of one treatment train for maintenance.

Theoretical trigger and estimated date to start next stage

The next stage would be triggered by unexpected growth around the airport or growth in wet industry beyond the capacity of the plant. It may also be triggered if it becomes necessary to divert Hamilton South catchments from Pukete WWTP to the Southern Sub-Regional WWTP. For the purposes of this staging plan we have assumed these triggers would occur in 2061.

5.6.3 Stage 3 – MBR with Energy Recovery (Primary Sedimentation and Digestion) with discharge to Waikato River

Servicing areas

This stage services the Airport precinct (with wet industry), Mātangi/ Tamahere commercial areas and Southern Hamilton (Hillcrest, Riverlea, Glenview and Peacocke catchments). The areas of Southern Hamilton assumed to be diverted to the Southern Sub-Regional WWTP, and the conveyance system concept details, are shown in Figure EC - 11.

Southern Links area is allowed for at the ultimate stage PE forecasts, but timing is uncertain and has been assumed to be after 2061.

Assumed starting date and plant flow

For the purposes of this DBC it has been assumed that this stage will become operational in approximately 2061. The precise operational start date and flow will most likely depend on the timing and requirements for servicing the Hamilton South catchments.


Nominally, the starting flows for a Stage 3 type have been assumed to be 8,000 m³/d. However, this is very much dependent upon the needs for servicing Hamilton South catchments. A step change to 15,000 m³/day servicing 78,000 PE (464 P/E for Waikato DC, 17,852 P/E for Waipa DC and 59,626 P/E for Hamilton CC) has been assumed based on the available growth projections and the change of Hamilton South catchment flows occurring around 2061.

Assumed configuration

The solution is expected to be a continuation of the MBR configured treatment plant of stage 2 as shown in Figure EC - 11. below with additional:

- Reactor and membrane trains
- Screens and UV modules
- Primary sedimentation and anaerobic co-digestion of primary sludge and waste activated sludge.

Figure EC - 11: Stage 3 Southern Sub-Regional WWTP Configuration

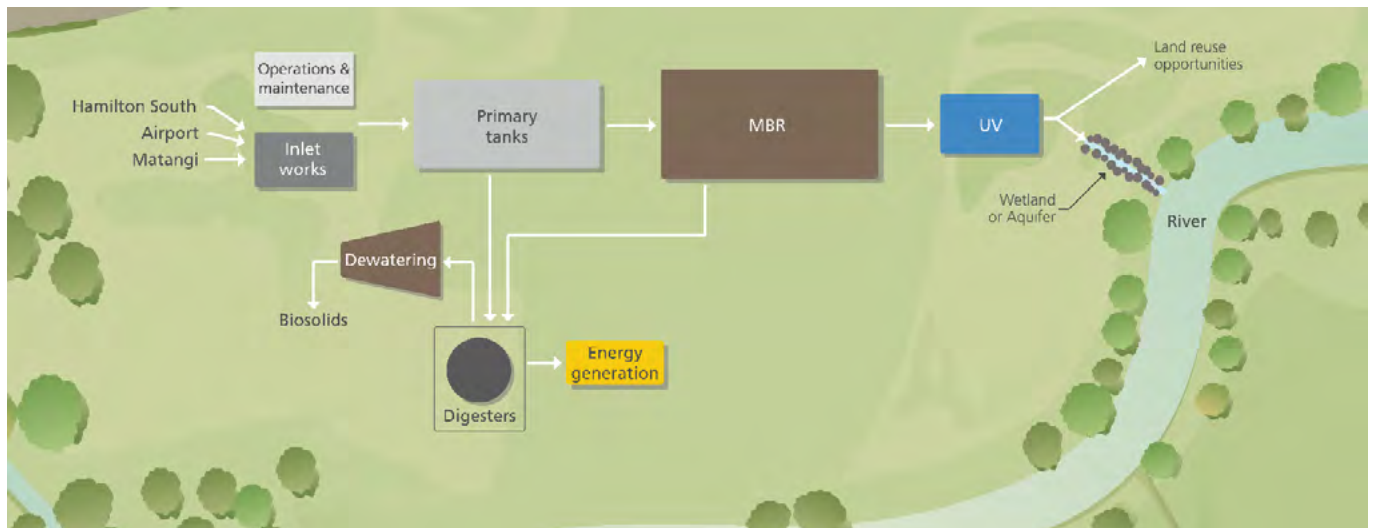

A key risk involves the provision of private infrastructure by the developers in the airport precinct. The level of investment required to deliver, operated and maintain onsite wastewater solutions is significant and will only meet the immediate needs of the individual landowner or developer. There are practical limits to the flows that can be processed through an onsite wastewater solution, and so there is a risk of a proliferation of these types of systems to respond to growth over time. This will increase operating, maintenance and compliance costs and complexity and could result in poorer system performance over time.

Investment in further private infrastructure misses the opportunity to invest in key strategic infrastructure required for the broader Metro Area.

Staged implementation of the Southern Sub-Regional WWTP allows for servicing in the short-term and also provides greater surety and confidence for commercial businesses to develop near the airport in decades to come. It also provides the ability to respond to Hamilton's needs going forward and land use changes in the local area.

A new site or WWTP offers the opportunity to masterplan a treatment facility to achieve the greatest operational efficiency while being able to adapt quickly and easily to growth changes and future demands. A buffer area around the WWTP will be required to mitigate potential visual, odour and noise issues.

5.7 Conveyance

The Preferred Option conveyance consists of the new conveyance infrastructure to connect to current and future reticulation networks to the treatment facilities.

The conveyance infrastructure included in the DBC estimates are the terminal pumping systems (pump stations and rising mains) from the service areas to the southern treatment plant. The costs associated with local or trunk network upgrades or diversions to convey wastewater to the terminal conveyance systems are not included in the financial assessments of the preferred option. Costs of network upgrades needed to service growth within each city/community have not been included either as, in most cases, investment in upgrading the existing conveyance networks would be required regardless of the wastewater treatment solution.

As the assumed Stage 1 service area (located at the Airport) is near the assumed location of the Southern Sub-Regional WWTP, no strategic conveyance costs have been included for Stage 1. The cost of local reticulation and trunk conveyance infrastructure needed to service the Stage 1 area would sit with developers, not councils.

The assumed Stage 2 service area is shown in Figure 20. The Stage 2 conveyance system estimates include the terminal conveyance system from Mātangi to the Southern Sub-regional WWTP. A new pump station at Mātangi discharging into a 9.7 km 2000D PE pressure main to the new Southern Sub-Regional WWTP (Figure EC - 10: Stage 2 Southern Sub-Regional WWTP Configuration) is included.

For the purpose of this DBC, conveyance from Mātangi to the Southern Sub-Regional WWTP is assumed to occur in 2041. However actual connection timing will be triggered by demand. When flows at Mātangi are 3-4 times existing flows there are less likely to be septicity issues in the pipeline. This could be through additional residential or commercial development in the village or by connecting up more of the surrounding area. Tamahere hub could also connect into this pipeline. The cost of the Tamahere hub pumpstation has not been included in the financial assessments of the preferred option.

Figure EC - 12: Assumed Stage 1 and 2 Service Areas and Stage 2 Conveyance details


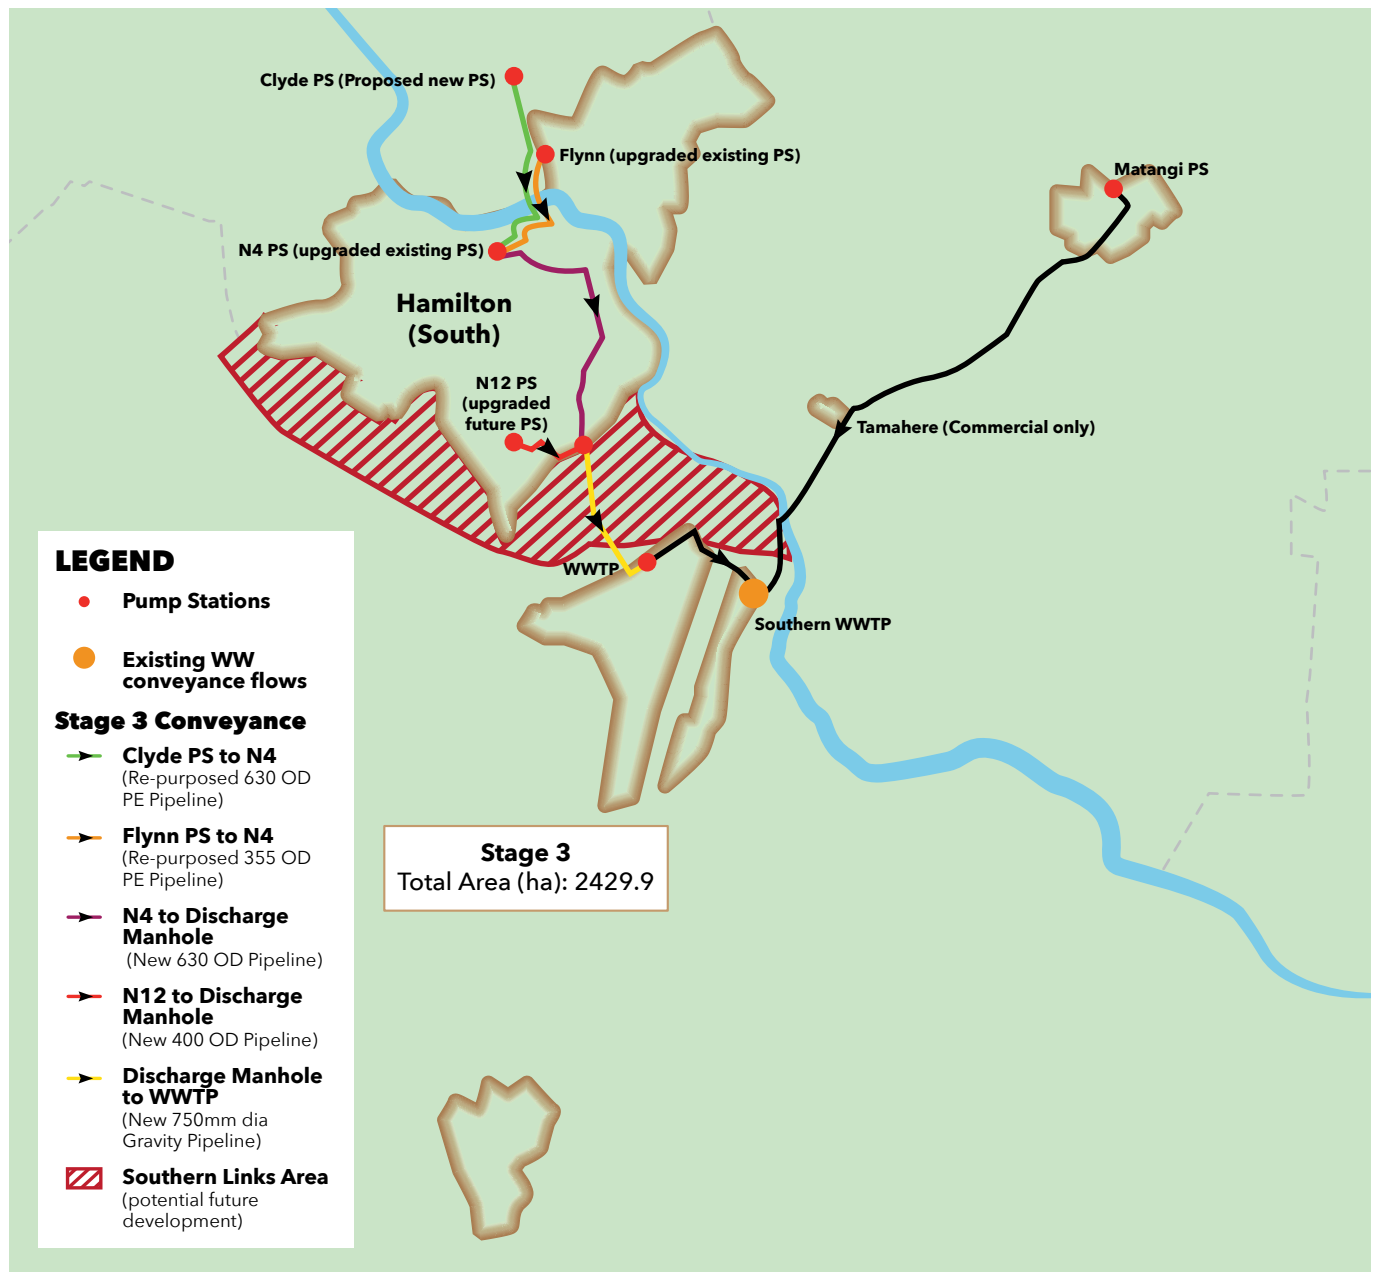


Figure EC - 13: Assumed Stage 1, 2 and 3 Service Areas and Stage 3 Conveyance details

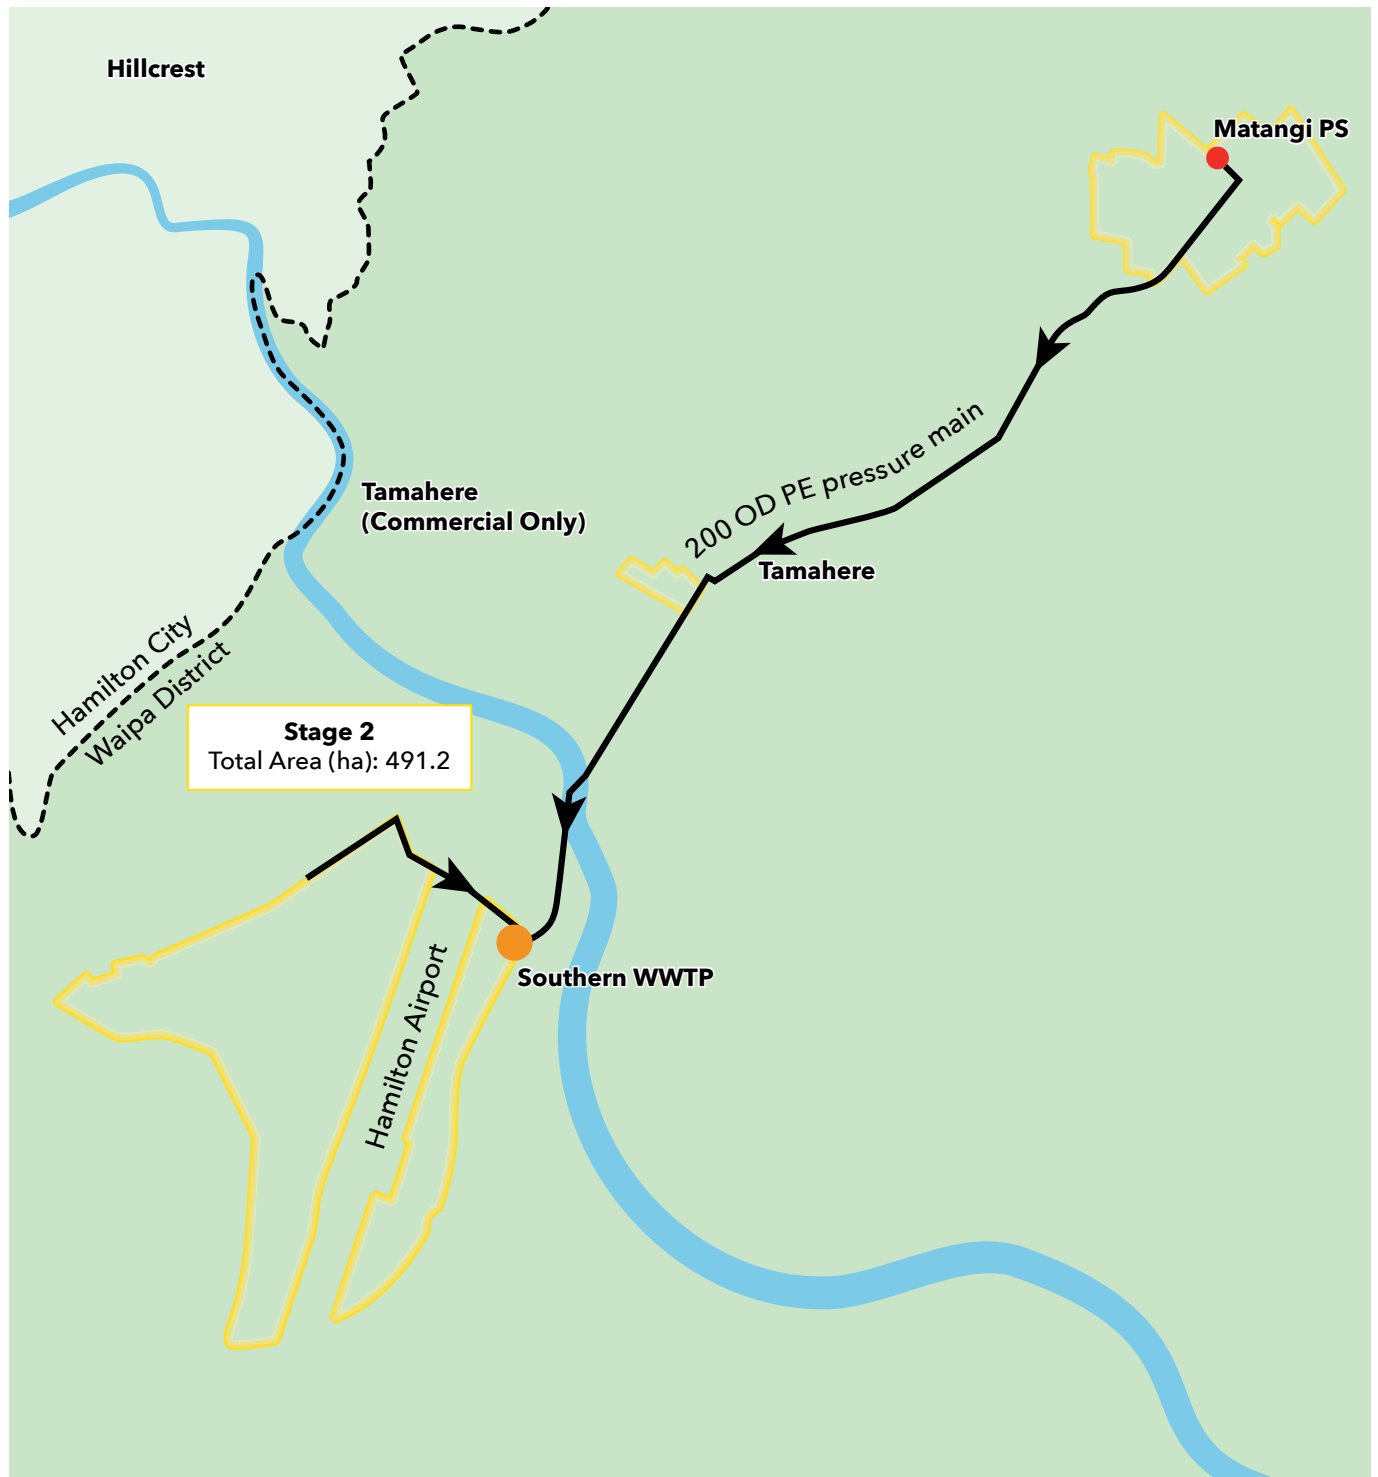

The assumed Stage 3 service area and conveyance system elements included in the DBC are shown in Figure 21 and further outlined in the Preferred Option Report (Appendix F). The Stage 3 conveyance system includes a new pump station at Clyde Street and an upgraded Flynn pump station utilising the Peacocke rising mains in reverse. Both pump stations would pump to the N4 pump station in the Peacocke growth cell. The N4 and N12 pump stations will divert flow through (new or repurposed) pressure mains to the Southern Sub-Regional WWTP. The estimates include for re-purposing the N4 and N12 pump stations as their construction is either underway or funded as part of delivering the Peacocke growth cell. Several local and trunk pump station upgrades and diversions will be necessary to divert the full extent of Stage 3 Hamilton South Area, however these costs have not been included in this DBC.

- For this purpose of this DBC diversion of Hamilton South is assumed to occur in 2061. A number of factors will influence the actual timing of the Hamilton South diversion, including the cost of upgrading the Hamilton strategic wastewater network and Pukete plant, versus the cost of conveyance and upgrades to the Southern Sub-Regional WWTP, and the rate and scale of growth in and around Hamilton South.
- The Southern Sub-Regional WWTP has been developed to be able to be expanded to meet changing needs and growth across Hamilton and the sub-region. The recommended site footprint for the Southern Sub-Regional WWTP provides for sufficient space to expand the plant to service a larger part of Hamilton in the future if deemed more efficient.
- Some initial conveyance concepts for the Southern Links area have also been developed which link in with the conveyance concept for the Peacocke area. The costs of conveyance and plant upgrades to service other parts of Hamilton not outlined above and/or Southern Links area through the Southern Sub-Regional WWTP are not included in the financial assessments of the preferred option.

5.8 Nutrient Summary

The following information is summarised from the technical note Wastewater Baseline and Future Nutrient Loads for Waikato Metro Wastewater DBC (Appendix G).

Calculation and comparison of future predicted nutrient (Total Nitrogen (TN) and Total Phosphorus (TP)) mass loads against the baseline nutrient loads from the existing treated wastewater discharges for the southern metro areas has been undertaken. This is to analyse whether the proposed level of wastewater treatment and associated discharges will meet the various policy and statutory requirements, such as Te Ture Whaimana around improving the health and wellbeing of the river. In particular, analysis indicates whether the proposed future discharges (which will likely see an increase in volume discharged) will deliver a reduction in the total nutrient loads discharged to the Waikato River compared to the baseline nutrient loads.


The predicted mass loads from the proposed new Southern Sub-Regional WWTP and the upgraded Cambridge WWTP were considered individually and in combination with each other, and in combination with other Metro WWTP discharges.

When considered alone the new Southern Sub-Regional WWTP will exceed the TN and TP mass load baseline. This is because it is a new WWTP and discharges into a largely greenfield environment. Wastewater generated by the few existing industrial sites in the vicinity is either discharged to land or trucked offsite (mostly to Cambridge WWTP). Any growth and the associated wastewater discharge would be considered against a very low existing baseline. The existing baseline for TN is 1 kg/day and <1 kg/day for TP, and this is associated with the current discharge to land from the Mātangi WWTP (these flows will be re-directed to the new Southern Sub-Regional WWTP once it is operational).

Taking a combined view of future mass loads is considered reasonable, given that wastewater generated by a few of the existing airport industrial sites is already trucked offsite to the Cambridge WWTP. If there was no Southern Sub-Regional WWTP, the additional flow and load to be served by the plant would likely be conveyed to either Pukete or Cambridge to be treated and discharged.

As shown in Figure EC - 14: Baseline and predicted nutrient loads for the Cambridge WWTP and Airport Southern Sub-Regional WWTP combined, when the Cambridge WWTP and new Southern Sub-Regional WWTP are considered together, future nutrient loads are substantially less than existing. This is likely to be consistent with policy and statutory requirements around improving water quality and Best for River principles.

Figure EC - 14: Baseline and predicted nutrient loads for the Cambridge WWTP and Airport Southern Sub-Regional WWTP combined

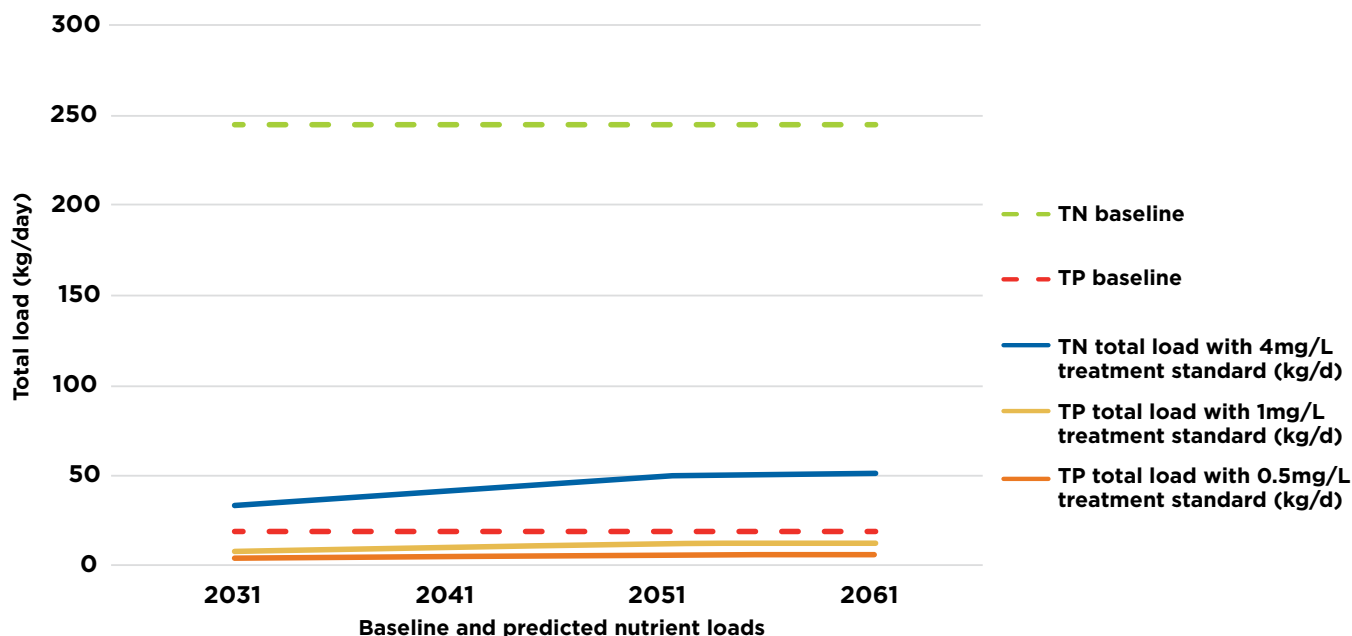

In addition to employing high treatment standards, investment in restoration may also be required to deliver Best for River outcomes. This could be achieved in a number of ways, including by planting erosion prone land and undertaking riparian planting.

If the Cambridge WWTP and the new Southern Sub-Regional WWTP are not considered together for consenting purposes, then offsetting would likely be required when consenting the discharges from new Southern Sub-Regional WWTP due to the very low nutrient mass load baselines.

5.9 Other Wastewater Treatment Plant Upgrades

Through the development of this DBC it was confirmed that the Cambridge and Te Awamutu WWTPs will be upgraded by Waipa District Council to meet the long term needs of those communities.

Planning and design for the Cambridge WWTP upgrade and preparation of the resource consent application for long term discharge consents are underway. This DBC has evaluated the capital and operating costs to achieve the agreed minimum treatment performance standards at an updated Cambridge WWTP.

The estimates included in this DBC for Te Awamutu WWTP are based on the funding included in the Waipa District Council 2021 - 2031 LTP and provisional estimates and do not reflect the level of investment likely to be required to achieve the treatment standards agreed through this DBC. This approach was taken because the long-term discharge consent for Te Awamutu is relatively new and is unlikely to be reviewed in the near future. However, the costs associated with achieving the agreed standards will need to be evaluated as part of future Te Awamutu WWTP consenting and upgrade projects.

This DBC also assumes that Tauwhare Pa WWTP is to be expanded and continue to be a discharge to land approach. An alternative to service Tauwhare Pa via the new Southern Sub-Regional WWTP or connection to the Hamilton network was also considered at a high level. The need for alternative solutions or system upgrades will be triggered by demand.

Further information is provided below and in the Preferred Option Report (Appendix F).

Cambridge WWTP

The new Cambridge WWTP can be staged as outlined in Table EC - 15: Option 4A Cambridge WWTP Base Staging below and concept development has been progressed in parallel to this process. Additional screens, reactors, primary sedimentation tanks and digestors are added over time in response to residential and industrial growth. Primary sedimentation and digestion processes could be added post 2050 when flows are higher, but this would require more reactor capacity and result in less energy recovery.

Treatment plant development would need to provide both horizontal and vertical spaces for the process units to be added, subsequent to the initial phase of development. Initial process configuration would need to allow vertical and horizontal spaces for the future introduction of primary sedimentation tanks.

Table EC - 15: Option 4A Cambridge WWTP Base Staging

Asset	Size ³¹	2031	2041	2051	2061
Flow	m ³ /d	6,824	7,678	8,578	9,006
Screens	200L/s	2	2	2	3
PSTs	80m ²	3	4	4	4
Reactors	1000m ³	3	3	3	4
Membrane Trains	100L/s	4	4	4	5
Digesters	1100m ³	2	2	3	3
Dewatering	10m ³ /hr	2	2	2	2
Biosolids @ 26%DS	m ³ /d	5.6	5.8	6	6.1

Te Awamutu WWTP

The Te Awamutu WWTP currently provides a reasonable treated wastewater quality with load-based TN and TP requirements. Capacity upgrades to cater for growth are planned for around 2030. A further upgrade is expected to be required around the consent expiry date of 2044 to meet the very high treated wastewater standards adopted by this DBC for discharge to water.

Tauwhare Pā WWTP

Duplication of the current treatment plant and land discharge system at Tauwhare Pā could service expected growth at this location. This is expected to meet the treatment standards adopted for discharge to land in this DBC.

³¹ Process unit sizes are indicative and will likely change. Designers will refine these and numbers may alter depending upon selected resilience and redundancy policies.

5.10 Risks

The key risks (refer to Management Case – Section 1.5 for additional detail including detailed mitigations) for this project include:

- The recommended DBC projects cannot be funded leading to the project being delayed, not proceeding or lower standards being adopted, as a result of competing priorities, financial constraints, capital cost increases and/or, poor integration, coordination and planning.
- Costs to implement recommended DBC projects are significantly higher than estimates. This could further impact on affordability and lead to the project being delayed, not proceeding or lower standards being adopted as a result of increased market (resources and materials) costs due to demand, supply chain issues or poor risk allocation in construction contracts.
- The recommended DBC projects do not meet the partner expectations which may impact ability to implement the recommendations, consentability and adversely impact relationships as a result of poor engagement partner views not reflected in decision making and project not delivering on 'best for river' outcomes.
- Resource consents and designations for the recommended option cannot be secured, or the costs to deliver a consentable solution are prohibitive as a result of the need for a new discharge to the Waikato River, other WWTPs consent renewal timeframes do not align, or legislative change of the Vision and Strategy.
- While the DBC has been prepared on the basis of 'business as usual' water services delivery, three waters reforms could result in the projects being deferred, delayed or not occurring in the timeframes required. This delay will result in a proliferation of on-site private solutions, undermining the long-term investment in the Southern Sub-Regional WWTP. Conversely, reforms may provide a stronger financial position to support project implementation than BAU.
- Inability for councils to move to an integrated delivery programme results in uncoordinated delivery of the overall programme, misalignment of objectives and 'Best for River' principles.

Technical risks

The technical risks relating to the Preferred Option are outlined in Table EC - 16: Technical Risk Summary below.

Table EC - 16: Technical Risk Summary

Risk Area	Description	Cause	Consequences	Mitigation measures
Meeting initial demand	Delay in Stage 1 delivery for Southern Sub-Regional WWTP	Planning, approvals (including consents) and design stages are delayed	Private developer investment in decentralised solutions. This may impact on project viability in the medium term and will result in inefficient infrastructure investment.	Early engagement with potential land owners for WWTP site, project planning and funding confirmation
WWTP Site and Conveyance corridor protection	WWTP site and Conveyance corridors not protected for future servicing requirements	Delayed decision making and project implementation of WWTP. Future transfer of wastewater from Mātangi and Hamilton South to a Southern Sub-Regional WWTP will also require protection of the conveyance routes.	Increased project costs and potential delays to project delivery	Early purchase of WWTP site Allowances for utilities corridors should be considered when designations, sub-divisions and new infrastructure (roads and bridges) are implemented. Space in berms alongside existing roads should be protected
Wet industry demand	Wet industry demand occurs before current assumed servicing from 2051	Wet industry demand occurs prior to planned time (assumed from 2051). Flows and plant design up until 2051 are insufficient to accommodate large amounts of wet industry. Wet industry has high demands and far more variable flows than the domestic flows the plant will be servicing up until this time.	If wet industry did not locate to this area, or more wet industry arrived than allowed for, process capacity could be delayed or bought forward to match requirements. A very high proportion of trade waste flows and loads to the Southern Sub-Regional WWTP could impact on treatment performance.	Early diversion of largely domestic flows from Hamilton South or Southern Links could mitigate this risk. Careful consideration in design processes and the setting of trade waste discharge consent conditions.
Change in rate of growth	Lack of or excess WWTP/network capacity	Change in rate of growth compared to assumptions	Limits growth (need to accelerate future stages) or financial burden of under-utilised assets	Regular reviews of actual growth and development plan submissions. Flexibility in process unit sizing at WWTPs. Generous sizing and master planning of pipelines/sites
Change in wastewater composition	Lack of or excess WWTP capacity	Change in wastewater composition compared to assumptions	Limits growth (need to accelerate future stages) or financial burden of underutilized assets	Regular reviews of actual characterization of wastes (flow & load) Flexibility in process unit sizing. Generous sizing and master planning of sites

Risk Area	Description	Cause	Consequences	Mitigation measures
Biosolids	Limited options for biosolids reuse/disposal	No coordinated approach to biosolids reuse/disposal. Research around emerging contaminants such as hormonal compounds, pharmaceuticals and micro-plastics leads to widespread rejection.	Increased operating cost, lost opportunities for resource recovery. Increased greenhouse gas emissions	Plan to minimise biosolids mass to be removed from site Treatment process operation to maximise destruction of harmful organics. Remain adaptable to treatment methods that improve biosolids quality
Construction market	Increased capital cost (no commercial tension)	Saturated construction market, lack of resource available	Increased cost, delays to project implementation	Early market engagement with attractively configured packages of work including those with a narrow scope that may suit specialist contractors.
Ground conditions	More extensive ground improvements required	Poor ground conditions. Liquefaction potential	Increased capital costs	Early (before concept design) investigation of likely sites to allow time to alter plant configuration/change site. To be done as part of due diligence for land acquisition and easements
Greenhouse gas emissions	Increased cost of energy, chemicals and biosolids disposal	Typically, GHG emissions have largely been given lip service in comparison to other effects of an activity. Change in zero carbon legislation /targets (introduction of carbon taxes/levies) Liquid and solids discharge concerns trump concerns around greenhouse gas emissions. Reluctance to invest in energy recovery technology.	Increased capital costs and operating costs Increased rather than decreased GHG emissions over what is a readily achievable 'Baseline'.	Develop a sound, useable and agreeable methodology for comparing the relative effects of whole-of-life cost, atmospheric emissions, emissions to water and emissions to land. The methodology will include cultural, Environmental, Social and economic criteria
Site Layout	Inefficient site development	Limited or poor master planning of WWTP sites	Limits population that can be served. Increased cost, H&S issues	Certainty around potential development areas and types Adequate resourcing of master planning process and subsequent reviews
Conveyance corridors	Pipeline routes take time to secure	Some or all conveyance corridors secured (to WWTP and from WWTP to river)	Time delay to projects	Cooperative approach to landowner relationships and negotiations
Operational costs	Increases in operational costs	Introduction of carbon levies or taxes related to energy, biosolids or WWTP emissions.	Increasing various costs including disposal of biosolids to landfill, power to operate the facility	These costs could be reduced if biosolids reuse (Stage 3) come to be viewed as a resource and used accordingly

5.11 Recommended Investigation and Design


For the Preferred Option further investigation and design is recommended as follows:

- Geotechnical investigations for the Southern Sub-Regional WWTP.
- Review of redundancy requirements for major process units e.g. screens and reactors.
- Investigation of biosolids reuse and disposal options.
- Offsetting and consenting options.
- Further investigation of sustainability and capital/operational carbon footprint.
- Further refinement of capital, operational and present value analysis.
- Master planning for Cambridge and Southern Sub-Regional WWTP sites.

The DBC level cost estimates include allowances for the investigations above and appropriate contingencies.

A breakdown of proposed project activities to implement the Southern Sub-Regional WWTP is provided in the Management Case (Section 1.2.4).

Figure EC - 15: Proposed Project Activities (Management Case - Section 1.2.4)

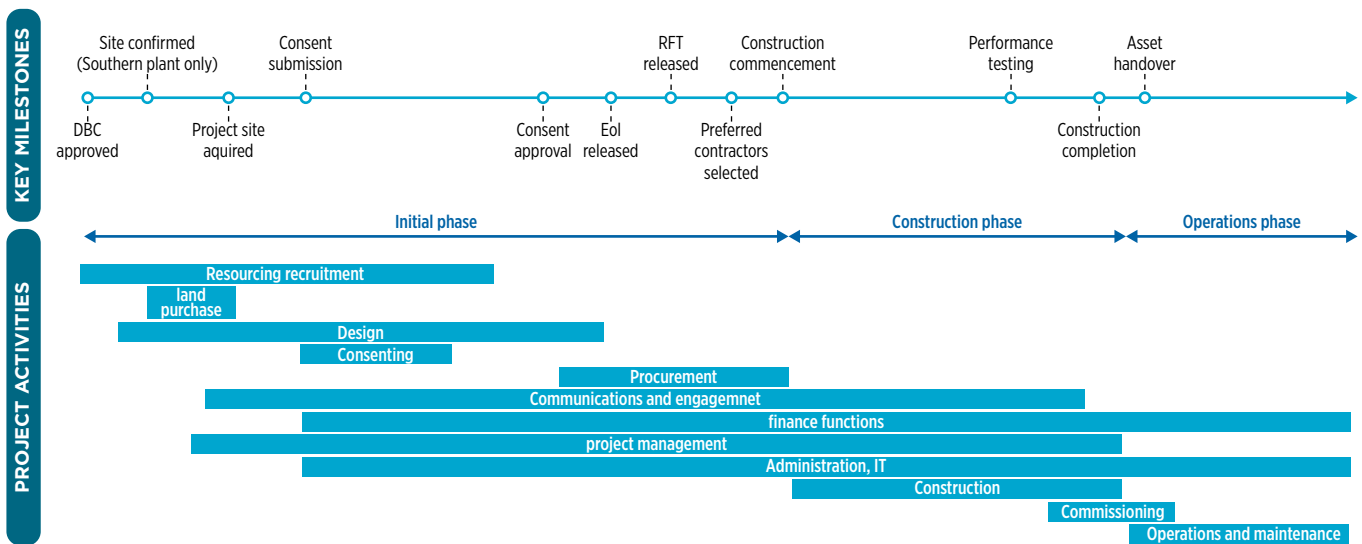

5.12 Cost Estimates

Cost estimates representing capital and operating requirements to 2061 were prepared to establish the order of magnitude capital and operational costs for the Preferred Option. The estimates were developed as part of the DBC to provide early estimates for inclusion in budgeting and funding applications for implementation funding.

They will need to be refined once a detailed design is developed as part the next stage in the process. The cost estimates are deemed to be Class 5 estimates as per the AACE³² Cost Estimate Classification System and have an expected accuracy range of -30% / +50%.

The capital and operational costs for the Southern Sub-Regional WWTP are shown in Table EC - 17: Stage 1 Capital Cost Estimate Breakdown (2026), Table EC - 18 and Table EC - 19 below. The costs for the other WWTPs are shown in Table EC - 20: below. The costs are also outlined in the Financial Case and contain additional information regarding cashflows and specific timing for expenditure.

The Financial Case provides analysis of the financial implications for the delivery of the Preferred Option including capital, operational, land purchase and, procurement and construction overheads based on Council estimates.

³² Association for the Advancement of Cost Engineering – Practice No. 18R-97

Table EC - 17: Stage 1 Capital Cost Estimate Breakdown (2026)

Item	Cost (2020 values)
Land Acquisition Assumes adequate land for Stage 1, 2 and 3 WWTP development	\$12 m
Master planning and consents This includes consenting for land and water discharge for Stage 1 and 2 and includes for Master planning, designation and consents for the treatment and discharge facilities.	\$8 m
2026 Wastewater Treatment Plant & Discharge System	
Design, ground improvements and initial civil work	\$1 m
Land disposal system: part – irrigation (sub-surface drip irrigation on approximately 10 ha)	\$1 m
SBR reactors, screens, mechanical and electrical equipment	\$6 m
2026 WWTP & Discharge (Capital Costs) Sub-Total:	\$8 m
2026 WWTP Procurement & Council Overheads Allowance of 10% of capital costs for procurement and Council overhead costs (as per the Financial Case)	\$0.8 m
Other Stage 1 Costs – extend the irrigation equipment and system (assumes use of land acquired in Stage 1)	\$1.1 m
Total – Capital Expenditure	\$29.9 m
Annual Operational Costs	\$0.544 m

Table EC - 18: Stage 2 Capital Cost Estimate Breakdown (2041 and 2051)

Item	Cost (2020 values)
2041 Wastewater Treatment Plant & Discharge System	
Outfall: 1 km pipeline plus discharge structure (assumed gravity flow)	\$4.5 m
Treatment Plant including screens, membranes, UV system, mechanical and electrical equipment, and pipework	\$19.5 m
Civil works and buildings	\$6 m
2041 WWTP & Discharge (Capital Costs) Sub-Total:	\$30 m
2041 Procurement & Council Overheads Allowance of 10% for procurement and Council overhead costs (as per the Financial Case)	\$3 m
2041 Matangi Conveyance Costs includes allowance of 10% for procurement and Council overhead costs (as per the Financial Case)	\$7.26 m
2051 WWTP (Capital Costs) Sub-Total Additional reactors, membranes, screens and aeration system (2051) – includes allowance of 10% for procurement and Council overhead costs (as per the Financial Case)	\$16.5 m
Total – Stage 2 Capital Expenditure	\$56.76 m
Annual Operational Costs WWTP	\$0.672 m - \$2.05 m
Annual Operational Costs Matangi Conveyance	\$0.102 m

Note: Consent approvals and cost assumed to be covered under stage 1

The Stage 2 plant costings assume that all Stage 1 plant can be reused.

While the key tankage will already be in place, the costs incurred will include:

- Provision of trunk infrastructure (including pipes and channels) on site for large future flows.
- Grit removal and second stage screening.
- Upgraded aeration system.
- Upgraded UV system.
- Dewatering facility.
- Reconfiguration work.
- Membrane trains and associated plant and plant room.
- Operator facilities.

Stage 2 also assumes that a treated water discharge to the river will be required and includes for a new outfall pipeline and a new outfall structure. The outfall cost estimates are based on 1 km distance from the river as the location, and nature of discharge are currently unknown.

Approximately 40% of the initial Stage 2 cost is associated with the outfall and dewatering facility.

Table EC - 19: Stage 3 Capital Cost Estimate Breakdown (2061)

Item	Cost (2020 values) \$
2061 Wastewater Treatment Plant & Discharge Systems	
Structural and civil works	\$48 m
Mechanical and electrical equipment	\$48 m
Upgrade capacity outfall pipeline and structure	\$8 m
2061 WWTP & Discharge (Capital Costs) Sub-Total	\$104 m
2061 Procurement & Council Overheads Allowance of 10% for procurement and Council overhead costs (as per the Financial Case)	\$10.4 m
2061 Hamilton South Conveyance Costs Conveyance for Hamilton South includes allowance of 10% for procurement and Council overhead costs (as per the Financial Case) – does not include servicing the area between the Southern Links designation and existing Hamilton City boundary	\$35.75 m
Total - Stage 3 Capital Expenditure	\$150.15 m
Annual WWTP Operational Costs	\$7.44 m
Annual Matangi Conveyance Operational Costs	\$0.102 m
Annual Hamilton South Conveyance Operational Costs	\$0.8 m

Note: Consenting costs relating to Stage 3 have not been included for the purposes of financial modelling. The consent approval process required at that time (c2055-2060) is unknown. Approval for a significant increase in discharge volume will be required.

Cost estimates to upgrade other wastewater treatment facilities in the Southern Metro Area are included in Table EC - 20 below. The assumptions and staging applied to each of these facilities are detailed in the Preferred Option Technical Report.

Table EC - 20: Preferred Option Cost Summary (un-escalated and excluding Southern Sub-Regional WWTP)

WWTP name	WWTP Capital Cost (\$ m) up to 2061 - includes allowance of 10% for procurement and Council overhead costs (as per the Financial Case)	Operational Cost @ 2061 (\$/year)
Cambridge	\$ 136.84 m	\$2.8 m
Mātangi	\$ 0.55 m (short term improvements)	Matangi is assumed to be serviced by the Southern Sub-Regional WWTP from Stage 2 (2041)
Te Awamutu	\$30.9 m	\$4.0 m
Tauwhare Pā	\$ 2.2 m	\$0.04 m

The estimates for Cambridge are based on achieving the treatment quality standards agreed through this DBC project.

The estimates for Te Awamutu are based on the funding included in the Waipa District Council 2021 - 2031 LTP and provisional estimates of the costs of further upgrades. These estimates do not reflect the level of investment likely to be required to achieve the agreed treatment standards. The costs associated with achieving the agreed standards will need to be evaluated as part of future Te Awamutu WWTP consenting and upgrade projects.

Over time the total operational costs increase as flows increase. The large plants with PSTs and digesters have significantly lower relative costs due to energy recovery and reduced biosolids volumes for disposal. The technology associated with the addition of primary sedimentation (PST), digestion and energy recovery increase the capital cost of a treatment plant development or plant upgrade.

However, a choice to delay the installation of PSTs and digesters at the Cambridge plant would increase operational costs. Any decision on delaying energy recovery facilities should take into account the whole-of-life cost implications.

5.13 Implementation

The implementation plan is summarised in Figure EC - 16: Preferred Option implementation plan below. Triggers have been identified to move between development stages. The Southern Sub-Regional WWTP development stages are triggered by local (Airport area and environs), Mātangi or Hamilton demand. Mātangi conveyance and Cambridge and Te Awamutu WWTP upgrades are triggered by growth and new resource consent requirements. Developer agreements will trigger the need to upgrade at Tauwhare Pā WWTP. Servicing of Ohaupo would be triggered by environmental issues with current on-site wastewater systems or significant increased demand due to higher density development.

Key implementation steps for the new Southern Sub-Regional WWTP involve:

Stage 1 - Pre-implementation

- Develop an understanding of the existing and short-term flows that will need to be managed before Stage 1 is operational. Coordination with the airport and other developers to develop a servicing concept and input into master plans for developments.
- Entering into funding agreements for pre-implementation activities and land acquisition.
- Securing land for the plant, buffers and Stage 1 land discharge. The total site area will be large enough to cater for future plant expansion.
- Master planning of the site to support staged plant development.
- Designating and consenting the treatment plant and discharge activities (Stages 1 and 2)
- Entering into funding agreements for Stage 1 of the plant.

Stage 1

- Commencing Stage 1 of the treatment plant development. SBR treatment technology with land disposal is proposed for the first stage. This technology provides enormous flexibility in terms of flows and load and will provide effluent quality suitable for application into or onto land. The first stage would cater for a capacity of between 400 m³/day and up to 1,000 m³/day (but with some flexibility on these limits). Soils will need to be suitable for low-rate irrigation year round.


Stage 2

- When the demand to the Stage 1 plant nears 1,000 m³/day, the plant would be upgraded to an MBR system and is likely require a discharge to water. There is the potential for all or part of the Stage 1 land disposal system to continue to be used in parallel with the discharge to water. The MBR system would be able to be configured using the Stage 1 SBR reactor tanks much like what was recently with the conversion of the Pukekohe WWTP from SBR to MBR configuration. This system will be upgraded to meet demand and with local demand, is expected to be 3,600 m³/day by 2061. If servicing of parts of the Southern links or Peacocke catchments was desired, the Stage 2 plant could be potentially be upgraded to 8,000 m³/day capacity. The MBR technology would also open up opportunities for re-use of treated wastewater by selected industries.

Stage 3

- The Stage 3 Treatment Plant upgrade provides additional capacity to service Hamilton South and allows for enhanced energy and resource recovery. Further system upgrades would be undertaken to meet demand.

Figure EC - 16: Preferred Option implementation plan

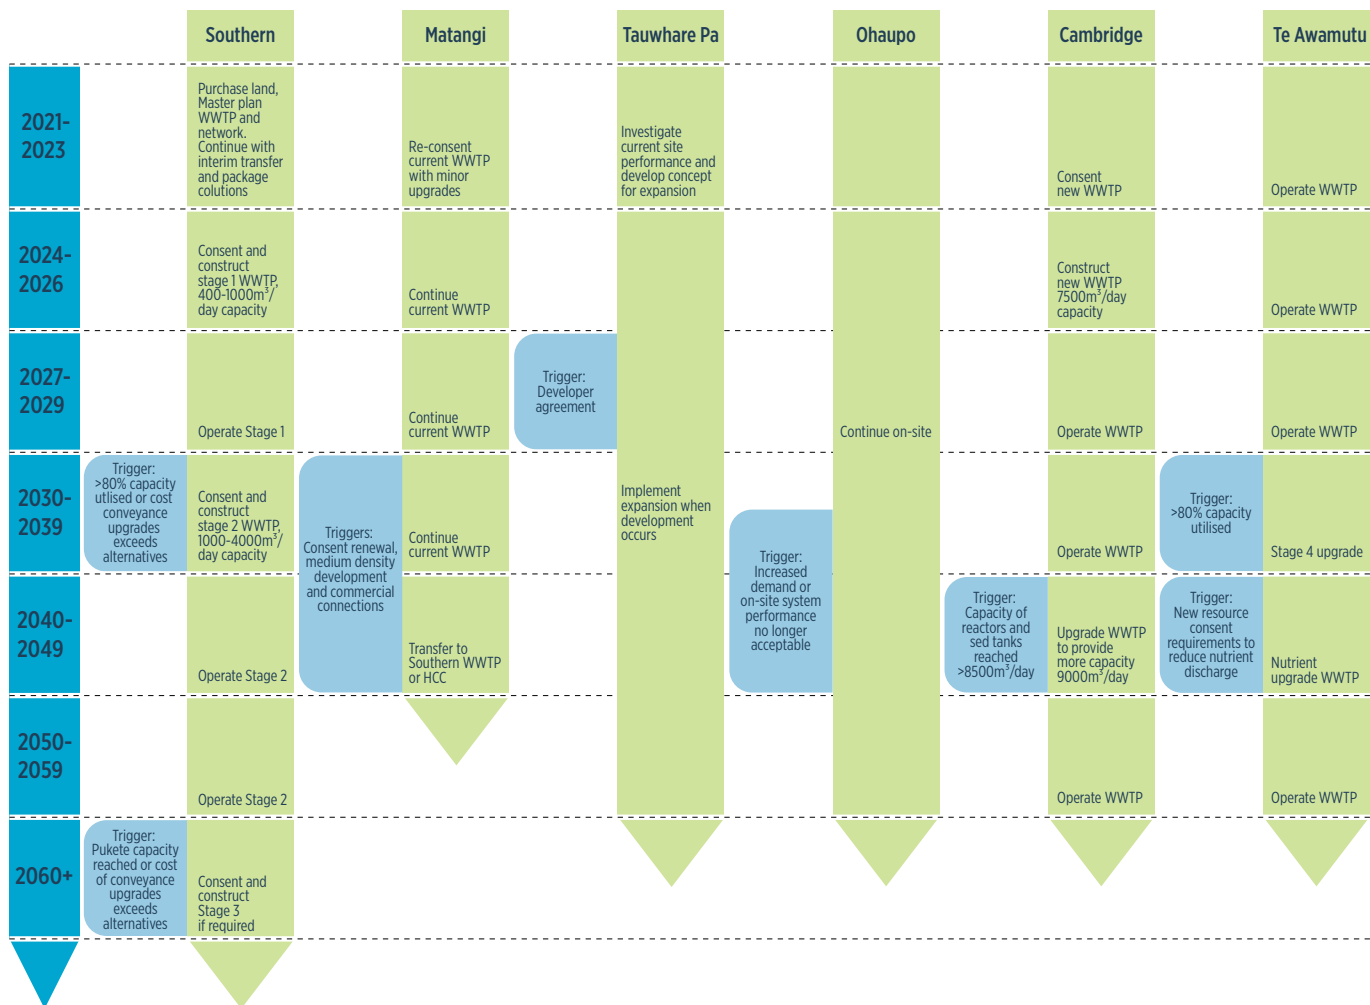

Master Planning

Master planning requirements for the new Southern Sub-Regional WWTP will typically include development of the following to a pre-concept design level. That is the basic size and location of the unit processes expected to be included in the ultimate development of the site:

- Hydraulic grade line.
- Process horizontal and vertical sizing, layout and anticipated staging.
- Vehicle circulation and utilities/process pipe corridors.
- Ultimate utility requirements (electricity, water, gas, communications, stormwater, operator facilities).
- Preferences for redundancy.
- Seismic risk management.
- Biosolids management.
- Buffers and conceptual planting plan for odour, noise and visual mitigation.
- Conveyance corridor alignments and design


Recommended investigations and design refinement

For the Preferred Option further investigation and design is recommended as follows:

- Geotechnical investigations for Cambridge WWTP and Southern Sub-Regional WWTP.
- Review of redundancy requirements for major process units e.g. screens and reactors.
- Investigation of biosolids reuse and disposal options.
- Offsetting and consenting options.
- Further investigation of sustainability and capital/operational carbon footprint.
- Further refinement of capital, operational and present value analysis.
- Master planning for Cambridge and Southern Sub-Regional WWTP sites.

Commercial Case

He Keehi tauhokohoko –
haha ratonga me te whai kirimana

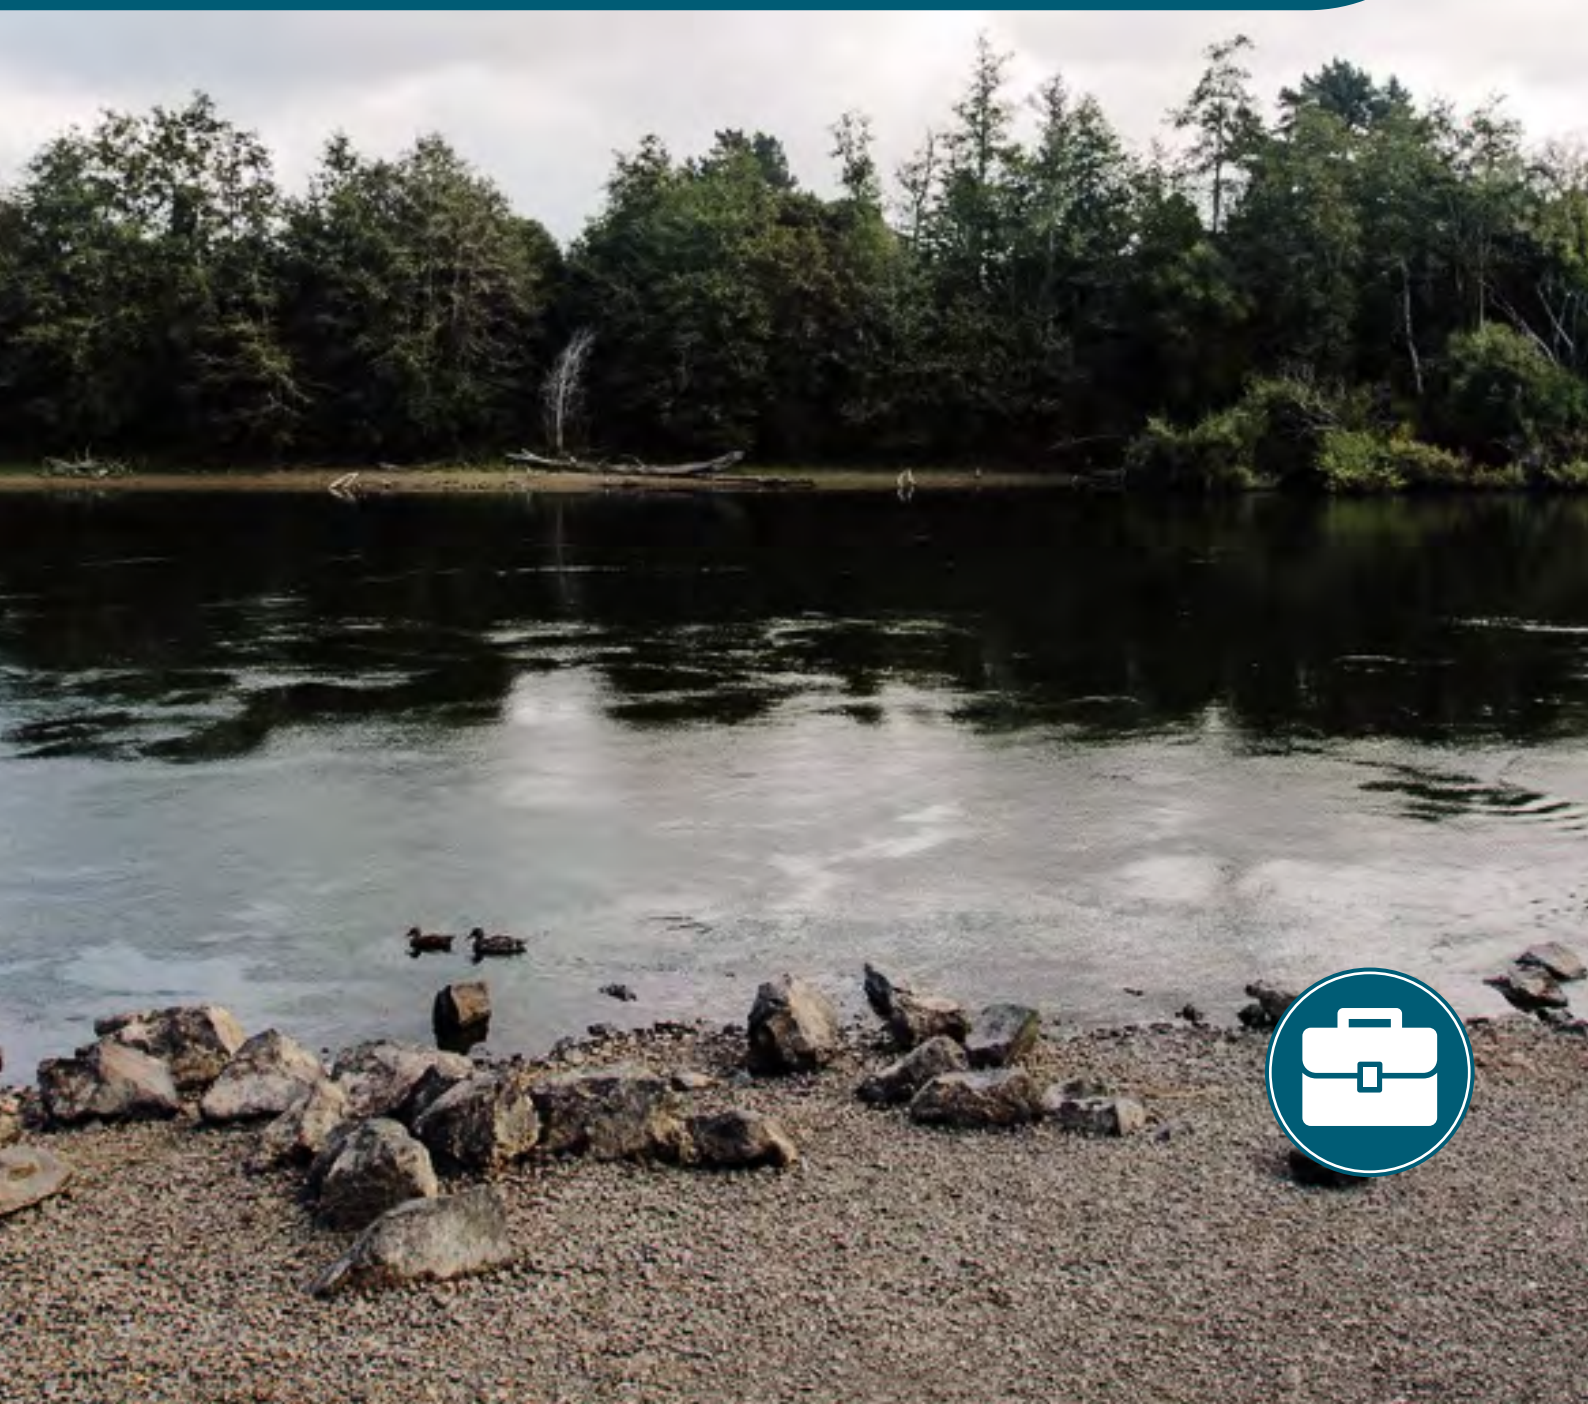

Commercial Case Contents

<i>1. Introduction</i>	<i>143</i>
1.1 Project Definition	143
1.2 Scope	144
1.3 Procurement Rules	144
1.3.1 NZ Government Procurement Rules	144
1.3.2 HCC Procurement Methodology	144
1.3.3 Waipā DC Procurement Policy and Manual	144
1.3.4. Waikato DC Procurement Policy	145
1.4 The Procurement Strategy	146
1.4.1 Commercial Strategy	146
1.4.2 Methodology	146
1.4.3 Project Attributes	147
1.4.4 Market Feedback	148
1.4.5 Evaluation Criteria	150
1.4.6 Approach to MCA Scoring: Short List to Preferred Option	151
1.4.7 Packaging Options Long List (Delivery Phase)	153
1.4.8 Contracting Model Long List	154
1.4.9 Southern WWTP Packaging and Contracting Options Assessment	155
1.4.10 Cambridge WWTP Packaging and Contracting Options Assessment	160
1.4.11 Other WWTP Upgrades Packaging and Contracting Options Assessment	165
1.5 The Procurement Plan	168
1.6 Required Outputs and Service Streams	170
1.7 Potential for Risk Sharing	170
1.8 Payment Mechanisms	172
1.9 Contractual and Other Issues	172
1.9.1 Type of Contract	172
1.9.2 Contract Management	173
1.9.3 Accountancy Treatment	173

Figures

<i>Figure CC - 1:</i>	<i>Procurement strategy methodology</i>	<i>146</i>
<i>Figure CC - 2:</i>	<i>Approach to MCA Scoring.....</i>	<i>151</i>
<i>Figure CC - 3:</i>	<i>Scoring definitions.....</i>	<i>152</i>
<i>Figure CC - 4:</i>	<i>Packaging options long list – Southern WWTP</i>	<i>153</i>
<i>Figure CC - 5:</i>	<i>Packaging options long list – Cambridge WWTP and other WWTP upgrades.....</i>	<i>154</i>
<i>Figure CC - 6:</i>	<i>Contracting options long list.....</i>	<i>154</i>
<i>Figure CC - 7:</i>	<i>Packaging long list to short list results – Southern.....</i>	<i>155</i>
<i>Figure CC - 8:</i>	<i>Contracting long list to short list results – Southern WWTP plant works package.....</i>	<i>157</i>
<i>Figure CC - 9:</i>	<i>Contracting long list to short list results – Southern WWTP conveyance package</i>	<i>158</i>
<i>Figure CC - 10:</i>	<i>Preferred Packaging and Contracting options – Southern WWTP</i>	<i>159</i>
<i>Figure CC - 11:</i>	<i>Packaging long list to short list results – Cambridge WWTP.....</i>	<i>160</i>
<i>Figure CC - 12:</i>	<i>Contracting long list to short list results – Cambridge WWTP enabling works package.....</i>	<i>162</i>
<i>Figure CC - 13:</i>	<i>Contracting long list to short list results – Cambridge WWTP plant works package.....</i>	<i>163</i>
<i>Figure CC - 14:</i>	<i>Preferred Packaging and Contracting options – Cambridge WWTP..</i>	<i>164</i>
<i>Figure CC - 15:</i>	<i>Packaging long list to short list results – Other WWTP upgrades.....</i>	<i>165</i>
<i>Figure CC - 16:</i>	<i>Contracting long list to short list results – Other WWTP upgrades plant works package.....</i>	<i>166</i>
<i>Figure CC - 17:</i>	<i>Preferred Packaging and Contracting options – WWTP upgrades.....</i>	<i>168</i>
<i>Figure CC - 18:</i>	<i>Financing and cross boundary servicing arrangements</i>	<i>173</i>

Tables

<i>Table CC - 1:</i>	<i>Project definition.....</i>	<i>143</i>
<i>Table CC - 2:</i>	<i>Project attributes</i>	<i>147</i>
<i>Table CC - 3:</i>	<i>Market feedback.....</i>	<i>148</i>
<i>Table CC - 4:</i>	<i>Multi criteria analysis.....</i>	<i>150</i>
<i>Table CC - 5:</i>	<i>Packaging option MCA sub criteria.....</i>	<i>151</i>
<i>Table CC - 6:</i>	<i>Contracting Model MCA sub criteria - Southern WWTP and WWTP upgrades.....</i>	<i>152</i>
<i>Table CC - 7:</i>	<i>Contracting Model MCA sub criteria - Cambridge WWTP.....</i>	<i>152</i>
<i>Table CC - 8:</i>	<i>Packaging options long list to short list assessment - Southern WWTP.....</i>	<i>155</i>
<i>Table CC - 9:</i>	<i>Packaging MCA scoring outcome - Southern WWTP.....</i>	<i>156</i>
<i>Table CC - 10:</i>	<i>Contracting options long list to short list assessment - Southern WWTP plant works package.....</i>	<i>157</i>
<i>Table CC - 11:</i>	<i>Contracting options long list to short list assessment - Southern WWTP conveyance package.....</i>	<i>158</i>
<i>Table CC - 12:</i>	<i>Contracting MCA scoring outcome - Southern WWTP plant works package.....</i>	<i>159</i>
<i>Table CC - 13:</i>	<i>Packaging options long list to short list assessment - Cambridge WWTP.....</i>	<i>160</i>
<i>Table CC - 14:</i>	<i>Packaging MCA scoring outcome - Cambridge WWTP.....</i>	<i>161</i>
<i>Table CC - 15:</i>	<i>Contracting options long list to short list assessment - Cambridge WWTP enabling works package.....</i>	<i>162</i>
<i>Table CC - 16:</i>	<i>Contracting options long list to short list assessment - Cambridge WWTP plant works package.....</i>	<i>163</i>
<i>Table CC - 17:</i>	<i>Contracting MCA scoring outcome - Cambridge WWTP plant works package.....</i>	<i>164</i>
<i>Table CC - 18:</i>	<i>Packaging options long list to short list assessment - Other WWTP upgrades.....</i>	<i>165</i>
<i>Table CC - 19:</i>	<i>Contracting options long list to short list assessment - Other WWTP upgrades plant works package.....</i>	<i>166</i>
<i>Table CC - 20:</i>	<i>Contracting MCA scoring outcome - Te Awamutu plant works package.....</i>	<i>167</i>
<i>Table CC - 21:</i>	<i>Contracting MCA scoring outcome - Mātangi and Tauwhare Pā plant works package.....</i>	<i>167</i>
<i>Table CC - 22:</i>	<i>Southern WWTP - Indicative procurement timeline.....</i>	<i>169</i>
<i>Table CC - 23:</i>	<i>Cambridge WWTP - Indicative procurement timeline.....</i>	<i>169</i>
<i>Table CC - 24:</i>	<i>Risk allocation table</i>	<i>170</i>

1. Introduction

This document sets out the Commercial Case for the Waikato Southern Metro Wastewater Treatment Detailed Business Case (DBC).

The purpose of the Commercial Case is to demonstrate that the preferred option will result in a viable procurement and a well-structured deal between the public sector and its service providers.

The Commercial Case considers the approach to packaging and contracting options, the procurement plan, potential for risk sharing and the planned contractual arrangements.

1.1 Project Definition

The preferred option comprises a programme of WWTP upgrades, conveyance works and the construction of two new WWTPs across the wider Waikato-Hamilton Waipā Metro Area. A detailed description of the preferred option is included in Economic Case Section [5 Preferred Option] and an overview is provided below:

Table CC - 1: Project definition

Project	Description
Southern Sub-regional Plant (Southern WWTP)	<p>Construction of a new WWTP to service the Waikato Regional Airport (the Airport) industrial precinct, Mātangi and southern Hamilton. The WWTP is expected to be located between Rukuhia and the Airport and will be delivered in three stages to align to the estimated demand. Initially, the WWTP will discharge to land, but will discharge into the Waikato River once stage two triggers are reached. An overview of the recommended staged development is provided below:</p> <ul style="list-style-type: none"> • Stage one: Construction of a bespoke WWTP consisting of a sequencing batch reactor (SBR) with discharge to land (8-10 ha). Starting flow of 400 m³/day with capacity up to 1,200 m³/day. Thickened sludge is to be transferred to Cambridge WWTP. • Stage two: Convert SBR WWTP into a membrane bioreactor (MBR) WWTP with discharge to river. Starting flow of 1,200 m³/day, with capacity up to 15,000 m³/day. A sludge processing facility and limited operator facilities will be constructed onsite. • Stage three: Large-scale MBR WWTP >15,000 m³/day with discharge to river. The plant will be upgraded to include energy recovery. <p>HCC is proposed to deliver this project as the Lead Council (see Management Case Section [1.2.2 Project Management Arrangements]).</p>
Cambridge WWTP	<p>Construction of a new WWTP at Cambridge with discharge to the Waikato River. Waipā District Council (Waipā DC) is proposed to deliver this project as the Lead Council (see Management Case Section [1.2.2 Project Management Arrangements]). The plant will have a starting flow of 5,000m³/day with capacity up to 11,700m³/day.</p>
Te Awamutu Upgrades	<p>Upgrades at Te Awamutu/Kihikihi WWTP, which will continue to discharge via rock channel to the Mangapiko Stream. Waipā DC is proposed to deliver this project as the Lead Council (see Management Case Section [1.2.2 Project Management Arrangements]).</p>
Mātangi and Tauwhare Pā Upgrades	<p>Improvements to the existing Mātangi WWTP, which will remain online until the wastewater is conveyed to the Southern WWTP or HCC network around 2040. Upgrades to the existing Tauwhare Pā WWTP, which discharges to land. Waikato District Council (Waikato DC) is proposed to deliver this project as the Lead Council (see Management Case Section [1.2.2 Project Management Arrangements]).</p>

1.2 Scope

The scope of the Commercial Case is to identify, assess and determine the preferred procurement approach for each of the Projects outlined above. Each project will be evaluated on a standalone basis. The procurement scope for the Southern WWTP will focus on stage one, with consideration given to the implications of moving directly to Stage two.

1.3 Procurement Rules

1.3.1 NZ Government Procurement Rules

Local Government Agencies are encouraged to follow the Government Procurement Rules.

The Government Procurement Rules support sustainable and inclusive procurement through the promotion of good practice for procurement planning, approaching the supplier community and contracting.

The Procurement Strategy should align with The Principles of Government Procurement and seek to meet as many of the Charter expectations as possible.

Relevant rules include those relating to open advertising, improving New Zealand business involvement, contributing to social outcomes, and providing sufficient time for tendering.

1.3.2 HCC Procurement Methodology

HCC's Procurement Methodology will apply to the Southern WWTP. The guidelines for appointing suppliers are outlined below:

- **Direct appointments:** Where there is no price tension to be gained through the tender process and the total cost of the works is less than \$100,000, works are required to be procured through direct appointments.
- **Public request for quote:** For physical works or procurement of assets of a value between \$10,000 and \$100,000, three quotes must be evaluated using this method, in accordance with HCC Procurement Policy.
- **Public request for tender:** For works or procurement of assets over \$100,000, the request for tender method must be used in accordance with HCC Procurement Policy.

The Southern WWTP stage one capital costs will be in excess of \$100,000, hence a public request for tender will be required under HCC's Procurement Policy.

1.3.3 Waipā DC Procurement Policy and Manual

Waipā DC's Procurement Policy and Manual will apply to the Cambridge WWTP and Te Awamutu upgrades. The guidelines for appointing suppliers are outlined below:

- Procurement under \$50,000 and considered low or medium risk requires:
 - One quote where a preferred supplier is utilised or spend is under \$20,000; or
 - Two quotes where a non-preferred supplier and spend is over \$20,000; or
 - For up to \$5,000 a purchase order can be used.
- Procurement between \$50,000 and \$250,000 and considered either low or medium risk requires:
 - Three quotes; or
 - A public (open) or invited request for tender process to be used as signed off in the procurement plan.

¹ The packaging options refer to the level of disaggregation of works used to deliver the Project (i.e. the degree to which each Project is split into separate work packages for tendering). The contracting model refers to the contracting method used to tender for the capital works and operations.

- Procurement over \$250,000, or any high-risk procurement regardless of dollar value requires:
 - a public or invited request for tender process, as signed off in the procurement plan.

The Cambridge WWTP and Te Awamutu upgrade capital costs will be in excess of \$250,000, hence a public or invited request for tender will be required under Waipā DC's Procurement Policy and Manual.

1.3.4. Waikato DC Procurement Policy

Waikato DC's Procurement Policy will apply to the Mātangi and Tauwhare Pā upgrades. The guidelines for appointing suppliers are outlined below:

- Procurement of less than \$50,000 and a low to medium risk level requires:
 - Single quote in writing where an existing supplier exists, or
 - Two quotes in writing where there is no existing supplier arrangement for the goods and services.
 - Services engaged via electronic purchase order or appropriate minor physical works contract.
- Procurement of \$50,000 to \$250,000 and a low to medium risk level requires:
 - A light procurement plan
 - Three written quotes required, or
 - Public or invited request for tender process where identified in the procurement plan.
 - Services engaged via contract.
- Procurement of over \$250,000 and any high-risk level procurement regardless of dollar value:
 - Full procurement plan required.
 - Single or multi-stage request for tender process as identified in the procurement plan.
 - Open procurement process required.
 - Services engaged via contract.

The Mātangi and Tauwhare Pā upgrades capital costs will be in excess of \$250,000, hence a public or invited request for tender will be required under Waikato DC's Procurement Policy and Manual.

1.4 The Procurement Strategy


1.4.1 Commercial Strategy

The Projects within the wider Programme of works will be delivered by a single council on behalf of the other Sub-regional Partners (the “Lead Council”). The Lead Council will utilise its existing resources, policies and procedures to deliver the Project. The Lead Council structure is discussed in the Management Case Section [1.2.2 Project Management Arrangements].

1.4.2 Methodology

The procurement strategy documents the process of identifying, evaluating and determining the preferred packaging and contracting options for each Project included in the Programme. The methodology for selecting the preferred option used an iterative process, where the long lists were objectively filtered to a short list and preferred option based on MCA. An overview of the process is outlined below:

Figure CC - 1: Procurement strategy methodology

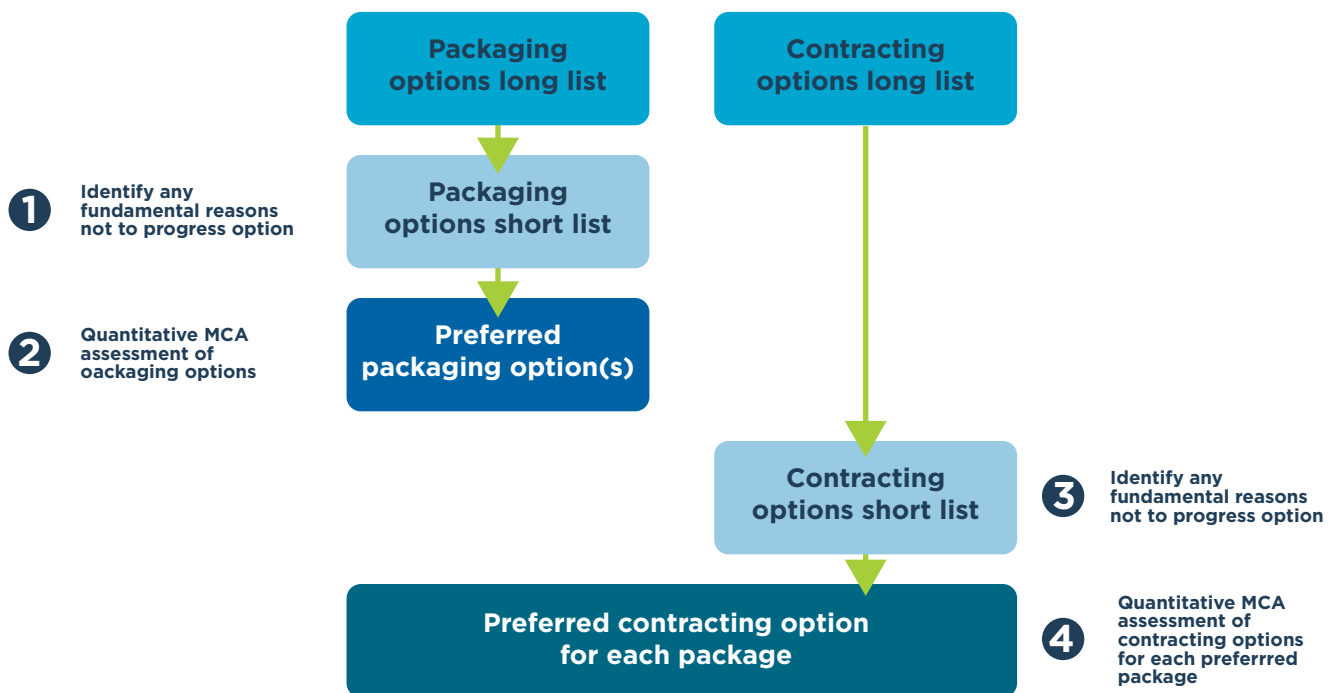

1. The long list of packaging options was initially filtered to a short list by removing any flawed options.
2. The short list of packaging options was then refined to a preferred option using MCA scoring.
3. A short list of contracting options was assessed for each preferred package of works.
4. The short list was then refined to a preferred contracting option using MCA scoring. The MCA scoring is further discussed under Section [1.3.6 Approach to MCA Scoring].

Throughout the development and assessment process, engagement and workshops were undertaken with the Sub-regional Partners. This included staff at each organisation, the DBC Control Group and the DBC Governance Group.

The procurement strategy is discussed within the Commercial Case rather than as a separate document. As discussed in Section 1.4 The Procurement Plan2, Lead Council's will prepare a separate Procurement Plan for each Project.

1.4.3 Project Attributes

Table CC - 2: Project attributes

Project	Attributes
Southern WWTP	<ul style="list-style-type: none"> • Size: At Stage one, the WWTP will be small to medium size (starting flow of 400 m³/day with capacity up to 1,200 m³/day). By stage three, the WWTP will be medium to large size (flow of >15,000 m³/day). • Complexity: Stage one will likely involve relatively straight forward treatment processes. However, it will be designed to be compatible with stages two and three, which will require more bespoke design work than a typical plant of this size. The site will need to be appropriately master planned to support the staged upgrade and to provide an overall plant hydraulic design that is future proofed. • Integration risk: The plant will be on a greenfield site with no integration risk with existing operations. New conveyancing will be necessary to connect the plant with the existing wastewater network. The site acquired for the WWTP will include the land for discharge. The discharge systems, including transfer pipe, are expected to be procured with the main plant works. Land acquisition and consenting risk is assumed to sit with the Lead Council. • Timing: Delivery of stage one of the project has short time frames driven by growing servicing needs at the airport precinct. There is expected to be sufficient time to plan and deliver the project; however interim servicing solutions will be required to meet the needs of the airport precinct while stage one is being delivered. The timing of future staging will be based on demand.
Cambridge WWTP	<ul style="list-style-type: none"> • Size: The WWTP is expected to be of medium / large size (starting flow 6,800 m³/day up to 11,700 m³/day). • Complexity: It is likely some bespoke process equipment will be required. • Integration risk: The WWTP will be located on a brownfield site adjacent to the existing Cambridge WWTP. There will be significant integration risks with the existing WWTP. No significant additional conveyancing is required over and above what would be needed to service the Cambridge area. • Timing: The project has short time frames driven by the consenting conditions.
Te Awamutu Upgrades	<ul style="list-style-type: none"> • Size and complexity: The WWTP is expected to be of medium / large size (starting flow 5,600 m³/day up to 7,200 m³/day). Future demand will be serviced through upgrades to the existing WWTP. The upgrades will encompass some design work that smaller contractors may not have the necessary resource or skills to undertake. • Integration risk: The works are brownfield in nature, resulting in integration risk. • Timing: The WWTP has recently been upgraded. A further upgrade will be required to meet demand. There is expected to be sufficient time to plan and deliver the upgrades.
Mātangi and Tauwhare Pā Upgrades	<ul style="list-style-type: none"> • Size and complexity: More likely to be a straightforward package plant or a duplication of existing technology. This means smaller contractors may be capable of undertaking the design work. • Integration risk: The works are brownfield in nature, resulting in integration risk. • Timing: Mātangi requires immediate upgrades to address existing performance issues and support renewal of the existing consent. There is expected to be enough time to plan and deliver these immediate and longer- term upgrades.

1.4.4 Market Feedback

A process of targeted market feedback and industry consultation was undertaken to assess market appetite, capacity and capability. Relevant projects were also reviewed to identify lessons learned and key procurement risks. Participants included civil contractors, process equipment suppliers, operations and maintenance providers, engineering firms and potential investors.

References to small, medium and large plants in the market feedback are based on the following indicative ranges:

- Small: flows of 800m³/day – 1,000m³/day (4,000-5,000 population equivalent)
- Medium: flows of 1,000m³/day – 8,000m³/day (5,000-40,000 population equivalent)
- Large: flows of greater than 8,000m³/day (greater than 40,000 population equivalent)

The key findings are summarised below:

Table CC - 3: Market feedback

Area of feedback	Description
Packaging – Scope for disaggregation	<ul style="list-style-type: none"> • Based on comparable projects, the scope for disaggregation into separate work packages could include: <ul style="list-style-type: none"> • Enabling works • Main plant civil works • Treatment systems • Conveyancing
Packaging – Market capacity and capability	<ul style="list-style-type: none"> • Larger civil contractors in New Zealand have appetite to deliver the new WWTPs as the main contractor, while international water companies are more interested in the design and equipment supply. • There is strong local market capability from smaller contractors to deliver the enabling works and conveyance components. • General feedback was that it would be inefficient to package the conveyance component with the main plant works due to the different risk profiles and contractor skill sets. • For smaller WWTPs a separate enabling works package would not provide significant schedule benefits and would likely be too small to efficiently tender separately. • For larger WWTPs it may be worthwhile to package the technical systems and civil works separately. This would allow direct sourcing of specific process equipment, which can avoid mark-up by the lead contractor and has the potential to provide a schedule benefit (direct sourcing of process equipment with long lead times can be faster). • For a small to mid-sized WWTP, it is generally not considered worthwhile to package the process equipment contracts and civil works separately because the higher tender costs would outweigh the benefits.
Packaging – Interface risk	<ul style="list-style-type: none"> • The key interface risk for a new WWTP is between the civil works and the treatment systems, which generally gets more significant as the plant gets larger. • The interface risk between the conveyance network and the WWTP is reasonably modest but depends on the load conditions and any process guarantees. It is important the assumptions made upfront are well understood and there is a clearly defined take or give point that is a reasonable distance from the civil works. • A separate enabling works contract can create interface risk, depending on what is included in the scope of works. Ground preparation can be a big risk given the main contractor is reliant on building on it. • Having different network operators could lead to inter-operability issues. Ideally, it is not preferable to have the conveyance network split between different operators.
Packaging – Cost	<ul style="list-style-type: none"> • Generally, costs are likely to be cheaper with separate packages. A single package may result in contractors pricing for risks they are not comfortable with, which often results in mark-ups on subcontracts / equipment. • However, separate tender processes will result in higher aggregate tender costs.

Area of feedback	Description
Contracting - Transfer of design risk	<ul style="list-style-type: none"> • In general, the design risk for smaller WWTPs is straightforward (“off the shelf”) and can be readily accepted by contractors in New Zealand. • A medium sized WWTP will have more bespoke design requirements. New Zealand contractors may be less willing to tender for these elements, given they typically don’t have the necessary resources or skills to undertake this degree of design work. • A medium sized plant would be unlikely to have sufficient scale to attract larger contractors which would have the resources to undertake this type of design work. • Larger WWTPs are likely to be of a sufficient scale to attract larger contractors with the appropriate design expertise. • In general, it is preferable for the public sector to retain design risk for high risk items; the rigour of using your own design team is important. • When transferring design risk, it can take a long time to negotiate contractual terms. Retention of design work in the wastewater industry tends to be the quickest option.
Contracting - Alliance	<ul style="list-style-type: none"> • Alliance often works well when there are uncertain risks or very short timeframes. • Alliances often have higher overheads for the Lead Council, given the additional complexity and administration in managing the contract.
Contracting - Transfer of operating risk	<ul style="list-style-type: none"> • Larger contractors generally have appetite and expertise to take operating risk, assuming there is sufficient scale to justify resourcing the project. • The transfer of operating risk as part of the initial tender can be beneficial because it incentivises a whole-of-life approach (operating costs can be 10-20 times the cost of the plant over the project life). However, sufficient scale is needed to attract operators to tender. • Consideration needs to be given as to whether Lead Councils would be comfortable having a third party operate the asset. • Tendering operating risk will add time to the procurement process.
Contracting - Transfer of financing risk	<ul style="list-style-type: none"> • Contractors generally had a low appetite for financing risk in relation to WWTP development.
Contracting - Private provision	<ul style="list-style-type: none"> • Some participants have considered private provision of wastewater assets previously. However, these projects have generally not proceeded because ownership of the asset and corresponding debt recognition is often retained by councils (as these models are unlikely to achieve off balance sheet treatment).







1.4.5 Evaluation Criteria

The MCA evaluation criteria used to refine the options were developed based on:

- Precedent transactions: Criteria have been developed with consideration given to learnings from other comparable projects.
- Stakeholder input: Workshopping with key stakeholders was undertaken to ensure that all interests were appropriately considered in the development of the preferred option.
- Applicability: The criteria needed to ensure options were effectively evaluated and were applicable to the proposed long lists.
- Wider objectives and criteria: Where relevant, the criteria reflect the investment objectives and KPIs of the DBC (See Strategic Case Section [3.3 Investment Objectives]).

The criteria that have been used and how they are applied to the options development process in the Commercial Case are outlined below:


Table CC - 4: Multi criteria analysis

Criteria	Description and application to Commercial Case options
 <p>Customer/Social Outcomes Option considers the wider impacts on stakeholders and environment</p>	<p>The extent to which the commercial options provide optimised operational outcomes, promoting whole-of-life considerations including where possible Waikato river quality and improved use and recovery of resources. Does the contracting model promote innovation in design and construction approaches.</p>
 <p>Timing and Budget Confidence Option delivers a high degree of confidence in project timing and budget</p>	<p>The extent to which the commercial options provide confidence for project timing and budget. Assessment of the degree of fixed price and date certainty in the contracting model as well as the overall delivery timeframes based on procurement strategy and packaging. Consideration of the degree of confidence that the commercial model provides for contractors to undertake the works within the agreed budget.</p>
 <p>Deliverability Option does not have significant barriers to implementation</p>	<p>The extent to which the commercial options will be implementable. Are there significant barriers to progressing with the option, i.e. is there significant consultation required, a significant administrative process / burden or significant community or political opposition to a particular delivery model or structure.</p>
 <p>Risk Allocation and Management Option allocates risks appropriately to the parties best able to manage them</p>	<p>The extent to which the commercial option appropriately allocates risk. Making sure that risks are allocated to the party best capable of managing them and that the risk transfer is real and not just perceived. Where risk is transferred to contractors or other parties under a commercial delivery structure or contracting model they have to be capable of managing the risk and face the financial implications of not doing so.</p>
 <p>Market Interest & Capability Option facilitates private sector interest and delivers a high level of competition</p>	<p>The extent to which the commercial options will optimise market interest in the project, improving competition and contestability and therefore driving value for money. Facilitating the involvement of potential project partners with appropriate skill and capacity by optimising the size and scale of packages, complexity of the options and attracting the necessary market expertise.</p>
 <p>Flexibility Option is flexible to changes in scope of works and sector structural changes</p>	<p>The extent to which the commercial options can accommodate unexpected changes to scope and / or specification of the treatment plant during delivery, as well as wider structural and regulatory changes within the sector. This includes changes that could arise from the Government's Three Waters Reform programme. The extent to which the commercial options accommodate the use of a broad range of funding and financing options.</p>

1.4.6 Approach to MCA Scoring: Short List to Preferred Option

An overview of the approach to the MCA scoring process is outlined below:

Figure CC - 2: Approach to MCA Scoring

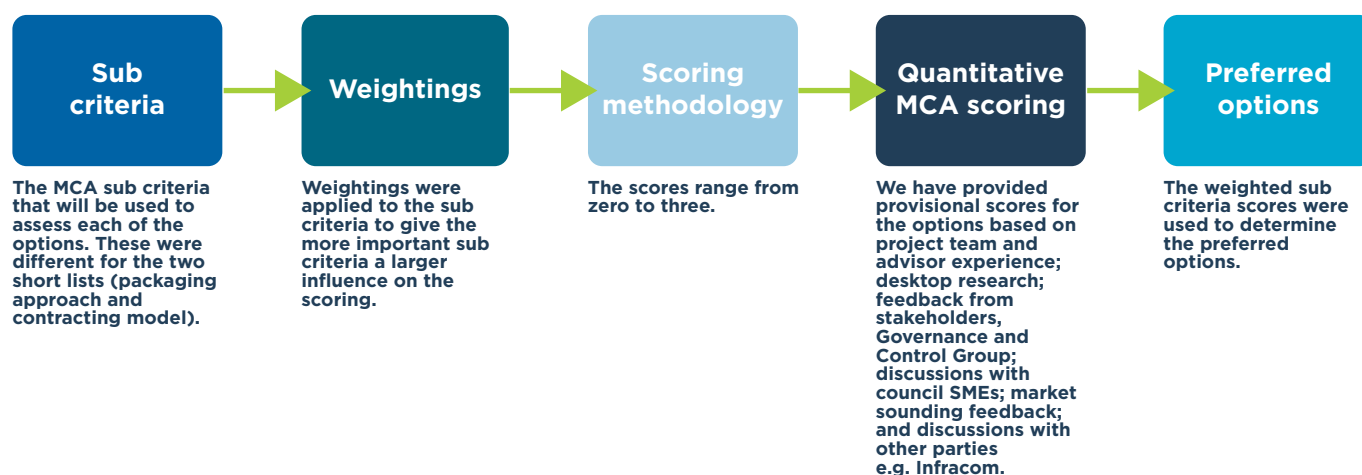

The high-level MCA criteria discussed above were broken down into different sub-criteria for each short list (both packaging and contracting options). Weightings were applied to each of the sub-criteria to capture their relative importance. Sub-criteria that were deemed to be relatively more important than others were given a higher rating. Different weightings were utilised for the Cambridge WWTP to reflect the importance of timing for this project. The sub-criteria, weights and scoring definitions for the packaging and contracting model options are outlined below:

Table CC - 5: Packaging option MCA sub criteria

Packaging - MCA Sub Criteria		
MCA	Sub Criteria	Weight
Customer/social outcomes	Facilitation of innovative approach to design and delivery	5%
	Opportunities for local SME suppliers to be involved in the delivery of services	5%
	Affordability considerations - level of mark up on subcontracts	10%
Timing and budget confidence	Level of confidence in timing and budget for the project	10%
Deliverability	Administrative burden on delivery entity	15%
Risk allocation and management	Level of project interface risk that resides with council	20%
Market interest and capability	Ability for councils to choose preferred contractors for each activity	10%
	Attractiveness to large domestic and international contractors (bringing economies of scale and specialist skills)	5%
	Competitiveness of procurement process	5%
Flexibility	Flexibility to align packages with the right contracting model for specific risks and skills	10%
	Flexibility and ease of making changes in scope	5%
Total		100%

Table CC - 6: Contracting Model MCA sub criteria - Southern WWTP and WWTP upgrades

Contracting Model MCA sub criteria – Southern WWTP and WWTP upgrades		
MCA	Sub Criteria	Weight
Customer/social outcomes	Maximisation of whole of life outcomes	10%
	Facilitation of innovative approach to design and delivery	5%
	Affordability considerations - transaction / procurement cost	5%
Timing and budget confidence	Speed to market of procurement process	5%
	Degree of contractual time and budget certainty for project delivery	10%
Deliverability	Administrative burden on delivery entity	5%
	Political risk	5%
Risk allocation and management	Risks allocated to the party best able to manage them	20%
Market interest and capability	Market depth and contractor appetite	10%
	Degree of market capability	10%
Flexibility	Ability to include large degree of staging / scaling in the project	5%
	Ability to make changes in scope	5%
	Flexibility to future state and ease to unwind if necessary	5%
Total		100%

Table CC - 7: Contracting Model MCA sub criteria - Cambridge WWTP

Contracting Model MCA sub criteria – Cambridge WWTP		
MCA	Sub Criteria	Weight
Customer/social outcomes	Maximisation of whole of life outcomes	10%
	Facilitation of innovative approach to design and delivery	5%
	Affordability considerations - transaction / procurement cost	5%
Timing and budget confidence	Speed to market of procurement process	5%
	Degree of contractual time and budget certainty for project delivery	10%
Deliverability	Political risk	5%
	Risks allocated to the party best able to manage them	5%
Risk allocation and management	Market depth and contractor appetite	15%
Market interest and capability	Degree of market capability	5%
	Ability to include large degree of staging / scaling in the project	10%
Flexibility	Ability to make changes in scope	5%
	Flexibility to future state and ease to unwind if necessary	5%
	Flexibility to future state and ease to unwind if necessary	5%
Total		100%

Figure CC - 3: Scoring definitions

Score	
3	Significant positive impact compared with other options over time
2	Moderate positive impact compared with other options over time
1	Minor positive impact compared with other options over time
0	Very limited to no positive or negative impact (neutral) over time

1.4.7 Packaging Options Long List (Delivery Phase)

The potential opportunities to break the scope of works into separate individual work packages for the new wastewater treatment plants (new Southern WWTP and the Cambridge WWTP) are presented below:

- **Enabling works:** Site preparation works that could take place prior to the main construction contract. This could include site clearance, geotechnical investigations, ground works, site access and provision of utilities to site.
- **Main WWTP facility works:** The main construction contract that would include civil engineering, construction of the plant, discharge transfer pipes and land application system (where relevant). This would cover general construction work carried out in relation to preparation of foundations, roads, canals, ponds, control buildings, fences etc.
- **Process equipment:** Supply and installation of the equipment for mechanical, chemical and biological wastewater treatment.
- **Conveyancing network:** The construction of the new conveyance network required to connect the plant to the existing network. This will involve the construction of pipes, pumps and tanks. This is not relevant to the Cambridge WWTP because there are no significant additional conveyancing requirements.

The inclusion of operations and maintenance components in the delivery phase packages was considered in the contracting model section below.

The long list of packaging options for the Southern WWTP includes five combinations of these different packages as below:

Figure CC - 4: Packaging options long list – Southern WWTP

Southern WWTP packaging options				
Disaggregated	Single package	Plant works together	Civils and process equipment separate	Enabling works and conveyancing separate
Enabling works	All works procured together as one package	Plant works together	Civils	Enabling works
Main WWTP facility works			Process equipment separate	Facility works and process equipment together
Process equipment		Conveyancing separate	Conveyancing separate	Conveyancing separate
Conveyancing network				

The long list of packaging options for the Cambridge WWTP and the WWTP upgrades is the same as the Southern WWTP but excludes the conveyancing package. The Cambridge WWTP and other WWTP upgrades have therefore been grouped together for the purposes of presenting the long list of packaging options. This results in four combinations of the different packages as below:

Figure CC - 5: Packaging options long list – Cambridge WWTP and other WWTP upgrades

Cambridge WWTP and WWTP upgrades packaging options			
Disaggregated	Single package	Process equipment separate	Enabling works separate
Enabling works	All works procured together as one package	Civils	Enabling works
Main WWTP facility works			Facility works and process equipment together
Process equipment		Process equipment separate	

The advantages and disadvantages for each of the packaging options are included in Appendix H.

1.4.8 Contracting Model Long List

Contracting options have been developed based on New Zealand procurement guidelines and previous comparable transactions. The long list of contracting options and a brief description of each option is outlined below. These are used consistently across the different packages and projects.

Figure CC - 6: Contracting options long list

Contracting model	Description
Construction only (traditional)	Private contractor is contracted to develop the facility. All design work is completed prior to the tender and a detailed specification is provided to bidders. Financing is managed by the procuring entity.
Design and build (D&B)	Private contractor is responsible for design and construction. Procuring entity will prepare the functional and technical performance requirements that are used in the tender process to guide developer design. Financing is managed by the procuring entity.
Managing contractor	Single managing contractor engages with the procuring entity and undertakes the procurement process on its behalf. The managing contractor enters into a contractual arrangement for each of the proposed packages.
Alliance	Collaborative model that will bring together the procuring entity and other parties, including contractors and designers, to deliver a 'best for project' outcome. Pain / gain share arrangements where costs below and above target are shared between parties.
Design, build, operate and maintain (DBOM)	Private contractor is responsible for design and construction as well as long-term operation and maintenance services. The procuring entity secures the financing independently and retains operating demand risk.
Design, build, finance, operate and maintain (DBFOM)	Concession style arrangement where responsibilities for designing, building, financing, operating and maintaining are bundled together and transferred to a private sector consortium. This model is similar to a number of PPPs that have been completed in NZ with a large degree of risk transfer passed to the private sector.
Private provision	Development of the facility is outcomes based with the private sector engaged to provide all aspects of work including design, construction, operation and maintenance. The private sector also takes responsibility for approvals and management. The procuring entity would use the facility under a service agreement.

The advantages and disadvantages for each of the contracting options are included in Appendix H. Where the contracting option transfers the operating risk (DBOM, DBFOM and private provision) it is assumed the third party would be responsible for achieving consent compliance.

1.4.9 Southern WWTP Packaging and Contracting Options Assessment

The following section steps through the packaging and contracting long list to preferred option process for the Southern WWTP.

The packaging long list to short list assessment is provided below:

Table CC - 8: Packaging options long list to short list assessment – Southern WWTP

Packaging approach	Reasons for not progressing to shortlist	Progressed to short list
Disaggregated	<ul style="list-style-type: none"> Council would retain responsibility for managing interface risk for all project elements with no single point of responsibility. Enhanced administration and management costs. Increased tender costs for separate procurement processes. The project is likely to be too small to justify a separate early works package. Timetable savings from early works package are less important given the sufficient time available to deliver the project. 	No
Single package	<ul style="list-style-type: none"> A single package provides the lowest level of interface risk, however the different skill set required and risk profile between the WWTP works and conveyancing works may mean it is inappropriate to group them together. This option was progressed for further evaluation. 	Yes
Plant works together and conveyancing separate	<ul style="list-style-type: none"> Size of the package is not expected to limit participation and complexity of procurement is considered manageable. 	Yes
Civils, process equipment and conveyancing separate	<ul style="list-style-type: none"> Separate civils and process equipment packages would result in the Lead Council having to manage greater interface risk and increased contract administration, management costs and tender costs. This option was progressed for further evaluation of how material this would be for a plant of this size. 	Yes
Enabling works and conveyancing separate	<ul style="list-style-type: none"> A separate enabling works package would result in council having to manage greater interface risk and will increase contract administration, management costs and tender costs. The project is likely to be too small to justify a separate early works package. 	No

Based on the long list to short list assessment, the following packaging options were short listed:

Figure CC - 7: Packaging long list to short list results – Southern

Southern WWTP Packaging Options				
Disaggregated	Single package	Plant works together	Civils and process equipment separate	Enabling works and conveyancing separate
Enabling works	All works procured together as one package	Plant works together	Civils	Enabling works
Main WWTP facility works			Process equipment separate	Facility works and process equipment together
Process equipment		Conveyancing separate	Conveyancing separate	Conveyancing separate
Conveyancing network				
X	✓	✓	✓	X

✓ = Progressed to shortlist X = Not progressed to shortlist

WWTPMCA scoring was undertaken for the three shortlisted packaging options. A summary of the results is provided below, with the full analysis is provided in Appendix I.

Table CC - 9: Packaging MCA scoring outcome – Southern WWTP

Southern WWTP Packaging - Scoring Outcome				
	Combined Weighting	Weighted Scores		
		Single Package	Plant works together and conveyancing separate	Civils, process equipment and conveyancing separate
Customer / social outcomes	20%	0.10	0.25	0.30
Timing and budget confidence	10%	0.20	0.20	0.10
Deliverability	15%	0.45	0.30	0.15
Risk allocation and management	20%	0.60	0.40	0.20
Market interest and capability	20%	0.05	0.20	0.30
Flexibility	15%	0.05	0.15	0.20
Total	100%	1.45	1.50	1.25

Based on the weighted scoring, the “Plant works together and conveyancing separate” is the preferred option. The primary drivers of this outcome are discussed below:

- **Deliverability:** The higher level of aggregation inherent in the “plant works together and conveyancing separate” option provides less ongoing administration for the Lead Council relative to the more disaggregated approach.
- **Risk allocation and management:** The scoring reflects the level of interface risk that resides with the Lead Council which is higher where there are more packages and therefore interfaces between them. This is most significant for the civil works and treatment systems packages. The “plant works together and conveyancing separate” option outperforms the more disaggregated model in this regard. The interface risk between the plant and the conveyancing is considered modest and is limited to:
 - construction timing mismatches between the conveyance and the plant; and
 - interfaces at the point of connection.
- **Timing and budget confidence:** The scoring reflects the higher tender and administration costs of running two separate tender processes for process equipment and civils. This is not worthwhile for a small to medium size plant without complex process equipment.
- **Market interest and capability:** Procuring the conveyancing with the main WWTP works is considered inappropriate because of the different contractor skill set required and different risk profile of the assets. It is beneficial to be able to tender these packages separately and select the preferred contracting model for each package.

The contracting option long list to short list process for each of the preferred packages (plant works and conveyancing) is provided on the next page.

Table CC - 10: Contracting options long list to short list assessment – Southern WWTP plant works package

Plant Works		
Contracting model	Reasons for not progressing to shortlist	Progressed to short list
1. Construction only	• N/A	Yes
2. D&B	• N/A	Yes
3. Managing contractor	<ul style="list-style-type: none"> • The use of a managing contractor is only applicable to a disaggregated approach which has not been progressed to the shortlist. • This approach is only applicable for complex plant procurement. • An additional management fee would apply. 	No
4. Alliance	<ul style="list-style-type: none"> • The risks that would traditionally be transferred to the private sector are relatively well understood and accepted - reducing the effectiveness and value for money of a pain-share / gain-share arrangement. • An alliance is unlikely to deliver cost and timing certainty. • This approach would require significant resourcing from the Lead Council in terms of governance and management. • Complexity in establishment that is not justified given smaller scale of works. 	No
5. DBOM	• N/A	Yes
6. DBFOM	<ul style="list-style-type: none"> • Small / medium size of plant does not justify higher tender and transaction costs. • Unlikely to be market appetite for a PPP style transaction of this size. • Financing provided by private sector (likely to be more expensive than the NZ Local Government Funding Agency). • It would be difficult to change scope during delivery or deliver the works in stages. 	No
7. Private provision	<ul style="list-style-type: none"> • Small / medium size of plant unlikely to provide / market appetite from private providers - private provision requires sufficient scale to be feasible. • Implicit financing cost (likely to be more expensive than the NZ Local Government Funding Agency). • Low control of asset for the Lead Council. • Difficult to change scope during delivery. 	No

Based on this assessment, the following options were short listed:

Figure CC - 8: Contracting long list to short list results – Southern WWTP plant works package

Southern WWTP Contracting Options - Plant Works						
Construction only	D&B	Managing contractor	Alliance	DBOM	DBFOM	Private provision
✓	✓	X	X	✓	X	X

✓ = Progressed to shortlist X = Not progressed to shortlist

Table CC - 11: Contracting options long list to short list assessment – Southern WWTP conveyance package

Conveyancing Package		
Contracting model	Reasons for not progressing to shortlist	Progressed to short list
1. Construction only	<ul style="list-style-type: none"> N/A 	Yes
2. D&B	<ul style="list-style-type: none"> Conveyance pipelines carry toxic substances, travel through public and private land, have a 50-80 year life and are a huge task to pull up if changes need to be made. It is best to have the rigour of your own engineers designing conveyance assets, rather than under a tender process where contractors are looking to minimise cost. In this instance, transfer of design risk is not appropriate. 	No
3. Managing contractor	<ul style="list-style-type: none"> Only applicable for complex procurement (i.e. where there are multiple packages and / or a high degree of interface risk to manage), not suitable for conveyance. An additional management fee would apply. 	No
4. Alliance	<ul style="list-style-type: none"> Only applicable for complex procurement where there is a high degree of uncertainty, not suitable for conveyance. The risks that would traditionally be transferred to the private sector are relatively well understood and accepted - reducing the effectiveness and value for money of a pain-share / gain-share arrangement. 	No
5. DBOM	<ul style="list-style-type: none"> Councils already maintain (or have external contracts to maintain) the conveyance network and this is not material enough for a stand alone operator. 	No
6. DBFOM	<ul style="list-style-type: none"> The size of conveyance works does not justify the higher tender and transaction costs. There is unlikely to be market appetite for a PPP style transaction of this size. The financing that is provided by private sector is likely to be more expensive than the NZ Local Government Funding Agency). Difficult to change scope or stage during delivery. 	No
7. Private provision	<ul style="list-style-type: none"> Size of conveyance works unlikely to provide market appetite from private providers - private provision requires sufficient scale to be feasible. Implicit financing cost (likely to be more expensive than NZ Local Government Funding Agency). Low control of asset for councils. Difficulty to change scope during delivery. 	No

Based on the assessment, the following options as short listed:

Figure CC - 9: Contracting long list to short list results – Southern WWTP conveyance package

Southern WWTP Contracting Options - Conveyancing						
Construction only	D&B	Managing contractor	Alliance	DBOM	DBFOM	Private provision
✓	X	X	X	X	X	X

✓ = Progressed to shortlist X = Not progressed to shortlist

MCA scoring was undertaken for the three shortlisted contracting options for the plant works package. A summary of the results is provided below, with the full analysis provided in Appendix I. There is no requirement to undertake an MCA scoring process for the conveyancing package because there was only one contracting option shortlisted.

Table CC - 12: Contracting MCA scoring outcome - Southern WWTP plant works package

Southern WWTP Packaging - Scoring Outcome				
	Combined Weighting	Weighted Scores		
		Construction only	D&B	DBOM
Customer / social outcomes	20%	0.20	0.15	0.30
Timing and budget confidence	15%	0.25	0.25	0.25
Deliverability	10%	0.15	0.20	0.20
Risk allocation and management	20%	0.40	0.00	0.00
Market interest and capability	20%	0.50	0.30	0.10
Flexibility	15%	0.25	0.10	0.05
Total	100%	1.75	1.00	0.90

Based on the weighted scoring, the Construction only contracting model was preferred for the plant works package. The primary drivers of this outcome are discussed below:

- **Risk allocation and management:** The risk allocation inherent in the Construction only model is preferred because the market is unlikely to accept design risk. This is because of the bespoke nature of the design work required to ensure the plant is compatible with stages two and three.
- **Market interest and capability:** As above, the market is unlikely to accept the transfer of design risk. Further, the additional bid costs associated with a D&B or DBOM contracting model may discourage contractors from tendering.
- **Flexibility:** Construction only is a more straightforward procurement option to tender multiple stages over time. Given the importance of future proofing the WWTP for stages two and three, control over the full design is likely to be more critical. Accordingly, the Lead Council may be better placed to undertake design activities.

Based on this assessment, the following contracting options were preferred for the Southern WWTP:

Figure CC - 10: Preferred Packaging and Contracting options - Southern WWTP

Southern WWTP



Moving directly to stage two for the Southern WWTP would not require material changes to the procurement strategy, given it reflects design requirements compatible with stages two and three.

Given the short time frames for stage one of the Southern WWTP driven by growing servicing needs at the airport precinct, it is recommended to proceed with the procurement of professional services to assist with delivery of the pre-implementation tasks. These include:

- Site selection.
- Land acquisition.
- Designations and consenting.
- Engagement.

The Lead Council's internal procurement systems are expected to be adopted for the scale of this work. This would likely involve the appointment of a single lead consultant (with appropriate sub-consultants to complement their team) to complete the site selection and investigation processes. That work would then inform the land acquisition strategy and preliminary plant design, consenting and engagement activities.

The land acquisition strategy is expected to be implemented alongside the airport property team.

In parallel with land acquisition activities, it is recommended the work needed to support the designation and consenting processes commence. A lead consultant (with an appropriate team) is expected to be appointed to manage and deliver this package of work including site master planning, process design, interfacing with incoming conveyance systems, enabling works (transport assessments, utilities etc), land discharge/irrigation system design, landscape architecture design, engagement (as needed), and preparation of the applications. More accurate cost estimates would also be needed for budgeting and funding request purposes. The above work would be sufficient to inform the EOI documentation. Detailed design and preparation of tender documents would be completed following confirmation of consents and funding

1.4.10 Cambridge WWTP Packaging and Contracting Options Assessment

The packaging long list to short list assessment is provided below:

Table CC - 13: Packaging options long list to short list assessment – Cambridge WWTP

Packaging approach	Reasons for not progressing to shortlist	Progressed to short list
Disaggregated	<ul style="list-style-type: none"> Council would retain responsibility for managing interface risk for all project elements with no single point of responsibility. Enhanced administration and management costs. Increased tender costs for separate procurement processes. 	No
Single package	<ul style="list-style-type: none"> A single package provides the lowest level of interface risk, however the different skill set required and risk profile between the WWTP works and conveyancing works may mean it is inappropriate to group them together. This option was progressed for further evaluation. 	Yes
Process equipment separate	<ul style="list-style-type: none"> Separate civils and process equipment packages would result in the Lead Council having to manage greater interface risk and will increase contract administration, management costs and tender costs. This option was progressed for further evaluation of how material this would be for a plant of this size. 	Yes
Enabling works separate	<ul style="list-style-type: none"> A separate enabling works package would result in council having to manage greater interface risk and will increase contract administration, management costs and tender costs. However, we have progressed because there is potential for the enabling ground works at Cambridge to be a bottleneck if not dealt with separately. This is particularly relevant given the time pressure faced to deliver the plant. 	Yes

Based on this assessment, the following options were short listed:

Figure CC - 11: Packaging long list to short list results – Cambridge WWTP

Cambridge WWTP packaging options			
Disaggregated	Single package	Process equipment separate	Enabling works separate
Enabling works	All works procured together as one package	Civils	Enabling works
Main WWTP facility works			Facility works and process equipment together
Process equipment		Process equipment separate	
X	✓	✓	✓

✓ = Progressed to shortlist X = Not progressed to shortlist

MCA scoring was undertaken for the four shortlisted packaging options. A summary of the results is provided below, with the full analysis provided in Appendix I.

Table CC - 14: Packaging MCA scoring outcome - Cambridge WWTP

Cambridge WWTP Packaging - Scoring Outcome				
	Combined Weighting	Weighted Scores		
		Single package	Process equipment separate	Enabling works separate
Customer / social outcomes	20%	0.10	0.40	0.35
Timing and budget confidence	10%	0.20	0.20	0.30
Deliverability	15%	0.45	0.15	0.15
Risk allocation and management	20%	0.60	-	0.40
Market interest and capability	20%	0.05	0.40	0.20
Flexibility	15%	0.05	0.20	0.20
Total	100%	1.45	1.35	1.60

Based on the weighted scoring, the “Enabling works separate” is the preferred option. The primary drivers of this outcome are discussed below:

- **Customer / social outcomes:** The separate enabling works contract provides greater opportunity for local contractor participation.
- **Timing and budget confidence:** Packaging the enabling works separately scores highly because it provides scope to begin the groundworks in advance of the main plant works contract. The enabling works would otherwise have the potential to delay the main works. This is more important for the Cambridge WWTP than the Southern WWTP given the larger size, its brownfield nature and the consenting time constraints.
- **Risk allocation and management:** The scoring reflects the level of interface risk between the main plant works and process equipment packages. This becomes more important as the plant gets larger and the process equipment is more bespoke. This creates more interface points, more feedback loops, larger technical process units and therefore higher risk costs associated with supporting the civil works.

The contracting option long list to short list for each of the preferred packages is provided below:

Table CC - 15: Contracting options long list to short list assessment – Cambridge WWTP enabling works package

Enabling works package		
Contracting model	Reasons for not progressing to shortlist	Progressed to short list
1. Construction only	• N/A	Yes
2. D&B	• There is no stand alone design requirement for the enabling works, therefore this approach is not appropriate.	No
3. Managing contractor	• This approach is only applicable for complex procurement (i.e. where there are multiple packages and / or a high degree of interface risk to manage), not suitable for enabling works. • An additional management fee would apply.	No
4. Alliance	• Only applicable for complex procurement where there is a high degree of uncertainty, not suitable for enabling works. • The risks that would traditionally be transferred to the private sector are relatively well understood and accepted - reducing the effectiveness and value for money of a pain-share / gain-share arrangement.	No
5. DBOM	• No standalone operating or maintenance component for enabling works, therefore this approach is not appropriate.	No
6. DBFOM	• No standalone operating or maintenance component for enabling works, therefore this approach is not appropriate.	No
7. Private provision	• Private provision of enabling works is not applicable.	No

Based on this assessment the following option as short listed:

Figure CC - 12: Contracting long list to short list results – Cambridge WWTP enabling works package

Cambridge WWTP Contracting Options - Enabling Works						
Construction only	D&B	Managing contractor	Alliance	DBOM	DBFOM	Private provision
✓	X	X	X	X	X	X

✓ = Progressed to shortlist X = Not progressed to shortlist

Table CC - 16: Contracting options long list to short list assessment – Cambridge WWTP plant works package

Plant Works Package		
Contracting model	Reasons for not progressing to shortlist	Progressed to short list
1. Construction only	<ul style="list-style-type: none"> N/A 	Yes
2. D&B	<ul style="list-style-type: none"> N/A 	Yes
3. Managing contractor	<ul style="list-style-type: none"> Managing contractor only applicable to disaggregated approach which has not been progressed to shortlist. Only applicable for complex plant procurement. An additional management fee would apply. 	No
4. Alliance	<ul style="list-style-type: none"> The risks that would traditionally be transferred to the private sector are relatively well understood and accepted - reducing the effectiveness and value for money of a pain-share / gain-share arrangement. This approach is unlikely to deliver cost and timing certainty. This approach will require significant resourcing from the Lead Council in terms of governance and management 	No
5. DBOM	<ul style="list-style-type: none"> N/A 	Yes
6. DBFOM	<ul style="list-style-type: none"> The medium size of the plant does not justify the higher tender and transaction costs. There is unlikely to be market appetite for a PPP style transaction of this size. The financing provided by private sector (likely to be more expensive than the NZ Local Government Funding Agency). It would be difficult to change scope during delivery or deliver in stages. 	No
7. Private provision	<ul style="list-style-type: none"> The medium size of the plant is unlikely to provide market appetite from private providers - private provision requires sufficient scale to be feasible. The implicit financing cost is likely to be more expensive than the NZ Local Government Funding Agency. Low control of asset for Lead Council. It would be difficult to change scope during delivery. 	No

Based on this assessment the following options were short listed:

Figure CC - 13: Contracting long list to short list results – Cambridge WWTP plant works package

Cambridge WWTP Contracting Options - Plant Works						
Construction only	D&B	Managing contractor	Alliance	DBOM	DBFOM	Private provision
✓	✓	X	X	✓	X	X

✓ = Progressed to shortlist X = Not progressed to shortlist

MCA scoring has been undertaken for the three shortlisted contracting options relevant to the plant works package. A summary of the results is provided below, and the full analysis is provided in Appendix I. There is no requirement to undertake an MCA scoring process for the enabling works packages because only one contracting option was shortlisted.

Table CC - 17: Contracting MCA scoring outcome - Cambridge WWTP plant works package


Cambridge WWTP Packaging - Scoring Outcome				
	Combined Weighting	Weighted Scores		
		Construction only	D&B	DBOM
Customer / social outcomes	20%	0.20	0.15	0.30
Timing and budget confidence	25%	0.55	0.35	0.35
Deliverability	10%	0.15	0.20	0.20
Risk allocation and management	15%	0.15	0.00	0.15
Market interest and capability	15%	0.40	0.25	0.30
Flexibility	15%	0.25	0.10	0.05
Total	100%	1.70	1.05	1.35

Based on the weighted scoring, “Construction only” is the preferred contracting option for the main plant works. The primary drivers of this outcome are discussed below:

- **Timing and budget confidence:** Tender timeframes for “Construction only” are the most streamlined of the options considered, noting the design work required upfront. For the Cambridge WWTP, this is likely to be the fastest procurement option.
- **Market interest and capability:** There is likely to be more market interest in a “Construction only” contract than a D&B or DBOM for a medium size plant that has this degree of bespoke design work. Additionally, the higher contractor bid costs for D&B and DBOM may discourage bidders.
- **Flexibility:** “Construction only” is more straightforward to tender multiple contracts over time and the design can be varied with relative ease after the construction contract has been awarded, noting variation costs.

This results in the following preferred options for the Cambridge WWTP:

Figure CC - 14: Preferred Packaging and Contracting options - Cambridge WWTP

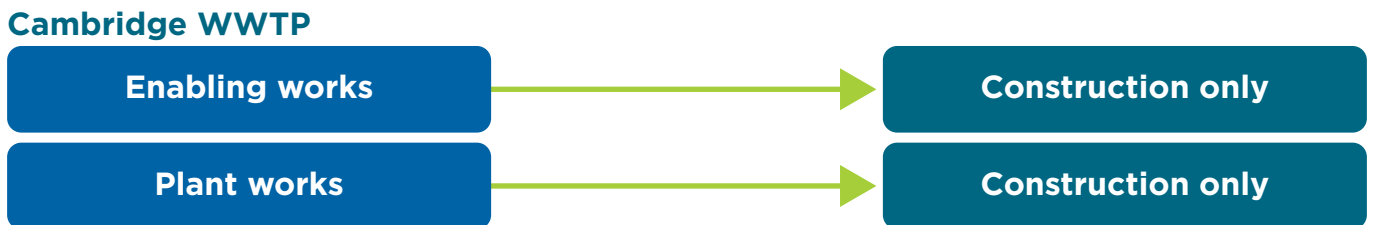

1.4.11 Other WWTP Upgrades Packaging and Contracting Options Assessment

The packaging long list to short list assessment for the other project WWTP (Mātangi, Tauwhare Pā and Te Awamutu) is provided below:

Table CC - 18: Packaging options long list to short list assessment – Other WWTP upgrades

Packaging approach	Reasons for not progressing to shortlist	Progressed to short list
Disaggregated	<ul style="list-style-type: none"> Brownfield nature of upgrades do not require enabling works. The small / medium scale of upgrades does not justify segregating civils and treatment systems. Tender costs for two procurement processes not justified. Council would retain responsibility for managing interface risk with no single point of responsibility. Enhanced administrative and management costs. Increased tender costs for separate procurement processes. 	No
Single package	<ul style="list-style-type: none"> No immediate reason for not progressing, the small / medium scale of the upgrades means single package most appropriate. 	Yes
Process equipment separate	<ul style="list-style-type: none"> The small / medium scale of upgrades does not justify segregating civils and treatment systems. 	No
Enabling works separate	<ul style="list-style-type: none"> A separate enabling works package would result in council having to manage greater interface risk and will increase contract administration, management costs and tender costs. These upgrades are likely to be too small to justify a separate early works package. Timetable savings from early works package are less important given the sufficient time available to deliver the projects. 	No

This results in only one packaging option being shortlisted:

Figure CC - 15: Packaging long list to short list results – Other WWTP upgrades

WWTP Upgrades - Packaging Options			
Disaggregated	Single package	Civils and process equipment separate	Enabling works separate
Enabling works	Plant works together	Civils	Enabling works
Main WWTP facility works		Process equipment separate	Facility works and process equipment together
Process equipment			
X	✓	X	X

✓ = Progressed to shortlist X = Not progressed to shortlist

The contracting option long list to short list for the “Plant works together” package is provided below:

Table CC - 19: Contracting options long list to short list assessment – Other WWTP upgrades plant works package

Contracting model	Reasons for not progressing to shortlist	Progressed to short list
1. Construction only	• N/A	Yes
2. D&B	• N/A	Yes
3. Managing contractor	<ul style="list-style-type: none"> • Simple nature of WWTP upgrades does not require managing contractor - no package disaggregation. Only applicable to complex procurement. • Additional management fee. 	No
4. Alliance	<ul style="list-style-type: none"> • Option 4A does not have a sufficient number of treatment plant upgrades of similar timing, scale, complexity and location to justify an ongoing relationship style procurement. • The risks that would traditionally be transferred to the private sector are relatively well understood and accepted - reducing the effectiveness and value for money of a pain-share / gain-share arrangement. • This option is unlikely to deliver cost and timing certainty. • Will require significant resourcing from the procuring entity in terms of governance and management. 	No
5. DBOM	• The brownfield nature of the plant means there is already an operator.	No
6. DBFOM	<ul style="list-style-type: none"> • The brownfield nature of the plant means there is already an operator. • The WWTP upgrades do not have the scale to absorb the higher transaction costs. • No market appetite for a PPP style transaction of this size. • Financing provided by private sector (likely to be more expensive than LGFA). • Difficult to change scope or stage during delivery. 	No
7. Private provision	• Private provision not applicable for brownfield plant upgrades.	No

This results in the following options being taken through to the short list:

Figure CC - 16: Contracting long list to short list results – Other WWTP upgrades plant works package

Contracting Options - Upgrade Works						
Construction only	D&B	Managing contractor	Alliance	DBOM	DBFOM	Private provision
✓	✓	✗	✗	✗	✗	✗

✓ = Progressed to shortlist ✗ = Not progressed to shortlist

The preferred contracting option was assessed independently for each of the other WWTP upgrade projects;

- Te Awamutu; and
- Mātangi and Tauwhare Pā

For the Te Awamutu WWTP upgrades, MCA scoring has been undertaken for the two shortlisted contracting options relevant to the plant works package. A summary of the results is provided below, and the full analysis is provided in Appendix I.

Table CC - 20: Contracting MCA scoring outcome - Te Awamutu plant works package

Te Awamutu Contracting Model - Scoring Outcome			
	Combined Weighting	Weighted Scores	
		Construction only	D&B
Customer / social outcomes	20%	0.20	0.15
Timing and budget confidence	15%	0.25	0.30
Deliverability	10%	0.15	0.20
Risk allocation and management	20%	0.60	0.00
Market interest and capability	20%	0.50	0.30
Flexibility	15%	0.25	0.10
Total	100%	1.95	1.05

The key drivers of the “Construction only” option scoring the highest are as follows:

- **Risk allocation and management:** “Construction only” is considered most appropriate for brownfield upgrades because there will be multiple complex interfaces with the existing plant. The Te Awamutu scope involves adding a new reactor and aeration system to the plant, smaller contractors may not be capable of accepting design risk on, while it is not of sufficient value for the larger contractors.
- **Market interest and capability:** Construction only scores better due to the strong capability of contractors in New Zealand which undertake works of this nature under a “Construction only” contract. The higher contractor bid costs for D&B may also discourage bidders.

For Mātangi and Tauwhare Pā, MCA scoring has been undertaken for the two shortlisted contracting options relevant to the plant works package. A summary of the results is provided below, and the full analysis is provided in Appendix I.

Table CC - 21: Contracting MCA scoring outcome - Mātangi and Tauwhare Pā plant works package

Tauwhare Pā Contracting Model - Scoring Outcome			
	Combined Weighting	Weighted Scores	
		Construction only	D&B
Customer / social outcomes	20%	0.20	0.15
Timing and budget confidence	15%	0.25	0.30
Deliverability	10%	0.15	0.20
Risk allocation and management	20%	0.00	0.40
Market interest and capability	20%	0.50	0.30
Flexibility	15%	0.25	0.10
Total	100%	1.35	1.45

The key drivers of the “D&B” option scoring the highest are as follows:

- **Risk allocation and management:** The Mātangi and Tauwhare Pā upgrades are likely to be a straightforward package-type plant or would duplicate existing technology. The design risk is likely to be well understood and it would be efficient for a D&B contractor to assume.

This results in the following preferred options for the WWTP upgrades:

Figure CC - 17: Preferred Packaging and Contracting options – WWTP upgrades

Te Awamutu Upgrades



Matangi and Tauwhare Pā Upgrades



1.5 The Procurement Plan

In line with the Procurement Rules outlined in Section [1.2 Procurement Rules], procurement for all the Projects will be undertaken through a competitive tender process. This will ensure market tension and drive value for money outcomes.

A detailed procurement plan will be prepared for each package of works within each Project by the relevant Lead Council before going to market. The proposed principles for the approach to the market, evaluation of offers and identification of the preferred supplier for all the Projects is outlined below:

- The procurement plan for each Project will use a two-stage procurement process with the first stage Expression of Interest (EOI) being publicly advertised through GETS, followed by a Request for Tender (RFT) being made available to the successful respondents. Once further design work has been undertaken, it may be worthwhile to consider using a one-stage process for the WWTP upgrades that are of a smaller scale.
- The EOI will be evaluated by a Pass/Fail score for the non-price attributes.
- The RFT stage will be evaluated using a Weighted Attribute Method² and will include extensive interaction with the respondents. The Weighted Attribute Method is a supplier selection method in which the preferred supplier meets the required outcomes set out in the RFT and provides the best value for money. A balanced decision is taken that weighs up the whole-of-life costs and/or non-financial attributes in addition to the up-front price. Under this method, the financial and non-financial attributes are defined and weighted to reflect their relative importance to achieving the stated outcome. Non-financial attributes are expected to consider overall methodologies including sustainability issues such as:
 - strategies to avoid unnecessary consumption and manage demand (such as reducing waste to landfill and achieving efficiencies on use of raw materials).
 - minimising environmental impacts and embedded carbon in the delivery of the goods/services over the life of the contract.
 - suppliers' socially responsible practices including compliance with legislative obligations to employees.
 - innovation around social procurement opportunities and meeting each Lead Council's social procurement targets and aspirations.
- The relevant procurement team and supporting advisers (where relevant) will undertake the description of attributes and assignment of weightings.
- A cross functional tender evaluation team will be established to evaluate the bids and recommend the preferred supplier. Team members will collectively have significant experience with evaluating contracts of this scale and complexity and operating under the principles of relevant procurement guidelines.
- An independent Probity Auditor will be appointed to shadow the tender process to ensure a transparent procurement process, ensure all parties are treated equitably and ensure potential third-party risks are managed proactively.

The proposed timeline for the procurement is as follows:

Table CC - 22: Southern WWTP - Indicative procurement timeline

Key Procurement Milestone (Stage 1 only)	Start Date	End Date
Pre-implementation activities: land acquisition, preliminary design, consenting and designation processes	November 2021	November 2023 (24 months to complete)
Detailed design, includes preparation EOI/RFT	November 2023	May 2024 (7 months to complete)
EOI released (main plant works and conveyancing)	April 2024 (Undertaken in parallel with detailed design)	May 2024 (2 months to complete)
RFT and award - main plant works	June 2024 (8 months after consent issued - assuming consent issued in October 2023)	September 2024 (Preferred contractor selected 4 months after RFT is released)
RFT and award - conveyancing	June 2024	Sept 2024
Construction	November 2024 (2 months after preferred contractor selected)	November 2025 (1-year construction period - excludes 2 months commissioning period)

Table CC - 23: Cambridge WWTP - Indicative procurement timeline

Key Project Milestone (Stage 1 Construction only)	Start Date	End Date
Pre - implementation		
RFT and award - enabling works	June 2022	August 2022 (2 -month procurement period)
Construction - enabling works	August 2022	December 2022 (4-month construction period)
RFT and award - main plant works	June 2023	October 2023 (4-month procurement period)
Construction - main plant works	October 2023	August 2025 (22-month construction period)
Commissioning	August 2025	January 2026 (5-month commissioning period)

1.6 Required Outputs and Service Streams

The specific required outputs for each of the individual procurements will be detailed by the Lead Council as part of the Procurement Plan.

Information on the technical attributes of the new WWTPs and the WWTP upgrades is discussed in the Economic Case Section [5 Preferred option]. This will continue to be refined as the individual projects are progressed through the detailed design phase by the Lead Councils.

The Projects anticipated to be delivered through a traditional “Construction only” contracting approach (Southern WWTP, Cambridge WWTP and the Te Awamutu upgrades) will engage technical consultants to undertake design work and prepare tender documentation prior to approaching the market. The Mātangi and Tauwhare Pā upgrades that will be delivered through a D&B contract will approach the market with a detailed output specification. The tender documentation will include the functional performance requirements of the upgrade works rather than prescriptive design specifications.

1.7 Potential for Risk Sharing

Key procurement risks have been identified, evaluated and recorded in the risk register (see Management Case Section [1.5 Risk Management Planning]).

An assessment of how the project proposes to apportion these risks between the public sector and potential providers is outlined in the risk allocation table below:

Table CC - 24: Risk allocation table

Potential Risk Allocation				
Project and Package	Risk Category	Lead Council	Supplier	Shared
Southern WWTP (Construction only) (Plant works and conveyancing packages)	Design risk	✓		
	Construction and development risk		✓	
	Transition and implementation risk			✓
	Performance risk		✓	
	Operating risk	✓		
	Interface risk (Plant works)		✓	
	Interface risk (Plant works and conveyance)	✓		
	Technology and obsolescence risks	✓		
	Financing risks	✓		
	Legislative risks	✓		

² <https://www.procurement.govt.nz/procurement/guide-to-procurement/plan-your-procurement/evaluation-methodology/>

Potential Risk Allocation				
Project and Package	Risk Category	Lead Council	Supplier	Shared
Cambridge WWTP Construction only) (Enabling works, plant works packages)	Design risk	✓		
	Construction and development risk		✓	
	Transition and implementation risk			✓
	Performance risk		✓	
	Operating risk	✓		
	Interface risk (Plant works)		✓	
	Interface risk (Enabling and Plant works)	✓		
	Technology and obsolescence risks	✓		
	Financing risks	✓		
	Legislative risks	✓		

Potential Risk Allocation				
Project and Package	Risk Category	Lead Council	Supplier	Shared
Te Awamutu Upgrades (Construction only) (Single package)	Design risk	✓		
	Construction and development risk		✓	
	Transition and implementation risk			✓
	Performance risk		✓	
	Operating risk	✓		
	Interface risk (Plant works)	✓		
	Technology and obsolescence risks	✓		
	Financing risks	✓		
	Legislative risks	✓		

Potential Risk Allocation				
Project and Package	Risk Category	Lead Council	Supplier	Shared
Mātangi and Tauwhare Pā Upgrades (D&B) (Single package)	Design risk		✓	
	Construction and development risk		✓	
	Transition and implementation risk			✓
	Performance risk		✓	
	Operating risk	✓		
	Interface risk (Plant works)	✓		
	Technology and obsolescence risks	✓		
	Financing risks	✓		
	Legislative risks	✓		

1.8 Payment Mechanisms

All payment mechanisms under the proposed procurements are expected to use a milestone payment methodology whereby contractor remuneration will be linked to agreed project milestones. Payment will be based on the supplier's successful completion of milestones as detailed in the contract.

1.9 Contractual and Other Issues

The planned contractual arrangements and key contractual issues relating to the procurement of the services and key outputs are outlined below:

1.9.1 Type of Contract

The Construction only contracts are proposed to be contracted using the New Zealand Standard form NZS 3910:2013.

The D&B contract is proposed to be contracted using the New Zealand standard form NZS 3916:2013.

These are both widely understood by councils in New Zealand and are well proven for projects such as these. Given the nature of wastewater assets and the importance of process commissioning at completion, these standard form contracts often undergo revisions to allow for these specific requirements. Alternative international contracts (e.g., New Engineering Contracts (NEC) or International Federation of Consulting Engineers (FIDIC)) can sometimes be better placed for wastewater construction. However, these are less widely used and understood in New Zealand.

Specific contractual arrangements including remedies, intellectual property rights, dispute arrangements and end of the contract options will be assessed by each Lead Council.

1.9.2 Contract Management


The responsibility for managing delivery under the contract as well as supplier relationship management will pass to the project manager at each Lead Council on the signing of the contract. This person will develop a contract and relationship management plan in consultation with the successful supplier.

1.9.3 Accountancy Treatment

The intended accountancy treatment is for the Lead Council to own the wastewater assets as an asset on their balance sheet. There is not anticipated to be any off-balance sheet treatment under the Construction only or D&B contracting structures. It is envisaged the assets underpinning delivery of the services will be on the balance sheet of the Lead Council.

As per the Financial Case Section [1.2.4 Preferred Funding and Financing Options] the Lead Council is expected to own and finance the delivery of the respective Projects. The Lead Council will enter into an agreement based on commercial terms for servicing of cross-boundary communities. These arrangements are summarised in the diagram below:

Figure CC - 18: Financing and cross boundary servicing arrangements

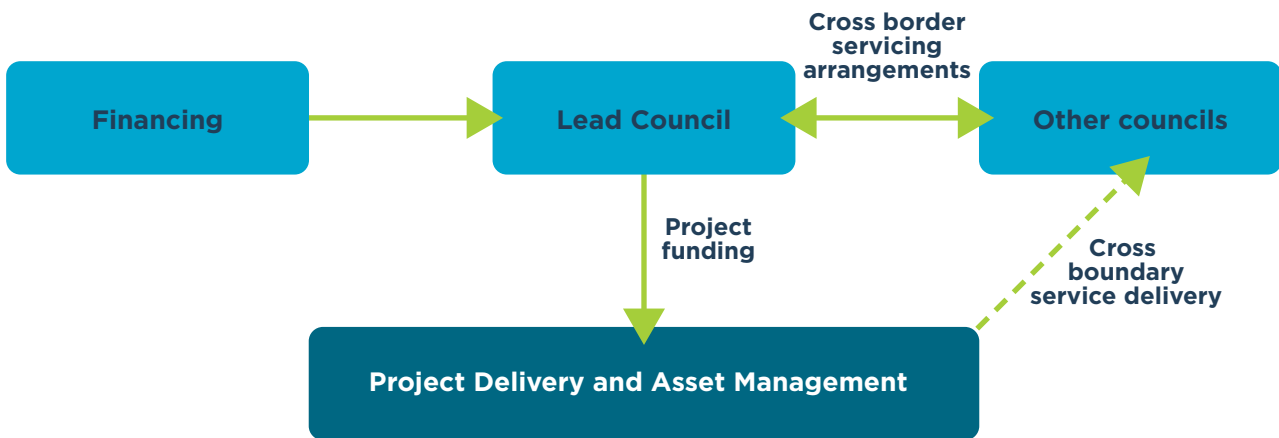

The Lead Council is anticipated to recognise an asset on its balance sheet as milestone payments are made in return for delivery of the services under the Construction only and D&B contracting options. There is not expected to be any off-balance sheet treatment under these contracting structures.

The Lead Council is anticipated to recognise a corresponding financial liability on its balance sheet as debt is drawn to finance the milestone payments.

Service agreements between councils that commit to funding obligations over time are likely to be treated as financial liabilities.

Financial Case

He Keehi taahua – puutea,
puuranga moni



Financial Case Contents

<i>1. Introduction, Project Definition and Scope</i>	<i>178</i>
1.1 Introduction	178
1.2 Project Definition	178
1.3 Scope	178
<i>2. Assumptions</i>	<i>179</i>
<i>3. Cost Analysis</i>	<i>181</i>
3.1 Capital (Delivery) Costs	181
3.2 Ongoing Costs	181
<i>4. Risks and Complexities</i>	<i>182</i>
<i>5. Cost Allocation</i>	<i>182</i>
5.1 Approach to Cost Allocation	182
5.2 Cost Allocation Methodology	183
5.3 Project Funding Responsibilities for Each Council	184
5.4 Funding Split for the Southern WWTP	185
5.5 Council Cost Allocation	186
<i>6. Lead Council Delivery Model</i>	<i>187</i>
6.1 Overview of the Lead Council Structure	187
6.2 Responsibilities	187
6.3 Service Agreement and Funding and Financing Flows	187
6.4 Project Lead Councils	188
<i>7. Funding and Financing</i>	<i>189</i>
7.1 Introduction and Overview	189
7.2 Approach	189
7.3 Long List of Options	190
7.4 Assessment Criteria	190
7.5 Evaluation and Short Listing of Options	191
7.6 Short List	193
7.7 Preferred Funding and Financing Solution	194
7.8 Potential Airport Involvement	194

8.1 Introduction and Overview	195
8.2 Ratepayer Affordability	195
8.3 Affordability of Development Contributions.....	196
8.4 Affordability for Councils.....	197

9.1 NPV Analysis.....	200
9.2 Debt Limit Sensitivities.....	201
9.3 Sub-regional Cost Allocation Approach	202
9.4 Alternative Financing Model.....	203

Figures

<i>Figure FC - 1: Funding and financing flows</i>	<i>188</i>
<i>Figure FC - 2: Funding and financing option long list to preferred option process..</i>	<i>189</i>
<i>Figure FC - 3: Long list of funding and financing options</i>	<i>190</i>
<i>Figure FC - 4: Forecast HCC debt to revenue ratio</i>	<i>198</i>
<i>Figure FC - 5: Forecast Waipā DC debt to revenue ratio.....</i>	<i>198</i>
<i>Figure FC - 6: Forecast Waikato DC debt to revenue ratio</i>	<i>199</i>
<i>Figure FC - 7: NPV sensitivity analysis</i>	<i>200</i>
<i>Figure FC - 8: HCC debt limit sensitivities.....</i>	<i>201</i>
<i>Figure FC - 9: Waipā DC debt limit sensitivities</i>	<i>201</i>
<i>Figure FC - 10: Waikato DC debt limit sensitivities.....</i>	<i>202</i>
<i>Figure FC - 11: Forecast HCC debt to revenue ratio</i>	<i>203</i>

Tables

<i>Table FC - 1:</i>	<i>Population equivalent forecasts across the wider Waikato-Hamilton Waipā Metro Area</i>	<i>180</i>
<i>Table FC - 2:</i>	<i>Capital (delivery) costs</i>	<i>181</i>
<i>Table FC - 3:</i>	<i>Ongoing costs summary</i>	<i>181</i>
<i>Table FC - 4:</i>	<i>Cost allocation methodology</i>	<i>183</i>
<i>Table FC - 5:</i>	<i>Council's contributing to each Project</i>	<i>184</i>
<i>Table FC - 6:</i>	<i>Cost allocation to Southern WWTP (pre-reuse calculations).....</i>	<i>185</i>
<i>Table FC - 6:</i>	<i>Cost allocation to Southern WWTP (pre-reuse calculations).....</i>	<i>185</i>
<i>Table FC - 7:</i>	<i>Council cost allocation</i>	<i>186</i>
<i>Table FC - 8:</i>	<i>Project Lead Councils.....</i>	<i>188</i>
<i>Table FC - 9:</i>	<i>Funding and financing assessment criteria.....</i>	<i>191</i>
<i>Table FC - 10:</i>	<i>Evaluation of funding options</i>	<i>192</i>
<i>Table FC - 11:</i>	<i>Evaluation of financing options</i>	<i>192</i>
<i>Table FC - 12:</i>	<i>Funding and financing short lists</i>	<i>193</i>
<i>Table FC - 13:</i>	<i>Preferred options - Current council funding and financing approaches</i>	<i>194</i>
<i>Table FC - 14:</i>	<i>Estimated rating impact</i>	<i>195</i>
<i>Table FC - 15:</i>	<i>High-level rates affordability assessment</i>	<i>195</i>
<i>Table FC - 16:</i>	<i>Estimated development contributions (per HUE of demand).....</i>	<i>197</i>
<i>Table FC - 17:</i>	<i>Subregional cost allocation approach.....</i>	<i>202</i>

1. Introduction, Project Definition and Scope

1.1 Introduction

This report sets out the Financial Case for the Waikato Southern Metro Wastewater Treatment DBC.

The purpose of the Financial Case is to set out the programme costs, funding requirements, and preferred funding and financing solutions.

1.2 Project Definition

The preferred option comprises the Programme of WWTP works across the wider Waikato-Hamilton Waipā Metro Area. The projects are outlined below:

Southern Sub-regional WWTP (Southern WWTP): Construction of a new WWTP to service the Waikato Regional Airport (the Airport) industrial precinct, Mātangi/Tamahere Hub and southern Hamilton. The WWTP is expected to be located between Rukuhia and the Airport and will be delivered in three stages to align to the estimated demand. Initially, the WWTP will discharge to land, but for the purposes of this DBC is assumed to involve a discharge into the Waikato River once stage two triggers are reached. The stages are summarised as:

- Stage 1: Initial build and development of WWTP to cover immediate requirements;
- Stage 2: Build base WWTP prior to 2041 to cater for Matangi and increased capacity for industrial growth and some wet industry; and
- Stage 3: Upgrade of Stage 2 assets to full service WWTP.

Cambridge WWTP: Construction of a new WWTP at Cambridge with discharge to the Waikato River to replace the existing plant. The plant will be located on the same site as the existing plant.

Te Awamutu upgrades: Upgrades to the existing plant at Te Awamutu, which will continue to discharge via rock channel to the Mangapiko Stream.

Mātangi and Tauwhare Pā upgrades: Improvements to the existing Mātangi WWTP, which will remain online until the wastewater is conveyed to the Southern WWTP or **Hamilton City Council (HCC)** network around 2040. Upgrades to the existing Tauwhare Pā WWTP, which discharges to land.

1.3 Scope

The scope of the Financial Case is to outline:

- The key underlying assumptions for the cost estimates.
- The capital (delivery), operating and periodic renewal costs for the Programme.
- The methodology for allocating costs between the councils.
- The assessment of potential funding and financing options and determination of the preferred funding and financing option.
- The affordability of the Programme for each of the councils and their ratepayers.

The Financial Case is solely focused on the preferred technical option. No financial analysis was undertaken on the other technical options discussed in the Economic Case.

The terms funding and financing are used throughout the Financial Case and are defined as follows:

- **Funding:** Refers to the mechanism that recovers the costs of the Programme across its life. Commonly used funding tools include targeted rates, developer contributions and negotiated contributions.
- **Financing:** Refers to the instrument used to pay for the cost of the capital requirements of the plant. The financing tools spread the cost burden over time to align with the funding of the Programme. The typical financing approach used by councils for assets of this nature is the use of Local Government Funding Agency (LGFA) borrowing.

2. Assumptions

The financial assessment included in the DBC is based on the following assumptions:

- Each project was designed to have a useful life of 80 years, with mechanical and electrical components requiring renewal within this period at 20 year intervals. Capital expenditure associated with renewals is provided for in the Programme operating costs. No allowance was included to refresh individual projects beyond their 80-year useful life.
- Local and trunk reticulation costs required to service development areas are not included in the financial assessment. These costs are typical infrastructure costs that arise from land development.
- Strategic conveyance infrastructure required to convey flows from specific communities to the Southern WWTP (i.e., Hamilton South, Mātangi/Tamahere) are included in the financial assessment.
- High level capital and operating costs are estimated for the preferred option based upon the rates observed in similar wastewater projects. All capital costs include allowances for investigations, design, procurement, and construction supervision.
- Based on discussions with councils, overhead and procurement costs incurred by the Lead Council are included at a rate of 8% and 2% of capital costs respectively.
- Conveyance operational costs for maintenance and operations are calculated as a fixed percentage of pump station capital cost with variable components for energy and specialty-controlled chemicals based on average annual flow.
- There is significant uncertainty over the timing of staged upgrades and when HCC will connect to the Southern WWTP. This analysis assumes Southern Hamilton / HCC connects in 2061. If HCC were to connect to the Southern WWTP earlier than 2061 the same principles would be applied however the population served would change and the allocation of costs would need to be revisited. The principles based approach taken includes the flexibility to adapt to changes in timing and population growth.
- The analysis in the DBC considers future costs only, no allowance for costs incurred to date is included (e.g. costs associated with the early design of the technical solution, development of this business case, and planning and scoping work).
- Assets are depreciated on a straight line basis with a useful life of between 20 and 80 years.
- Population forecasts were developed by NIDEA based on 2013 census data and updated by each of the councils to reflect the 2018 census data. The population forecasts have been used to inform the staging and sizing of the plants, and for cost allocation purposes. Further discussion on the population assumptions is included in the Growth Assumptions document (refer Economic Case Section [5.12 - Cost Estimates]). These assumptions include both municipal and wet-industrial wastewater flows. An overview of the population equivalent forecasts is provided in the table on the next page.

Table FC - 1: Population equivalent forecasts across the wider Waikato-Hamilton Waipā Metro Area

Population Equivalent Forecasts								
Area	Council	Serviced from	2021	2031	2041	2051	2061	2120
Taupiri	Waikato	Current	2,063	5,176	6,167	6,991	7,256	8,400
Ngaruawahia	Waikato	Current	6,234	7,407	9,102	10,516	12,016	21,991
Horotiu	Waikato	Current	1,815	6,778	10,390	13,996	14,156	14,156
Te Kowhai	Waikato	2031	35	1,301	1,685	2,095	2,371	4,706
Hamilton North	Hamilton	Current	237,642	288,590	306,351	356,325	391,330	600,703
Hamilton South	Hamilton	2061	29,630	36,573	46,511	54,723	59,626	103,633
Tauwhare Pa	Waikato	Current	140	619	619	619	619	889
Matangi	Waikato	2040 to Southern	140	464	464	464	464	1,035
Airport	Waipa	2025	1,377	4,000	6,000	17,852	17,852	17,852
Ohaupo	Waipa	Not serviced	547	630	814	1,025	1,031	1,100
Cambridge and Hautapu	Waipa	Current	22,520	32,940	37,801	42,892	45,031	57,649
Te Awamutu and Kihikihi	Waipa	Current	24,988	27,989	30,905	34,982	36,001	42,011

Serviced by Southern WWTP
Serviced by Cambridge WWTP
Serviced by Te Awamutu WWTP

- Financing costs are calculated using the LGFA's indicative borrowing rates (as at 30 June 2021) for the longest borrowing tenor (May 2037) and each of the relevant council's current credit ratings. The longest borrowing tenor was used to reflect a conservative estimate for borrowing costs, given the long length of the Programme. However, the expectation is that financing will be undertaken as part of the Lead Council's wider debt portfolio and treasury management, which is likely to have a significantly shorter borrowing tenor.
- Finance is assumed to amortise over the life of the asset with each council managing this through its 'business as usual' portfolio treasury and debt management.
- Development Contributions are calculated based on the forecast increase in Population Equivalents for each relevant area, as provided by each of the Sub-regional Councils.
- All dollars set out in this report are provided in real terms (today's dollars), unless stated otherwise. Inflation was not included in the forecasts. Cost estimates will be subject to significant cost inflation due to the length of the Programme.
- A real discount rate of 5% is used in the Net Present Value (NPV) analysis based on the Treasury's discounting methodology¹.
- For the purposes of calculating rating impacts and development contributions, it has been assumed that all beneficiaries for each council are responsible for funding their pro-rata share of total wastewater costs based on flows. That is to say, there is an assumption that trade waste users and households pay equivalent costs per unit of wastewater flow.

¹ <https://www.treasury.govt.nz/information-and-services/state-sector-leadership/guidance/financial-reporting-policies-and-guidance/discount-rates>

3. Cost Analysis

3.1 Capital (Delivery) Costs

The below capital costs were developed by Beca based on scope prepared by GHD and Beca for each project (Refer to section 8 of the Preferred Option Report appended to the Economic Case for a detailed breakdown of the costs). They are P50 cost estimates and include a 20-30% risk allowance on the capital costs². An allowance of 10% for procurement and Council overhead costs has been added to the capital cost estimates for inclusion in the economic and financial cases. P95 estimates have also been prepared and are included in Appendix L of the Preferred Option Report.

Table FC - 2: Capital (delivery) costs

Programme Capital Costs (\$000's, real)						
Project	2022-31	2032-41	2042-51	2052-61	2062-71	Total
Southern WWTP	29,900	40,260	16,500	150,150	-	236,810
Cambridge WWTP	115,720	4,290	6,050	10,780	-	136,840
Te Awamutu Upgrades	20,900	-	11,000	-	-	31,900
Mātangi WWTP Interim Upgrade	550	-	-	-	-	550
Tauwhare Pā WWTP upgrade	2,200	-	-	-	-	2,200
Total Capital Expenditure	169,270	44,550	33,550	160,930	-	408,300

3.2 Ongoing Costs

Operating and maintenance costs will be incurred once the new WWTPs are operational, and upgrades have been completed at the existing WWTPs. These costs cover power requirements, staff costs, maintenance costs, and finance costs. The costs are based upon the specified service levels outlined in the Economic Case section [5].

Periodic renewal costs reflect the replacement of assets as they reach the end of their useful lives. Periodic renewal costs outside of the estimated 80-year asset lives were not included. Civils and structures are assumed to have an 80-year asset life while electrical and mechanical components are assumed to be refreshed every 20 years which is considered standard for assets of this nature.

An overview of the annual estimate for ongoing cost forecasts is provided in Table FC - 3: Ongoing costs summary.

Table FC - 3: Ongoing costs summary

Programme Ongoing Costs (annual, \$000's, real)					
Programme cost	2031	2041	2051	2061	2071
Southern WWTP operating costs	544	672	2,050	2,050	7,400
Cambridge WWTP operating costs	2,040	2,340	2,660	2,790	2,790
Te Awamutu WWTP operating costs	2,600	2,800	3,200	3,300	3,300
Tauwhare Pa WWTP operating costs	40	40	40	40	40
Hamilton South conveyancing operating costs	-	-	-	800	800
Mātangi conveyancing operating costs	-	102	102	102	102
Total operating costs	5,224	5,954	8,052	9,082	14,432

² Section [5.4] of the Economic Case sets out the details of the contingency allowance. The cost estimates are deemed to be Class 5 estimates as per the AACE Cost Estimate Classification System and have an expected accuracy range of -30% /+50%.

4. Risks and Complexities

There are a number of risks associated with delivering a relatively complex and long-term programme of works, which may impact the cost estimates. The key risks in relation to the Financial Case are summarised below:

- **Long-term programme:** The accuracy of cost estimates is likely to reduce the further out they are being forecasted, given the increasing levels of uncertainty. Additionally, the timing of certain elements of capital expenditure could change based on population growth and demand (i.e. those that rely on staged thresholds) which further reduces the level of uncertainty. Costs will also increase due to an uncertain amount of inflation which is likely to be significant over the length of the Programme.
- **Level of design work to support costings:** The level of design work that has been completed is a key constraint on the accuracy of cost estimates. Costs will be refined as the design work is further progressed through subsequent phases. The current cost estimates are deemed to be Class 5 estimates as per the AACE Cost Estimate Classification System and have an expected accuracy range of -30%/+50%.
- **Three Waters Reform programme:** The Three Waters Reform programme may significantly change the way wastewater projects and services are delivered across the region, which may affect the funding assumptions in the DBC.

The cost estimates outlined above will need to be updated and tested as the Programme progresses and the design for different elements is further developed and refined. As expected for major infrastructure programmes of this nature, in the early part of their lifecycle, a high-level contingency is included in the cost estimates to reflect the high degree of uncertainty. Contingencies across the Programme components will therefore reduce as the Programme progresses, and the level of risk and uncertainty decreases.

The Programme's complete risk register is attached as Appendix P.

5. Cost Allocation

5.1 Approach to Cost Allocation

Given the potential for the Projects to service communities that are located within different Territorial Authorities (TAs), the Project costs may need to be allocated amongst the Sub-regional Councils. This is largely applicable to the Southern WWTP that will ultimately service communities from multiple councils. The cost allocation process involves two stages, as follows:

- Cost allocation methodologies were developed for each of the different project components (e.g. capital costs for local reticulation, capital costs for conveyancing, etc.), which looked at the specific beneficiaries for each component.
- For each of these Project components, where applicable, costs are then split between the relevant councils depending on the proportion of communities that are served and time period over which they are served.

The objective of this approach is to ensure that the beneficiaries of the Projects are the ones that ultimately pay for them.

5.2 Cost Allocation Methodology

An overview of the cost allocation methodologies for each Project component is provided in Table FC - 4 below.

Table FC - 4: Cost allocation methodology

Component	Methodology
Local reticulation - capital costs	Costs for upgrades or new local reticulation (where applicable) are proposed to be met by the relevant council (or developer) on the basis that only beneficiaries within the territory would benefit from the works. The relevant council is expected to recover these funds as additional properties are connected.
Conveyance - capital costs	Costs for upgrades or new conveyancing are proposed to be met by the council relying on the conveyancing for connection. This is because the beneficiaries of the conveyancing would be located within that district (e.g. the capital cost of new pipes to connect Mātangi would be expected to be funded by Waikato District Council).
Conveyance - operating costs	As per conveyance capital costs, conveyance operating costs are proposed to be met by the council that is using the conveyancing.
WWTP - capital costs (upgrades and new plants)	<p>WWTP capital costs are proposed to be allocated between the councils based on one of the following two formulations:</p> <ul style="list-style-type: none"> • For a project with only one stage, the level of Population Equivalent demand from users in the district serviced by the project over its useful life, compared to the level of Population Equivalent demand from users over its useful life; or • For a project with multiple stages the proportion of capital costs for each stage will be allocated based on the level of Population Equivalent demand from users in its district by that stage of the Project over the useful life of that stage's assets, compared to the level of Population Equivalent demand from users over the useful life of that stage's assets. • For a project with multiple stages there will be a need to account for the reuse of assets from prior stages of the Project. In this case, immediately prior to each future stage being commissioned an assessment of the reusable value from prior stages will be undertaken. The reusable asset valuation will be used in the following ways: <ul style="list-style-type: none"> i. added to the capital costs of the new stage and allocated using the same methodology set out above; ii. used as the basis for compensation of the council(s) that has funded the prior stage of the project. This compensation could be delivered using a rebate to the council or by netting off the council's share of the reusable asset value from their funding obligations for the new stage of the project.
WWTP - operating costs	<p>WWTP operating costs are proposed to be allocated based on the proportion of Population Equivalent demand serviced by the WWTP, as a proxy for the distribution of beneficiaries.</p> <p>The calculation of the respective proportions will need to be updated regularly to reflect changes in the level of Population Equivalent demand in each district. The expectation is that the proportions will be estimated every three years (i.e. to align with Long Term Plan (LTP) cycles), and then confirmed at the start of each financial year as part of the Annual Planning process.</p>
Land and consenting costs (Southern WWTP)	Given the land and consenting costs will benefit all stages of the Project, land acquisition, planning, and consenting costs for the Southern WWTP are proposed to be shared pro-rata ³ according to the estimated final state of wastewater flows in 2061. The base case timing assumes that Hamilton South will have been connected to the Southern WWTP by this point. No sale proceeds are assumed for surplus land if discharge to land is discontinued as the land will be retained as part of the future plant.













No realisation of value has been attributed to any land assets that are no longer required as part of the Southern WWTP as the it progresses through the three stages.

³ These flows represent the final state of the preferred option.

5.3 Project Funding Responsibilities for Each Council

Based on the above cost allocation methodology, a breakdown of the funding responsibilities for each council by project scope is provided in Table FC - 5 below.

Table FC - 5: Council's contributing to each Project

Project	Project Scope	Funding
Southern WWTP	Land Costs	  
	Plant capital and operating costs	  
	Conveyance – Hamilton South to WWTP – capital and O&M costs	
	Conveyance – Matangi/Tamahere/Tauwhare Pa to WWTP – capital and O&M costs	
	Decommissioning costs (Mātangi)	
	Plant capital and operating costs	
Cambridge	Conveyance and reticulation - capital and O&M costs	
	Capital and O&M costs	
Mātangi and Tauwhare Pā upgrades	Capital and O&M costs	
Te Awamutu upgrades	Capital and O&M costs	

As can be seen in the table, the costs are generally allocated to the council where the Project is located, except for the Southern WWTP where all three councils will contribute to the costs. The specific split of costs for the Southern WWTP is further discussed below.

5.4 Funding Split for the Southern WWTP

The proportion of costs for each scope item for the Southern WWTP is determined by the proportion of communities that are served and time period over which they are served and the life of the asset. The result of this allocation is demonstrated in the table below.

Table FC - 6: Cost allocation to Southern WWTP (pre-reuse calculations)

Southern WWTP Project Stage / Scope	HCC	Waipā DC	Waikato DC
Land purchase, planning and consenting	77%	22%	1%
WWTP Groundworks	77%	22%	1%
WWTP Stage 1 - 80 year life	0%	100%	0%
WWTP Stage 1 - 20 year life	0%	100%	0%
WWTP Stage 2a - 80 year life	0%	90%	10%
WWTP Stage 2a - 20 year life	0%	93%	7%
WWTP Stage 2b - 80 year life	0%	96%	4%
WWTP Stage 2b - 20 year life	0%	97%	3%
WWTP Stage 3 - 80 year life	82%	17%	1%
WWTP Stage 3 - 20 year life	77%	23%	1%

Land, planning and consenting costs for the Southern WWTP are split between the three councils based on the proportion of wastewater flows at 2061. For the purpose of the DBC the capital costs for the early stages of the plant are largely allocated to Waipā DC given its communities are the main beneficiaries of the Project. By stage three when wastewater flows are connected from Southern Hamilton, a significant proportion of the costs are allocated to HCC as they are the main beneficiary.

Importantly, given the Southern WWTP will be delivered through a staged approach with staggered investment decisions, this framework provides flexibility to realign the allocation of costs if communities are connected at different times, or different communities are connected to what is assumed in the DBC. A 'go forward' assessment will be carried out prior to investment decisions, including a reassessment of the estimated population growth and the required technical solution.

The reuse of existing Southern WWTP assets at the commencement of each staged item has been included in the cost allocation estimates below. To ensure there is an equitable allocation of costs between the Councils, the condition and value of existing assets will need to be considered at each of the different stages.

Additionally, there is potential for Waikato Regional Airport Limited (WRAL or the Airport) to provide funding for the project which could influence the cost allocation for stage one. The Airport has immediate servicing requirements for its existing and proposed developments in the area and discussions with the Airport have signalled the potential to work together to provide a wastewater solution that meets their needs and aligns with the future servicing needs of the broader metro area.

5.5 Council Cost Allocation

Based on the capital costs outlined in Financial Case Section [3] and the cost allocation approach set out above, a breakdown of each council's share of the costs of the Programme is set out below.

Table FC - 7: Council cost allocation

Project	Council	2022-31	2032-41	2042-51	2052-61	2062-71	Total
Southern WWTP	HCC	15,300	-	-	119,627	-	134,927
	Waipā DC	14,481	29,204	18,296	(5,069)	-	56,911
	Waikato DC	119	3,796	(1,796)	(158)	-	1,962
	Total	29,900	33,000	16,500	114,400	-	193,800
Mātangi conveyancing costs	Waikato DC	-	7,260	-	-	-	7,260
Hamilton South conveyancing costs	HCC	-	-	-	35,750	-	35,750
Southern WWTP (incl. conveyance)	Total	29,900	40,260	16,500	150,150	-	236,810
Cambridge WWTP	Waipā DC	115,720	4,290	6,050	10,780	-	136,840
Te Awamutu Upgrades	Waipā DC	20,900	-	11,000	-	-	31,900
Mātangi and Tauwhare Pā Upgrades	Waikato DC	2,750	-	-	-	-	2,750
Total		169,270	44,550	33,550	160,930	-	408,300

* A negative figure represents a rebate to the council due to the reuse of assets that it has already paid for under the previous stages. Please see Table 3 for further detail on Cost Allocation Methodology.

Operating costs	Council	2031	2041	2051	2061	2071
Southern WWTP*	HCC	-	-	-	1,670	6,027
	Waipā DC	544	624	1,998	365	1,318
	Waikato DC	-	48	52	15	55
	Total	544	672	2,050	2,050	7,400
Cambridge WWTP	Waipā DC	2,040	2,340	2,660	2,790	2,790
Te Awamutu	Waipā DC	2,600	2,800	3,200	3,300	3,300
Tauwhare Pa	Waikato DC	40	40	40	40	40
Southern Hamilton Conveyance	HCC	-	-	-	800	800
Matangi Conveyance	Waikato DC	-	102	102	102	102
Total		5,224	5,954	8,052	9,082	14,432

Despite not connecting to the Southern WWTP until 2061, HCC is contributing \$16 million in the ten-year period ending 2031 for land and consenting costs. Purchasing the site early has a number of benefits to HCC:

- Acquiring the land now preserves flexibility and optionality for a long term wastewater solution e.g. if Pukete capacity runs out sooner than anticipated or if the pace of development south of Hamilton is faster than anticipated. The need for flexibility is further highlighted by the Housing Supply Bill that the Government announced recently which has the potential to both bring forward development, and increase the density of development, in the Hamilton Metro area.
- Purchasing the site early ensures the planned Southern WWTP can be carried out without the need to modify consents or design work later should the site no longer be available.
- A significant amount of development is expected to occur in the sub-region resulting in strong demand for developable land parcels. Securing the site now will likely reduce the cost of the overall programme by avoiding paying for substantial growth in land values if the site were to be purchased in future.

Costs for the other projects in Table 4 are allocated to the council where the project is located, which demonstrates there is limited cross boundary servicing for these assets.

6. Lead Council Delivery Model

6.1 Overview of the Lead Council Structure

The Projects are proposed to be delivered by a single council as the sole beneficiary of the project or in the case of the Southern WWTP on behalf of the other Sub-regional Partners (the Lead Council). The Lead Council will utilise its existing resources, policies and procedures to deliver the Project (See Management Case Section [1.2.2 Project Management Arrangements]).

Under the Lead Council model there is optionality regarding how each programme is financed:

- Financing for each council's share of the capital costs is raised by each respective council and passed through to the Lead Council. This is the approach generally applied in the Financial Case.
- Financing of the full project cost is proposed to be undertaken by the Lead Council and where costs have been allocated other councils (the Non-Lead Council), costs are proposed to be recouped through a servicing agreement. Of the different projects, this arrangement is most relevant to the Southern WWTP. A sensitivity assessment illustrating the impacts of this approach is included in Financial Case Section [9.4]
- The Non-Lead Council is expected to meet the service payment through applying its preferred funding tools to the communities that benefit from the project within its respective territorial boundaries. These arrangements are further discussed below.

6.2 Responsibilities

The Lead Council will be responsible for the following activities:

- Purchasing land and securing consents and designations.
- Procurement, design and construction of the assets.
- Depending on the financing structure chosen, financing the construction directly and collecting funding from other councils (if required) via a service agreement or direct contribution.
- Owning and operating the assets.

Non-Lead Councils will be responsible for the following activities:


- Supporting the Lead Council with design and procurement (as required).
- Imposing and collecting the preferred funding tools within their respective territorial boundaries.
- Paying their respective contributions to the Lead Council via a service agreement.

6.3 Service Agreement and Funding and Financing Flows

If a service agreement is required, the arrangement between the Lead Council and Non-Lead Councils will be formalised through a service agreement. This service agreement will set out the levels of service and the specific cost sharing arrangements and mechanics for the Project.

An overview of how the funding and financing flows between the Lead Council and the Non-Lead Councils is provided in Figure FC - 1 on the next page.

Figure FC - 1: Funding and financing flows

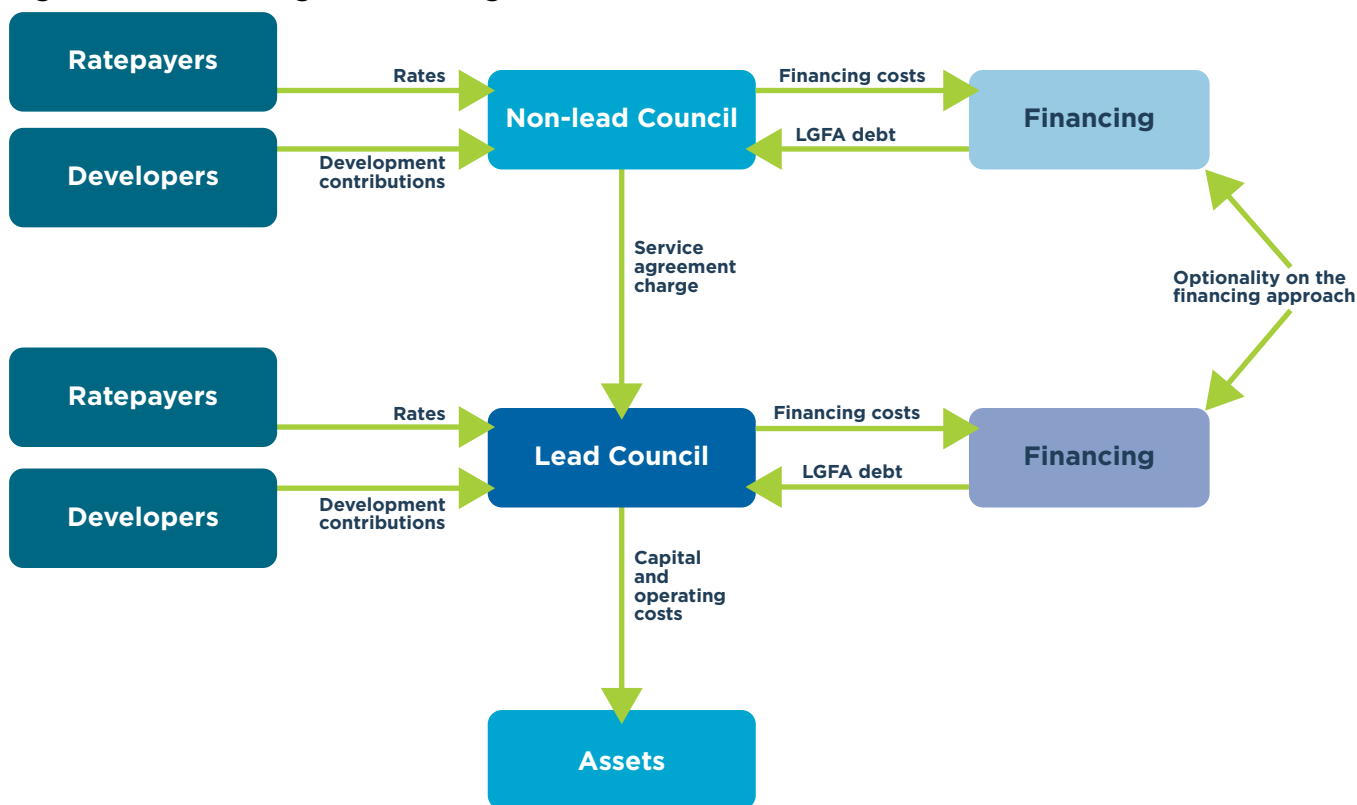





These Service Agreements will need to be established well before the commencement of each project. Further information on the Lead Council model is provided in Management Case Section [1.4 Project Management Planning].

6.4 Project Lead Councils

An overview of the Lead Council for each of the Projects is provided in the table below. The Lead Council for each project was determined based upon the location of the primary beneficiaries of each project.

Table FC - 8: Project Lead Councils

Project	Lead Council
Southern WWTP	
Cambridge WWTP	
Te Awamutu upgrades	
Mātangi and Tauwhare Pā upgrades	

7. Funding and Financing

7.1 Introduction and Overview

Due to the size and scale of the programme of works, there is likely to be a significant upfront and ongoing funding requirement. Accordingly, a combination of different capital and operating funding sources will be required to generate sufficient revenue. Financing is likely to be required to smooth and spread the delivery phase costs across the life of the project. This section sets out the evaluation of funding and financing options and recommends a preferred funding and financing solution.


7.2 Approach

The following steps were taken to determine the preferred funding and financing approach:

- Development of a long list of funding and financing options.
- Development of assessment criteria to evaluate the funding and financing options.
- Assessment of long list of options against the criteria to determine a short list of funding and financing options.
- Consultation and discussion with stakeholders on the short list to agree the preferred funding and financing approach.

This approach is outlined in Figure FC - 2.

Figure FC - 2: Funding and financing option long list to preferred option process

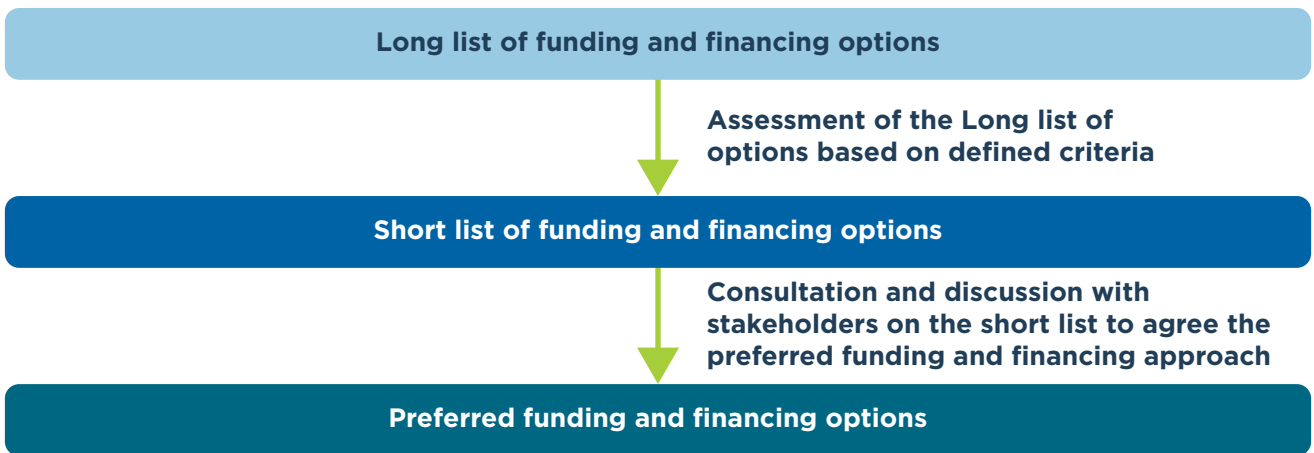

7.3 Long List of Options

The following long lists of funding and financing options were developed to capture all reasonable options available to fund and finance the Programme.

Figure FC - 3: Long list of funding and financing options

Funding Options		Financing Options	
Council funding	General rates	Debt	LGFA
	Targeted rates		Bank debt
	Development contributions ⁴		Bespoke Crown loan
Crown funding	Specific Crown fund		Crown DMO lending
	Crown operational subsidy/ assistance		Bonds/private placements
Direct funding	User pays		Subordinated/convertible instruments
	Long term commercial arrangements	Equity	Council equity
Value capture	IFF levy		Crown equity
	Negotiated contribution		Iwi equity
	Private sector partnering		Private equity
	Public sector partnering		

Transferring financing risk to the private sector through the contracting model (e.g. through a Design, Build, Finance, Operate and Maintain model) was considered as part of the Commercial Case, but was not ultimately preferred.

7.4 Assessment Criteria

A set of assessment criteria to evaluate funding and financing options were developed based on:

- **Precedent transactions:** Consideration given to learnings from other comparable projects.
- **Stakeholder input:** Workshopping with key stakeholders to ensure that all interests were appropriately considered.
- **Applicability:** The criteria needed to ensure that options were effectively evaluated and were applicable to the proposed long lists.
- **Wider objectives and criteria:** Where relevant, the criteria reflect the investment objectives and Programme KPIs (refer Strategic Case [Section 3.3 Investment Objectives]).

The assessment criteria are outlined in Table FC - 1: Population equivalent forecasts across the wider Waikato-Hamilton Waipā Metro Area⁹ on the next page.

⁴ Inclusive of trade waste and bulk supply arrangements.

Table FC - 9: Funding and financing assessment criteria

Criteria	Description and application to Financial Case options
Customer / Social Outcomes	The extent to which the funding and financing options enhance the social objectives of the Programme, prioritising ratepayer affordability and promoting intergenerational equity. The funding and financing options should accommodate investment from stakeholders who prioritise the long-term health of Waikato’s rivers and the sustainability of the Programme.
Timing and Budget Certainty	The extent to which the funding options provide certainty and predictability to stakeholders on the level and timing of contributions. How predictable are the rating implications of the funding options. The extent to which financing options are able to meet changes in the Programme budget to deliver the Programme. Are councils able to reliably forecast the timing and quantum of their capital contributions. Do the funding and financing options create additional risk to project timeframes.
Deliverability	The extent to which the funding and financing options can be easily implemented. Can the funding or financing options be achieved within the timelines of the project and are the financial case options likely to place significant administrative burden on the project. Are the funding or financing options likely to incur public opposition, require public consultation or a lengthy design and implementation processes.
Risk Allocation and Management	The extent to which the funding and financing options allocate risk to the party best able to manage it, promoting equity between ratepayers and other stakeholders. Where external capital providers are included in the Programme, they should bear some exposure to the operating performance of the entity.
Market Interest & Capability	The extent to which the funding and financing options will maximise interest in the project, improving competition, pricing and cost outcomes and ultimately delivering value for money. Financing options should generate sufficient interest to achieve competitive pricing and / or bring capability that is beneficial to the delivery of the project.
Flexibility	The extent to which the funding and financing options are able to adapt to changes in economic regulation and sector reform throughout the delivery life of the project. Are the funding and financing options able to be adjusted during the operations of the project to maintain equity of cost sharing across ratepayers and other stakeholders.

7.5 Evaluation and Short Listing of Options

Options were initially evaluated against the assessment criteria outlined above, with a focus on identifying whether there were any reasons that would prevent an option from being taken through to the short list. An overview of the assessment is provided in the tables below.

Funding options were assessed against the criteria for each of the key beneficiary groups of the Programme; municipal users and trade waste users. All funding tools were progressed to the short list stage as no funding tools were fatally flawed for all key beneficiary groups of the Programme. The full long list assessment of the funding options is set out in Appendix K.

Table FC - 10: Evaluation of funding options

Funding Option	Assessment	Progress to short list
General rates	No material issues identified for any beneficiary groups.	Yes.
Targeted rates	No material issues identified for any beneficiary groups.	Yes
Development contributions	Not appropriate for household beneficiaries, by appropriate for other groups.	Yes.
Crown funding support	Would benefit the Programme by reducing the financing burden required from other beneficiary groups.	Yes.
User pays	Not appropriate for property developers as they do not own the property long term, but appropriate for other beneficiary groups.	Yes.
Long-term commercial arrangements	Only appropriate for large industrial and commercial users due to the complexity of negotiating bespoke arrangements.	Yes.
IFF levy	No material issues identified for any beneficiary groups.	Yes.
Negotiated contribution	Not taken forward for municipal (household) and smaller trade waste users due to concerns regarding deliverability.	Yes.
Public or Private development partnering (e.g. Kāinga Ora)	Only relevant to property developers, not applicable for the other user groups.	Yes.

At the time of the short listing process, it was unclear as to whether a new entity would be used to deliver the Programme. The table below summarises the long list evaluation of financing options, which were assessed against whether a new entity was required or whether it would be delivered by councils. The full long list assessment of the financing options is set out in Appendix L.

Table FC - 11: Evaluation of financing options

Financing Option	Assessment	Progress to short list
LGFA	No material issues identified.	Yes.
Term lending - bank debt or non-bank private placement loan	Not taken forward for council entity due to higher interest costs than LGFA debt (Social Outcomes criteria).	Yes, for new entity borrowing.
Bespoke Crown loan	No issues identified, subject to Crown willingness.	Yes.
Crown DMO lending	Not taken forward as LGFA financing negates the need, and would introduce complexity and Deliverability risk.	No.
Bonds	Not progressed due to material issues with deliverability and timing and budget certainty.	No.
Subordinated / convertible instruments	Only progressed for a new entity, however significant hurdles identified due to the likely return requirements of these types of instruments.	Yes, for a new entity only.
Council equity	Only suitable for a new entity.	Yes, for a new entity only.
Crown equity	Only suitable for a new entity.	Yes, for a new entity only.
Iwi equity	Only suitable for a new entity.	Yes, for a new entity only.
Private equity	Only suitable for a new entity.	Yes, for a new entity only.

7.6 Short List

The long list assessment process resulted in the following short list:

Table FC - 12: Funding and financing short lists

Funding Option	Progress to short list	Financing Option	Progress to short list
General rates	✓	LGFA	✓
Targeted rates	✓	Term lending - bank debt or non-bank private placement loan	✗ Concerns regarding customer outcomes regarding affordability
Development contributions	✓	Bespoke Crown loan	✓
Crown funding support	✓	Crown DMO lending	✗ Deliverability risk as LGFA already fills this role
User pays	✓	Bonds	✗ Concerns regarding customer outcomes regarding Deliverability
Long-term commercial arrangements	✓	Subordinated / convertible instruments	✗ Deliverability risk as no new entity to be established
IFF levy	✓	Council equity	✗ Deliverability risk as no new entity to be established
Negotiated contribution	✓	Crown equity	✗ Deliverability risk as no new entity to be established
Public or Private development partnering (e.g. Kāinga Ora)	✓	Iwi equity	✗ Deliverability risk as no new entity to be established
		Private equity	✗ Deliverability risk as no new entity to be established

7.7 Preferred Funding and Financing Solution

The preferred funding and financing solution was determined following engagement with each of the councils on the short list of funding and financing options. The preferred solution was to leverage the current funding and financing approaches for each council (i.e. aligned to the relevant revenue and financing policies). Under this solution, each council is responsible for determining and implementing their preferred funding and financing approach.

This solution was preferred for the following key reasons:

- Existing approaches are well understood by councils.
- Existing approaches are easily implementable and reduce costs associated with establishing a new funding methodology.
- Under the Lead Council structure these funding and financing tools align with existing policies and procedures.
- These “business as usual” tools maintain flexibility to transition to a new three waters entity, if required as a result of sector reform.

The potential to impose a long-term levy through the Infrastructure Funding and Financing Act was considered, however the additional implementation challenges (e.g. requirement to develop a Levy Proposal, requirement to receive Ministerial approval, etc.) were considered a significant barrier.

An overview of the current funding and financing approaches for each council is provided in the table below.

Table FC - 13: Preferred options - Current council funding and financing approaches

Council	Current funding approach	Current financing approach
HCC	General Rates and Development Contributions (including trade waste or bulk supply arrangements)	Generally debt funded through the LGFA
Waipā DC	Targeted Rates and Development Contributions (including trade waste or bulk supply arrangements)	Generally debt funded through the LGFA
Waikato DC	Targeted Rates and Development Contributions (including trade waste or bulk supply arrangements)	Generally debt funded through the LGFA

Commensurate with the requirement to operate in a financially prudent manner and within a balanced budget, the expectation is that financing is only used for capital costs. The Financial Case does not include any allowance for Crown funding support.

7.8 Potential Airport Involvement

The Airport requires a wastewater solution to meet existing demand and proposed development and population growth around the Airport. Given the Airport will need to meet the costs of these upgrades themselves, they are open to contributing to a Southern WWTP if it would meet their requirements. This contribution may provide financial assistance to the Southern WWTP in the future through a contribution of either land to use for the Southern WWTP or direct financial support. Further discussions between the Airport and the Programme are required to further develop the Airport’s role and contribution to the Programme. Any impacts that result from the Airport’s involvement (including technical design changes, unbudgeted financial contributions etc) will need to be assessed. There is likely a need for an interim wastewater servicing solution at the Airport until the Southern WWTP is operational. This has not been included within the preferred option.

8. Affordability

8.1 Introduction and Overview

A high-level assessment of the affordability of the Programme was undertaken based on an assessment of:

- The burden on ratepayers to fund the additional general and / or targeted rates;
- The cost to developers of development contributions; and
- The debt headroom under the current relevant LGFA covenants for each of the council.

The high-level assessment indicates that the Programme is affordable. However, this should continue to be tested as certainty over the timing and magnitude of costs increases.

8.2 Ratepayer Affordability

An overview of the estimated annual impact (i.e. the incremental increase in rates per ratepayer) of the Programme on ratepayers is provided in the following table.

Table FC - 14: Estimated rating impact

Year	2031	2041	2051	2061	2071
HCC – General Rate	\$112	\$88	\$75	\$386	\$612
Waipā DC – Southern WWTP Targeted Rate	\$403	\$874	\$468	\$282	\$304
Waikato DC – Southern WWTP Targeted Rate	-	\$2,153	\$1,631	\$1,257	\$1,266
Waipā DC – Cambridge WWTP Targeted Rate	\$520	\$394	\$368	\$352	\$331
Waipā DC – Te Awamutu WWTP Targeted Rate	\$260	\$300	\$315	\$287	\$276
Waikato DC – Mātangi & Tauwhare Pa Targeted Rate	\$110	\$466	\$435	\$404	\$371

An overview of the affordability of these rates increases is provided in the table below. The assessment is based upon the 5% affordability threshold that was identified in the 2007 COVEC report into rates affordability. Ratepayer affordability has been assessed based on adding the average rating impact for a ratepayer to the average household rates bill as provided by the councils. At the date of this document, Waikato District Council did not participate in this rating survey.

Table FC - 15: High-level rates affordability assessment

Council	Median Household income (2021)	Affordability threshold (5%)	Average rates per household	Average additional project rating impact	Total rating burden	Affordability check
HCC – Southern WWTP	\$77,485	\$3,874	\$2,770	\$499*	\$3,269	✓
Waipā DC – Southern WWTP			\$3,092	\$466	\$3,558	✓
Waikato DC – Southern WWTP			\$2,649	\$1,577	\$4,226	-
Waipā DC – Cambridge WWTP			\$3,092	\$393	\$3,485	✓
Waipā DC – Te Awamutu WWTP			\$3,092	\$288	\$3,380	✓
Waikato DC – Mātangi & Tauwhare Pa upgrade			\$2,649	\$357	\$3,006	✓

* Average additional project rating impact calculation only considers years 2061 and 2071 for HCC i.e. after Hamilton South switches to using the Southern WWTP. The additional rating impact would not be applied to Hamilton North.

Source: Stats NZ.

Table FC - 15: High-level rates affordability assessment demonstrates that the rating impacts generally fall within the affordability thresholds set out by COVEC based on the average additional project rating impact for each council's ratepayers. The exception to this is the Waikato DC – Southern WWTP rating impact which is above this threshold by 9%. This is primarily driven by the costs of conveyancing from Mātangi to the Southern WWTP, with the relative rating impact reducing as further growth comes online in the future. It should be noted that there are likely other costs that would need to be considered in more detail prior to implementing an increase in rates, such as additional water related costs, mortgage servicing costs and other cost of living increases.

Under current council policies, HCC uses a general rate whereas Waikato DC and Waipā DC use a targeted rate. To provide a complete picture of the ratepayer affordability, Pukete upgrade costs would also need to be included in HCC's rating impact assessment. This will be considered as part of the Northern Metro Wastewater DBC.

8.3 Affordability of Development Contributions

The potential affordability of the development contributions required for the Programme was estimated through the following approach.

- An assessment was undertaken on the portion of costs that the Lead Council would need to recover from its ratepayer base .
- An estimate was made of the portion of the project that is attributable to growth. The increase in Population Equivalent units of demand over the forecast operational life of the project was used as a proxy for growth.
- Then a calculation was made to determine the pro-rata allocation of these costs to the amount that is attributable to growth. It is assumed this amount can be recovered from development contributions.
- A financing charge was then applied based on the respective interest rates for each council and solved for a level of development contribution that recovers the cost allocated to growth over the life of the project.

A more detailed assessment of the proportion of total capital costs that are attributable to growth, service improvement and renewal expenditure will need to be completed once cost estimates are refined. Any third-party contributions made to the project will also need to be considered when calculating the level of development contributions. This analysis assumes that no financial contributions are received from the Airport.

The estimated development contribution per Household Unit Equivalent (HUE) of demand for each of the councils is provided in the table below. Population data has been divided by 2.5 to convert it into HUE's.

Table FC - 16: Estimated development contributions (per HUE of demand)

Council	2031	2041	2051	2061
Hamilton CC - Southern WWTP	-	-	-	-
Waipā DC - Southern WWTP	\$9,728	\$9,728	\$9,728	\$9,728
Waikato DC - Southern WWTP (Matangi and Tamahere Commercial)	-	-	-	-
Waipā DC - Cambridge WWTP	\$7,327	\$7,327	\$7,327	\$7,327
Waipā DC - Te Awamutu WWTP	\$2,162	\$2,162	\$2,162	\$2,162
Waikato DC - Mātangi & Tauwhare Pa	\$6,261	\$6,261	\$6,261	\$6,261

The development contributions reflect the portion of project costs that are allocated to growth beneficiaries for each council. No development contributions are shown for HCC or Waikato DC for the Southern WWTP as the plant will only be servicing existing HCC and Waikato DC communities during the time period to 2061. The development contributions set out above compare reasonably to existing levels charged by the councils, falling near the middle of existing wastewater related charges for the councils.

8.4 Affordability for Councils

An overview of the indicative impact on each council is provided in the following figures, including a comparison against the council's current LGFA debt to revenue covenants.

As a debt obligation, the full borrowings are expected to be treated as being 'on-balance sheet' from a credit rating and accounting perspective.

For a Non-lead Council that has entered into a servicing agreement with a Lead Council, it will have a contractual payment obligation in respect of its allocation of capital and operating costs for the project. The accounting treatment for these servicing agreements will depend on the specific commercial arrangements that are agreed. It is recommended that formal accounting advice should be sought once the service agreement has been agreed to confirm its accounting treatment.

From an accounting perspective, the accounting treatment follows the substance of the arrangement rather than its legal form. Since the arrangement constitutes the use of an asset, it would need to be determined whether:

- The arrangement constitutes a service concession arrangement in the scope of PBE IPSAS 32;
- Whether the arrangement constitutes / contains a lease in the scope of PBE IPSAS 13; and
- Whether the lease should be classified as an operating lease or finance lease.


The key factors assessed under these tests include:

- Level of control
- Exclusivity of use; and
- Residual interest in the asset

The affordability analysis for councils was based on whether (or not) the financial impacts of the Programme resulted in any of the councils breaching their LGFA debt to revenue financial covenants.


The estimated financial impact on the debt to revenue ratio for each of the councils over the next 10 year LTP period is provided in the figures below. Debt forecasts were not available beyond this period.

Figure FC - 4: Forecast HCC debt to revenue ratio

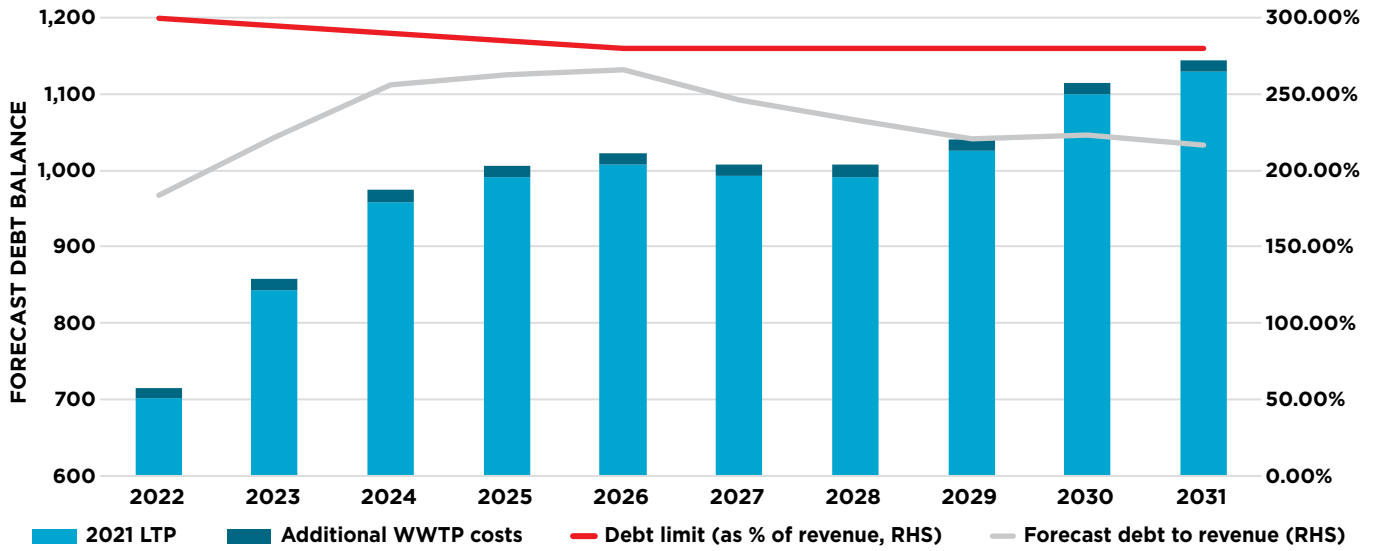


Source: Hamilton City Council Long Term Plan 2021-31

Figure FC - 5: Forecast Waipā DC debt to revenue ratio

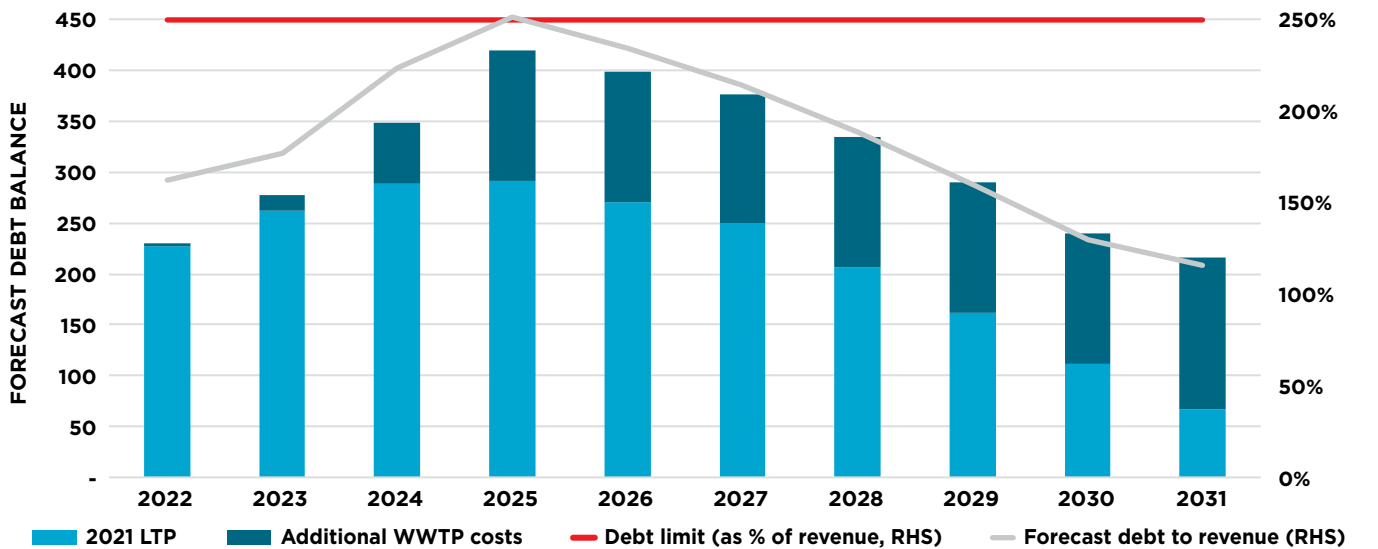

Source: Waikato District Council Long Term Plan 2021-31

Figure FC - 6: Forecast Waikato DC debt to revenue ratio

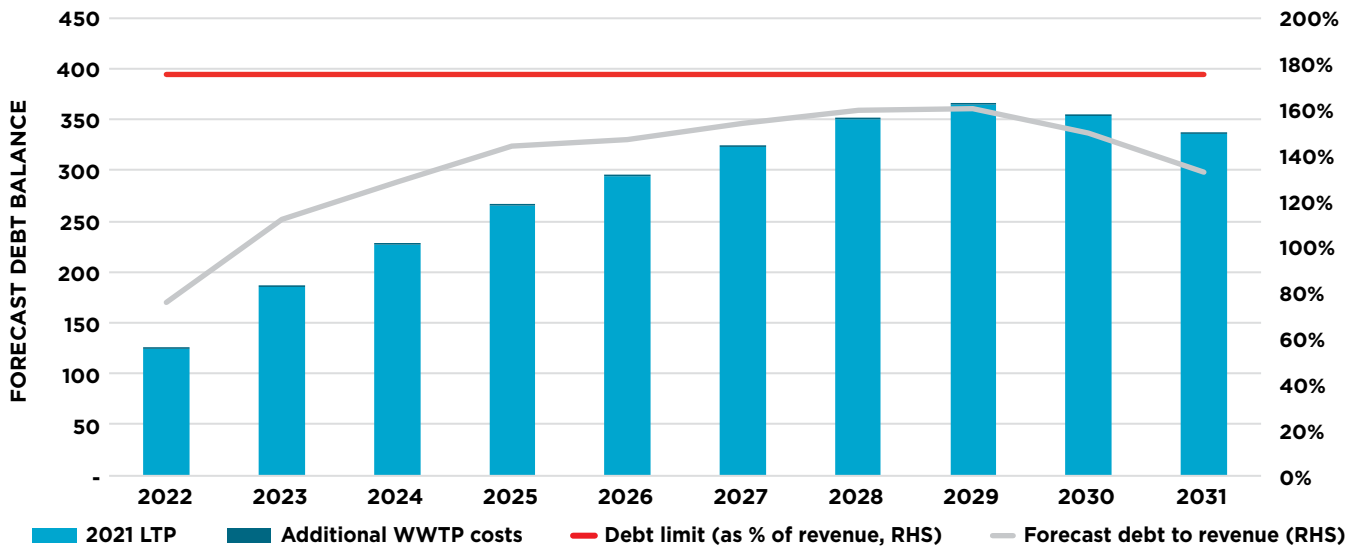

Source: Waikato District Council Long Term Plan 2021-31

Note: Revenue received from development contributions has been excluded from the revenue figures as they are not included in the LGFA’s metrics due to their one-off and uncertain nature.

As demonstrated in the charts, the councils are forecast to remain within the debt to revenue caps after allowing for the impact of the Programme over the next 10 years, although HCC do get close to breaching their debt limit.

9. Sensitivity Analysis


9.1 NPV Analysis

A NPV for the overall programme has been determined to understand the current value of all the future cash flows of the Programme. This measure can be used to test the sensitivity of the Programme to changes in the underlying assumptions (e.g. inflation or changes to costs).

The estimated NPV for the Programme is -\$344.1 million, which is based upon the capital and ongoing costs outlined in [Section 3- Cost Analysis] and a five-percent real discount rate (as per the New Zealand Treasury guidance).

Sensitivity analysis was carried out to understand the potential impact on the NPV as a result of several key risks eventuating. The risks include changes to inflation, operating costs and capital costs and the results are outlined in Figure FC - 7 below.

Figure FC - 7: NPV sensitivity analysis

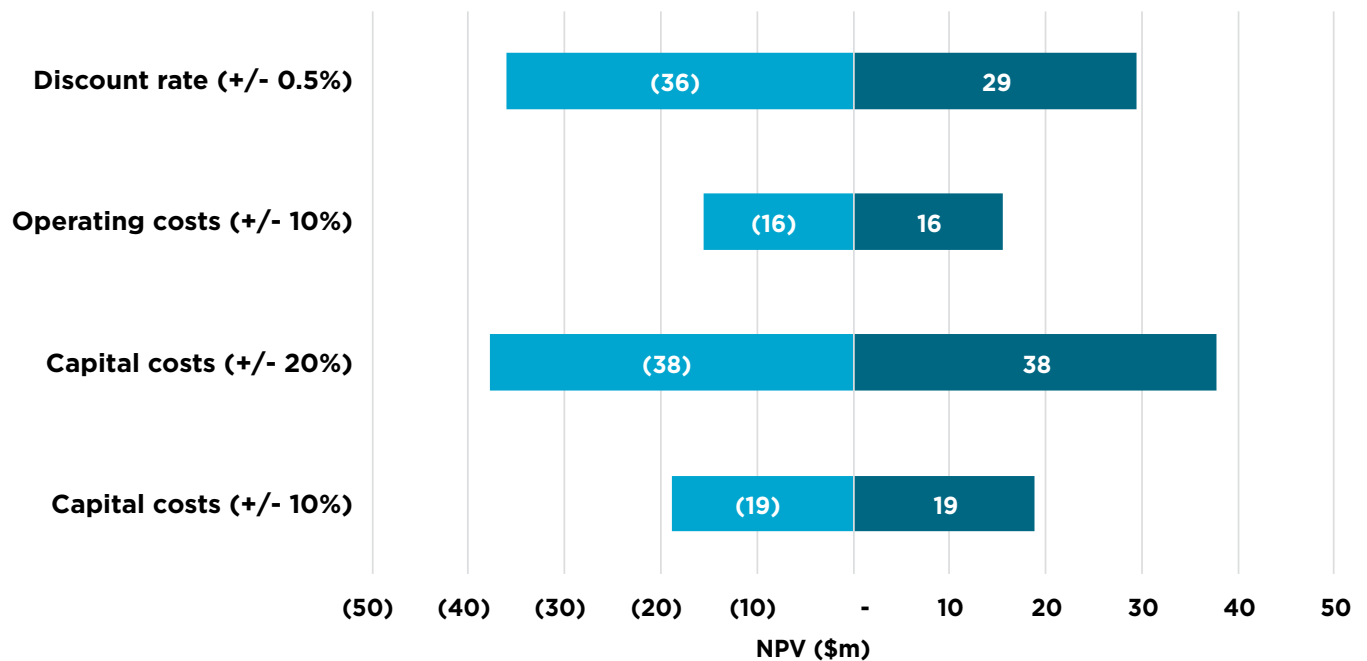

The NPV sensitivity analysis indicates that the impact of these risks eventuating is relatively minor in the context of the overall NPV for the Programme. However, this is primarily because most of the capital and ongoing costs are expected to be incurred later in the Programme and are therefore heavily discounted as part of the NPV analysis. Accordingly, there is still expected to be a material impact on affordability if there are significant cost overruns.

9.2 Debt Limit Sensitivities

A similar analysis has been undertaken to test the impact on the council debt to revenue ratios. Again these measures were evaluated after applying changes to inflation and capital costs. The results of this analysis are outlined below:

Figure FC - 8: HCC debt limit sensitivities

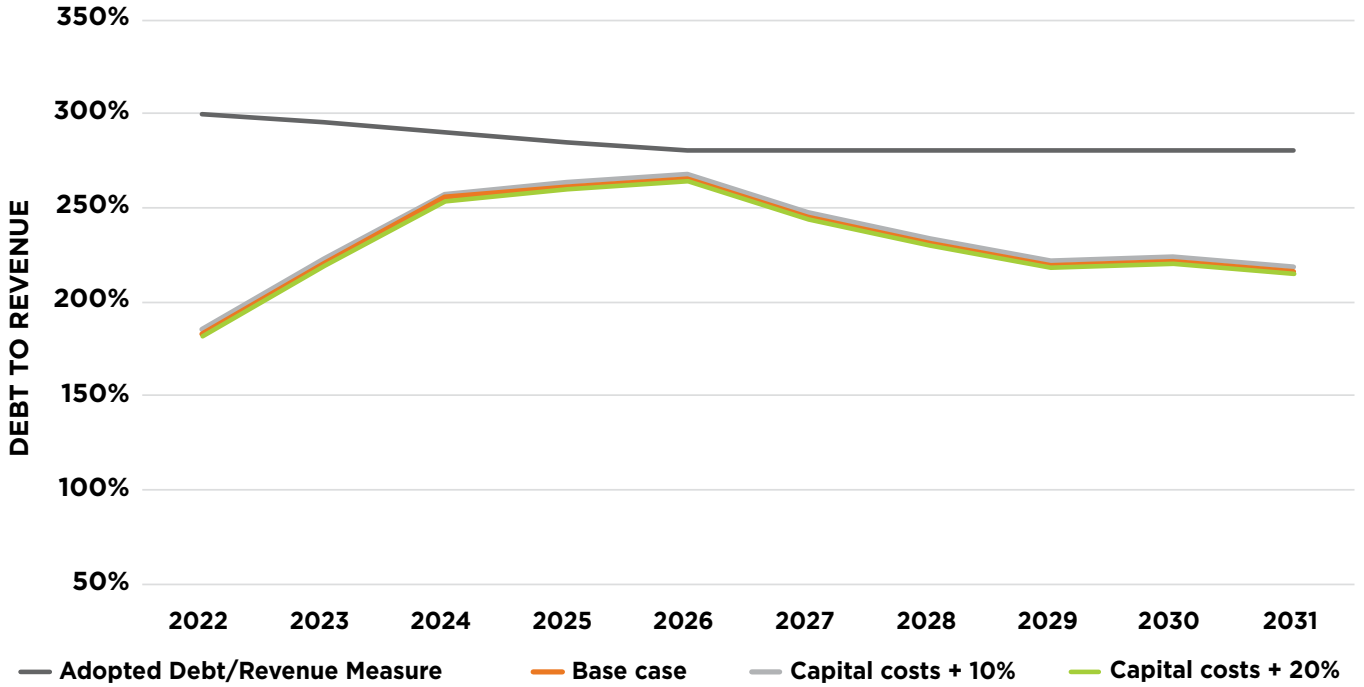


Figure FC - 9: Waipā DC debt limit sensitivities


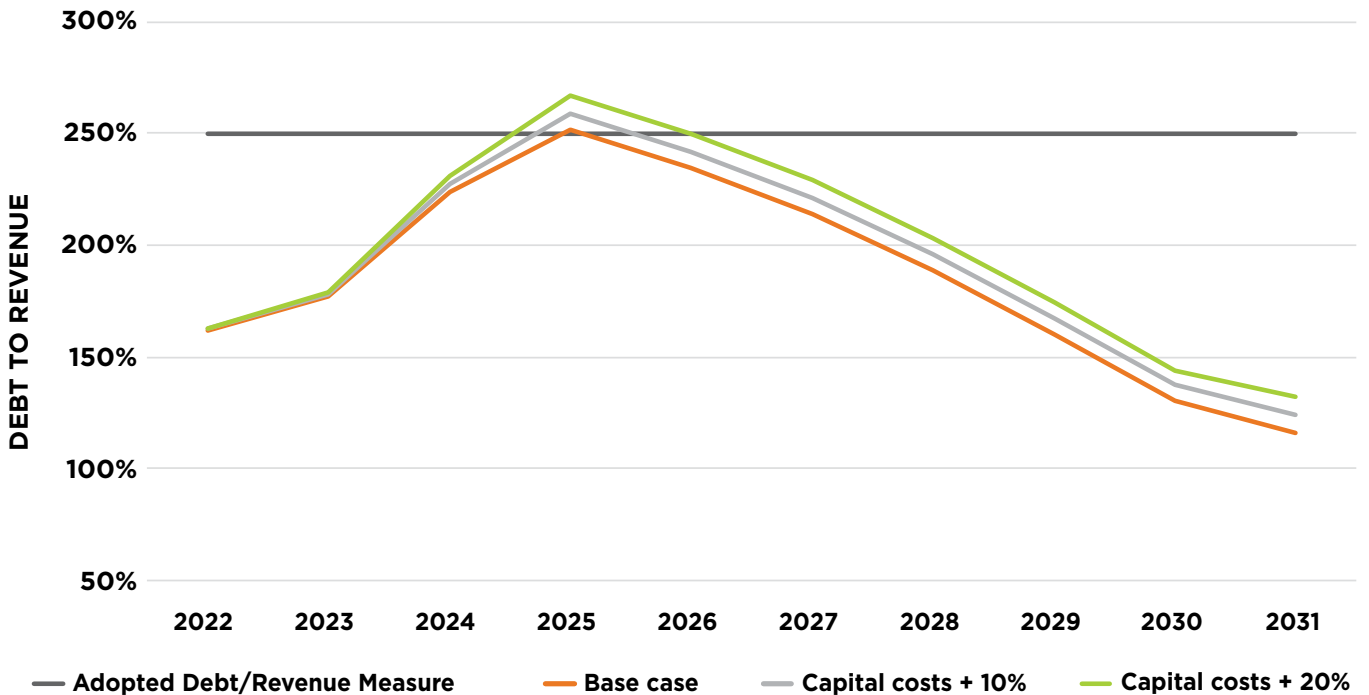


Figure FC - 10: Waikato DC debt limit sensitivities

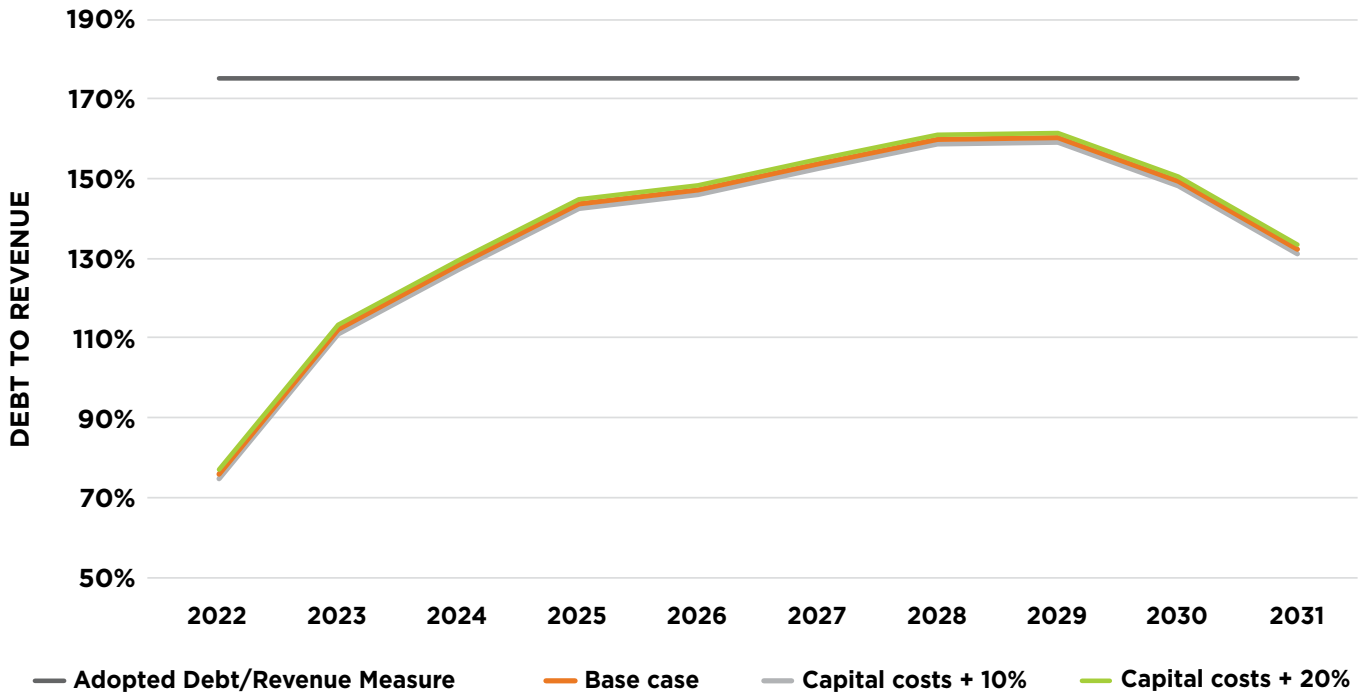

The analysis above identified that HCC and Waikato DC are not significantly impacted in the next 10 years due to the comparatively small capital expenditure and although Waipā DC’s debt does increase, this is relatively minor in scale compared to their current debt portfolio.

9.3 Sub-regional Cost Allocation Approach

At the request of the councils, a scenario has also been considered to examine the impacts of a sub-regional approach to wastewater cost allocation to understand the level of charging that would be required to distribute the costs of the Programme equitably across the subregion.

Under this scenario, costs and beneficiaries from the Northern Metro area are included in the analysis so that rates are harmonised across the Northern and Southern Metro areas. Costs of \$393.1 million for the construction of the Pukete and Ngaruawahia WWTPs are included in the analysis. These costs exclude buffer storage, reuse and outfall replacement costs. These are being considered in more detail as part of the Northern DBC.

There is potential that other Northern Metro area wastewater capital costs may need to be included in the final calculation that have not been captured as part of this analysis.

The estimated targeted rate and development contribution are presented below in Table FC - 17.


Table FC - 17: Subregional cost allocation approach

Year	2031	2041	2051	2061+
Subregional targeted rate (per Population Equivalent)	\$73	\$85	\$81	\$79
Development Contribution (averaged across the region)	\$2,249	\$2,249	\$2,249	\$2,249

9.4 Alternative Financing Model

We have also considered the impact of the alternative approach whereby the Lead Council finances the project in its entirety and charges the participating councils a service delivery charge. Under this approach HCC will need to borrow significantly more to finance the delivery of the early stages of the Southern WWTP and recover these costs through a service agreement charge. The allocation of costs will not change between either financing approach.

Figure FC - 11: Forecast HCC debt to revenue ratio

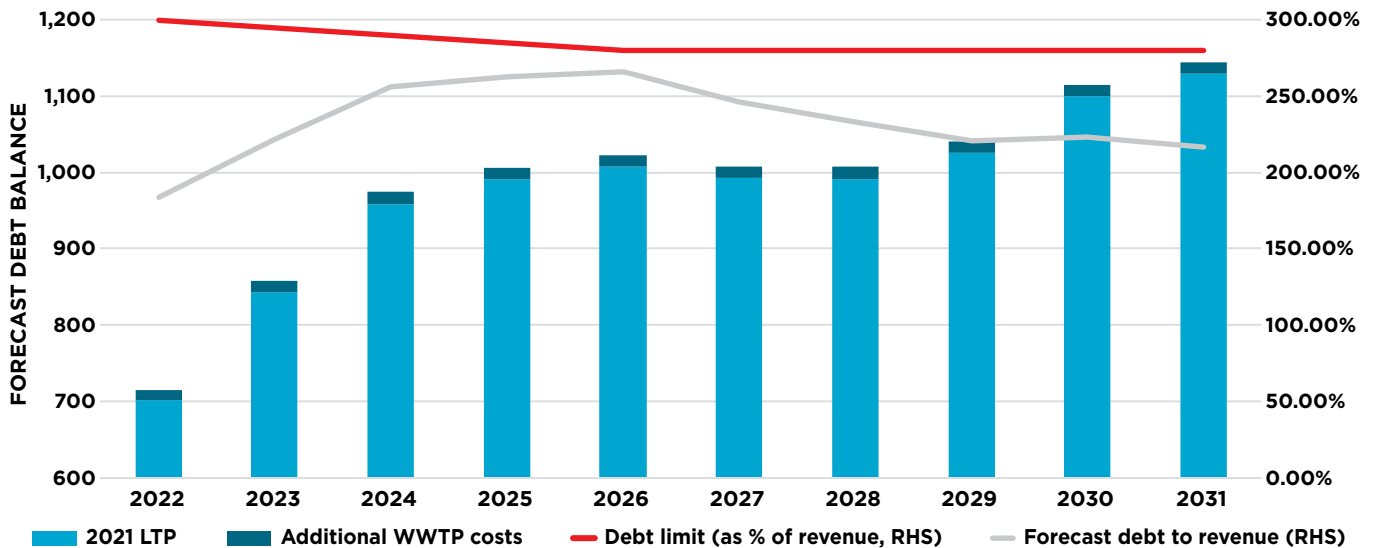

Under the alternative financing approach, HCC needs to borrow \$15 million more than under the base case. HCC will finance the land purchase, consenting and initial plant groundworks on its balance sheet, and then recover these costs from the Non-Lead Councils. This impact would be more severe in the 2032-2051 period where HCC will need to borrow a significant amount to fund assets it carries only a small amount of cost burden for. This financing approach brings HCC closer to its debt limit but still does not result in a breach.



Management Case

He Keehi Whakahaere -
Whakatinanatanga



Management Case Contents

<i>1. Introduction</i>	<i>207</i>
1.1 Scope	207
1.2 Project Management Planning	208
1.2.1 Programme Management Arrangements	208
1.2.2 Project Management Arrangements	209
1.2.3 Governance Structure	209
1.2.4 Project Organisation Structure	213
1.2.5 Use of Special Advisors	216
1.2.6 Personnel Implications	216
1.2.7 Project Plan and Milestones	217
1.3 Change Management Planning	221
1.3.1 Overview	221
1.3.2 Project Delivery Change	221
1.3.3 Operational Change	221
1.3.4 Change Management Strategy	222
1.4 Benefits Management Planning	223
1.4.1 Overview	223
1.4.2 DBC Objectives	223
1.4.3 Monitoring and Reporting	224
1.5 Risk Management Planning	225
1.5.1 Risk Recording and Reporting	225
1.5.2 Risk Register	225
1.6 Next Steps	228

Figures

<i>Figure MC - 1:</i>	<i>Governance structure</i>	<i>210</i>
<i>Figure MC - 2:</i>	<i>Project Activities</i>	<i>214</i>
<i>Figure MC - 3:</i>	<i>Organisational Structure - Initial phase.....</i>	<i>214</i>
<i>Figure MC - 4:</i>	<i>Organisational Structure - Construction phase</i>	<i>215</i>
<i>Figure MC - 5:</i>	<i>Organisational Structure - Operations phase.....</i>	<i>215</i>
<i>Figure MC - 6:</i>	<i>Key Milestones - Programme</i>	<i>217</i>
<i>Figure MC - 7:</i>	<i>Key Milestones - Southern WWTP</i>	<i>218</i>
<i>Figure MC - 8:</i>	<i>Key Milestones - Cambridge WWTP</i>	<i>219</i>

Tables

<i>Table MC - 1:</i>	<i>Memorandum of Understanding - Key terms.....</i>	<i>208</i>
<i>Table MC - 2:</i>	<i>Lead Councils</i>	<i>209</i>
<i>Table MC - 3:</i>	<i>Key features of the PPG.....</i>	<i>211</i>
<i>Table MC - 4:</i>	<i>Roles and Responsibilities of the PPG</i>	<i>212</i>
<i>Table MC - 5:</i>	<i>Roles and responsibilities of the Programme Director</i>	<i>212</i>
<i>Table MC - 6:</i>	<i>Roles and Responsibilities - Lead Council</i>	<i>213</i>
<i>Table MC - 7:</i>	<i>Advisory support.....</i>	<i>216</i>
<i>Table MC - 8:</i>	<i>Key Milestones - Southern WWTP</i>	<i>218</i>
<i>Table MC - 9:</i>	<i>Key Milestones - Cambridge WWTP</i>	<i>219</i>
<i>Table MC - 10:</i>	<i>Change management strategy</i>	<i>222</i>
<i>Table MC - 11:</i>	<i>Risk register: Top risks</i>	<i>226</i>

1. Introduction

This document sets out the Management Case for the Waikato Southern Metro Wastewater Treatment DBC.

The purpose of the Management Case is to confirm the proposal is achievable and detail the arrangements needed to ensure successful delivery as well as to manage project risks.

The Management Case considers:

- Programme and project management arrangements.
- The proposed governance structure.
- Roles and responsibilities.
- The project plan and milestones.
- Change management.
- Benefits management.
- Risk management.

The preferred option comprises a programme of WWTP works across the wider Waikato-Hamilton Waipā Metro Area. The Projects are outlined below:

- **Southern WWTP:** Construction of a new WWTP to service the Airport industrial precinct, Mātangi/Tamahere Hub and southern Hamilton. The WWTP is expected to be located between Rukuhia and the Airport and will be delivered in three stages to align to estimated demand. Initially, the WWTP will discharge to land, but will discharge to water and ultimately to the Waikato River once stage two triggers are reached. Interim servicing arrangements to meet the current and short-term needs of the Airport industrial precinct will also be required.
- **Cambridge WWTP:** Construction of a new WWTP at Cambridge to replace the existing plant with discharge to the Waikato River. The plant will be located on the same site as the existing plant.
- **Te Awamutu upgrades:** Upgrades to the existing plant at Te Awamutu, which will continue to discharge via rock channel to the Mangapiko Stream.
- **Mātangi and Tauwhare Pā upgrades:** Improvements to the existing Mātangi WWTP, which will remain online until the wastewater is conveyed to the Southern WWTP or HCC network around 2040. Upgrades to the existing Tauwhare Pā WWTP, which discharges to land.

1.1 Scope

The scope of the Management Case includes the management arrangements for the wider Programme as well as the project management framework applicable to each individual project.

At the time of writing, the impact of the New Zealand Government's Three Waters Reform process on the Sub-regional Councils is unknown. As such, the DBC has been prepared on the basis of 'business as usual' and where relevant, the proposed structures aim to maintain optionality and flexibility to transition to a new structure if required.

1.2 Project Management Planning

1.2.1 Programme Management Arrangements

Given the Projects will be undertaken at different times, locations and by different parties, strong collaboration between the respective councils, iwi and mana whenua will be required to successfully deliver the strategic outcomes agreed in the DBC. A Memorandum of Understanding (MoU) is intended to be entered into shortly after the finalisation of the DBC to capture these requirements.

The MoU outlines the parties' continued commitment to cooperation, collaboration and delivery of the strategic outcomes. It is expected items agreed in the MoU could transition into a three waters entity given the potential for significant structural change to three waters services delivery in New Zealand as a result of the Three Water Reform Programme.

The key terms of the MoU are detailed below:

Table MC - 1: Memorandum of Understanding – Key terms

Item	Details
Minimum performance standards	The proposed treatment standards in the MoU are consistent with those used for the DBC (see Economic Case Section [5.2 Preferred Option Key Considerations]) including liquid stream, solids stream and atmospheric emissions standards.
Governance structure	Establishment of the PPG to provide Programme level oversight. The PPG will include representation from the Sub-regional Partners and will be formalised by a contractual agreement. The scope of the PPG will include direct oversight and the ability to make recommendations in relation to Programme integration, Programme consenting strategy and benefits management. Importantly, PPG members will still be required to seek endorsement for decisions at their home organisations (i.e., the PPG cannot make decisions that utilise the powers of Local Government).
Cost allocation, funding and financing	Cost allocation principles for: <ul style="list-style-type: none"> • Land acquisition for the Southern WWTP. • Reticulation / conveyance costs. • Plant costs (master planning, consenting and design costs, initial ground works, civil works, treatment systems etc). • Discharge and compliance monitoring systems These items are further detailed in the Financial Case Section [1.3.1 Cost Allocation].
Southern WWTP thresholds	The MoU will include the capacity thresholds and triggers to move to the next stage of development for the Southern WWTP.
Lead Council	The Projects within the wider Programme of works will be delivered by a Lead Council. The Lead Council will utilise its existing resources, policies and procedures to deliver the Project (see Section [1.2.2 Project Management Arrangements]). The MoU will outline the Lead Council for each Project.
Cross-boundary servicing arrangements	The MoU will outline the intention for Lead Councils to enter into servicing agreements for servicing of any cross-boundary communities.
Ownership	The MoU will outline that joint ownership of wastewater assets is not preferred and that ownership will likely reflect the Council that provides the financing and has control of Project delivery and asset management.

¹ Shortlisting and detailed MCA analysis of the delivery structure options can be found in the Governance Group meeting content from 28 October 2020 and Control Group content from 30 November 2020 respectively.

1.2.2 Project Management Arrangements





The Projects within the wider programme of works will be delivered by a single council (Lead Council) on behalf of the other Sub-regional Partners. The Lead Council will utilise its existing resources, policies and procedures to deliver the project.

Project delivery through a Lead Council is preferred rather than establishing a new entity due to the lower establishment costs, lower ongoing costs, shorter establishment timeframes and greater flexibility to transition to a three waters entity if necessary, as a result of any sector reform. A number of other delivery structures were considered and assessed as part of the DBC. These included joint procurement, a partnership with principal council or principal CCO, a new entity that is fully council owned, an existing shared services organisation (WLASS), a new regional water entity, a new water entity with joint council and third-party ownership and a community trust¹,

The Lead Council for each project is based on the territorial authority where the beneficiaries are located. This generally reflects the location of the Project, except for the new Southern WWTP, which is located within Waipā DC's territory. The Southern WWTP is proposed to be delivered by HCC² because it is expected to service demand in southern Hamilton over the long term (see Economic Case, Appendix O, Preferred Option Report).

The Lead Councils for each project are outlined below:

Table MC - 2: Lead Councils

Project	Lead Council
Southern WWTP	
Cambridge WWTP	
Te Awamutu upgrades	
Mātangi and Tauwhare Pā upgrades	

1.2.3 Governance Structure

The governance structure comprises:


- Project level: Existing governance arrangements applicable to each Lead Council.
- Programme level: PPG and Programme Director.

The Project level governance arrangements reflect the Lead Council structure and are consistent with existing project delivery policies and decision-making frameworks. The Programme level governance is structured on a joint basis with representation from Waikato-Tainui, mana whenua, Waipā District Council (Waipā DC), Waikato District Council (Waikato DC) and HCC (the Sub-regional Partners). The purpose of the joint governance structure is to provide oversight to ensure the strategic objectives in the DBC/MoU are being followed by each Lead Council and opportunities for collaboration and integration are being captured.

² The specific arrangements between HCC and Waipā DC in relation to consent and designation processes outside HCC's territorial authority are to be further evaluated in relation to requirements under the Local Government Act and Resource Management Act.

The proposed governance structure is outlined below:

Figure MC - 1: Governance structure

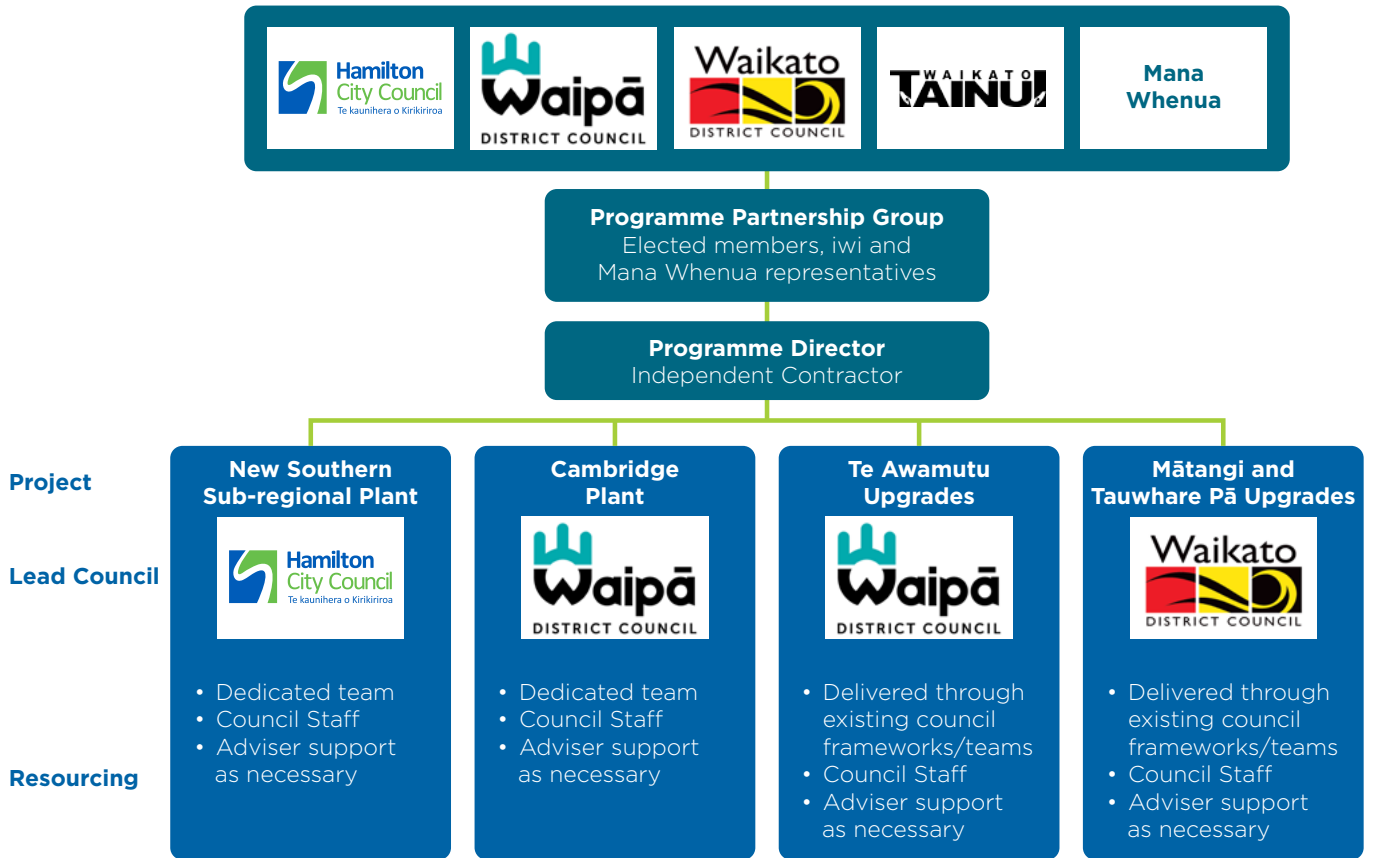

These arrangements are anticipated to remain in place until at least the completion of the construction works for each Project. Consideration would need to be given as to whether or not to disband the governance arrangements at this point.

Programme Partnership Group:

The PPG is a senior level joint governance group will be established contractually between the Sub-regional Partners and will provide direct oversight of the areas relevant to the wider programme.

Table MC - 3: Key features of the PPG

Key features	Description
Meeting frequency	Once every three months but frequency is dependent on the stage of the Programme and the underlying requirements.
Size and composition	<p>Representatives include:</p> <ul style="list-style-type: none"> • Up to two representatives appointed by Waipā DC; • Up to two representatives appointed by Waikato DC; • Up to two representatives appointed by HCC; • Up to six representatives of Taangata Whenua, including at least two representatives appointed by Waikato-Tainui. The remaining four Taangata Whenua Representatives will be appointed by the collective marae, hapuu and Iwi within the Metro Area through processes defined by Taangata Whenua; and • The PPG may appoint any further person or persons who will provide expertise and experience as may be required from time to time for the completion of the Projects. • Waikato Regional Council could potentially attend meetings in an observer capacity.
Decision making and voting	All decisions are expected to be made by consensus, however until such time as the PPG prepares and agrees its Terms of Reference, a decision of the PPG must be approved by a majority of the members. If voting is needed, all member organisations will have one vote each. The PPG members are still be required to seek endorsement for final decisions at their home organisations (i.e. the PPG cannot make decisions that utilise the powers of Local Government).
Appointment process	All members and alternates will be appointed by their respective organisation's governors. Mana whenua representatives will be appointed by the collective marae and hapū within the Metro Area through processes defined by mana whenua.
Skillset / expertise	Members should have sufficient influence within their organisations and be able to represent the respective views of their organisations.

The roles and responsibilities of the PPG aim to address items that are relevant to the wider programme but are not addressed through the Lead Council governance arrangements. While having a single council lead delivery on behalf of the other Sub-regional Partners has a number of benefits, an overall collective approach can provide additional benefits in relation to Programme integration, Programme consenting strategy and benefits management. These are discussed in further detail below:

- Programme Integration: Councils and other stakeholders need confidence that decision-making on Projects considers the potential implications for other projects (e.g. timetable, procurement, supply chain) to ensure the best value for money can be obtained.
- Consenting strategy: There may be the potential to save money or maximise synergies by taking a strategic approach to consenting for the individual projects. While individual Lead Councils will undertake the consenting applications themselves, the Programme must ensure that any cost savings or joint benefits from a global approach are considered and can be realised.
- Benefits management: There is potential that the disaggregated nature of the preferred option means it is more difficult to ensure accountability for the delivery of the strategic objectives and benefits that stakeholders have signed up to in the DBC and MoU (which have been guided by the 'Best for River' principle).

The roles and responsibilities of the PPG aim to address these items and are outlined below:

Table MC - 4: Roles and Responsibilities of the PPG

Oversight area	Responsibilities
General	<ul style="list-style-type: none"> • Represent the behaviours and strategic objectives agreed in the DBC and the MoU. • Actively contribute to group discussions and debate issues robustly. • Appoint and provide direction to the Programme Director in line with the methodology outlined in the terms of reference for the PPG.
Integration of the Programme	<ul style="list-style-type: none"> • Provide oversight, strategic direction and decision-making for the integration of the Programme on behalf of the Sub-regional Partners. • Receive regular updates from Lead Councils on the status of each of the Projects. • Make recommendations to Lead Councils on issues where there are potential benefits from applying an integrated approach across the sub-region. • Raise objections to Lead Councils should the Programme Director and PPG deem they are acting in a manner inconsistent with the delivery of an integrated Programme.
Consenting strategy	<ul style="list-style-type: none"> • Provide direct oversight of the Programme consenting strategy to ensure any cost benefits and other synergies available from an integrated approach can be achieved. • Make recommendations or raise objections to Lead Councils.
Benefits management	<ul style="list-style-type: none"> • Receive regular reporting on benefits realisation from Lead Councils. • Make recommendations to Lead Councils if there are opportunities to enhance the delivery of the strategic objectives. • Raise objections to Lead Councils if it deems they are failing to deliver the strategic objectives agreed to in the DBC.

Programme Director:

As part of the joint governance arrangements, a Programme Director is proposed to be established. The Programme Director will be independent of the Sub-regional Partners, sit across the whole Programme and report to the PPG. The Programme Director will be the key intermediary between the individual Projects and the PPG and have relevant experience in large-scale infrastructure project delivery.

The roles and responsibilities of the Programme Director largely mirror those of the PPG to reflect the intermediary nature of the role and are outlined below:

Table MC - 5: Roles and responsibilities of the Programme Director

Oversight area	Responsibilities
General	<ul style="list-style-type: none"> • Represent the behaviours and strategic objectives agreed in the DBC and the MoU.
Integration of the Programme	<ul style="list-style-type: none"> • Receive project reporting from the Lead Councils, consolidate and report to the PPG as necessary. • Directly make recommendations to the PPG on issues where there is potential for sub-regional benefits from an integrated approach.
Consenting strategy	<ul style="list-style-type: none"> • Provide direct oversight of the Programme consenting strategy to ensure any cost benefits and other synergies available from an integrated approach can be achieved. Consolidate and report to the PPG as necessary.
Benefits management	<ul style="list-style-type: none"> • Provide direct oversight over benefits management and highlight any failures to deliver agreed minimum standards (as set out in the MoU) to the PPG. • Make recommendations to the PPG if there are opportunities to enhance the delivery of strategic outcomes.

Lead Council:

The Lead Council will retain oversight of core project delivery functions through existing governance arrangements. The scope of the Lead Council will include the core project delivery functions including consenting and planning, procurement, construction management and asset management.

The roles and responsibilities of the Lead Council are outlined below:

Table MC - 6: Roles and Responsibilities - Lead Council

Responsibilities	Description
General	<ul style="list-style-type: none">• Represent the behaviours and strategic objectives agreed in the DBC and the MoU.
Project delivery and operations	<ul style="list-style-type: none">• Oversee the Project delivery and management, including Project scope, schedule, land acquisition (if applicable) and budget as the Project progresses through the planning, procurement and implementation phases.• Manage resourcing and advisory support for respective Projects.• Identify risks and agree appropriate management plans.• Drive the Project to deliver the strategic outcomes and benefits.• Approve key contracts and any variations.• Approve operational decisions.• Address any emerging issues and act decisively to alleviate the impact to the Project.
Reporting	<p>Provide reporting to the Programme Director and PPG in relation to:</p> <ul style="list-style-type: none">• Risks<ul style="list-style-type: none">- Consenting- Construction monitoring- Operational reporting- Project closure and post implementation reviews- Benefits realisation <p>Reporting is further discussed in Section [1.4.3 Monitoring and Reporting]</p>
Funding and financing	<ul style="list-style-type: none">• Independently finance respective Projects.• Enter into service agreements for any cross-boundary arrangements with other territories.
Communications and engagement	<ul style="list-style-type: none">• Approve media and stakeholder communication protocols in line with the protocols of the Programme.

1.2.4 Project Organisation Structure

Resourcing for each project will be managed by the Lead Council. The two new WWTPs will require a mix of dedicated resourcing, existing council teams and advisory support. The two upgrades are expected to be managed through existing council resources given their smaller scale (supported by advisers as necessary).


The proposed organisational structure for the two new WWTPs is based on Project activities to be undertaken at each stage. The organisational structure will evolve over time to ensure it remains fit-for-purpose.

The roles and responsibilities for the two new plants (Southern WWTP and Cambridge WWTP) have been broken down into three key stages:

- Initial phase (pre-implementation)
- Construction phase (implementation)
- Operations phase (post-implementation)

The underlying Project activities to be undertaken at each of these phases are detailed below:

Figure MC - 2: Project Activities

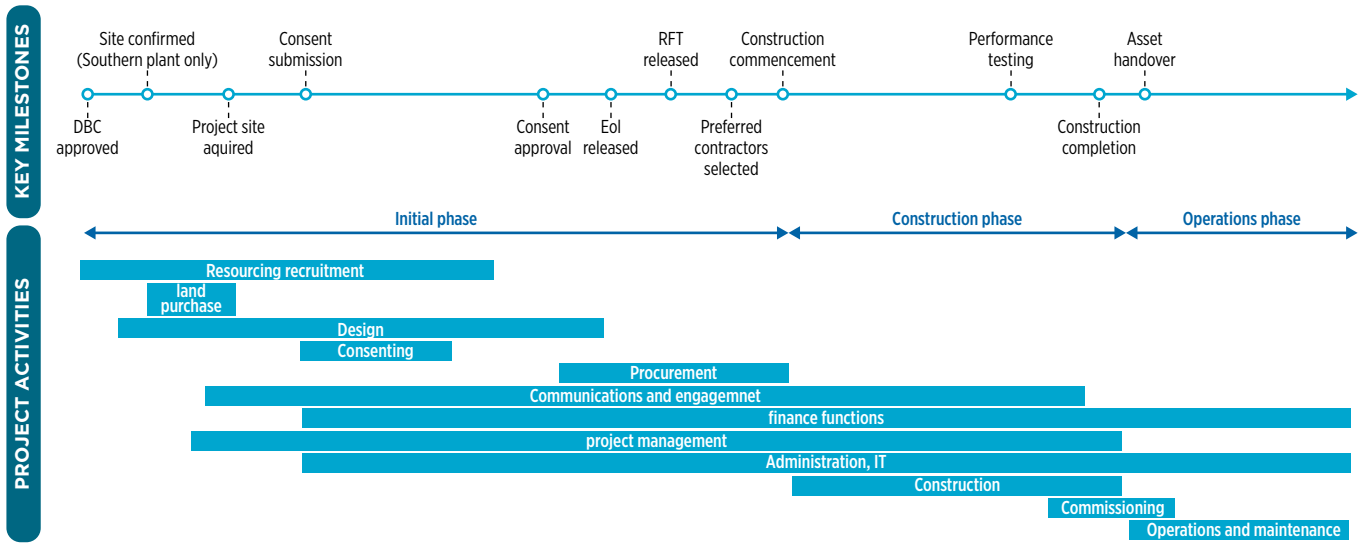

The ultimate composition of the teams will be dependent on the Lead Councils preferred organisational structure, however a suggested structure for each phase is detailed below:

Figure MC - 3: Organisational Structure - Initial phase

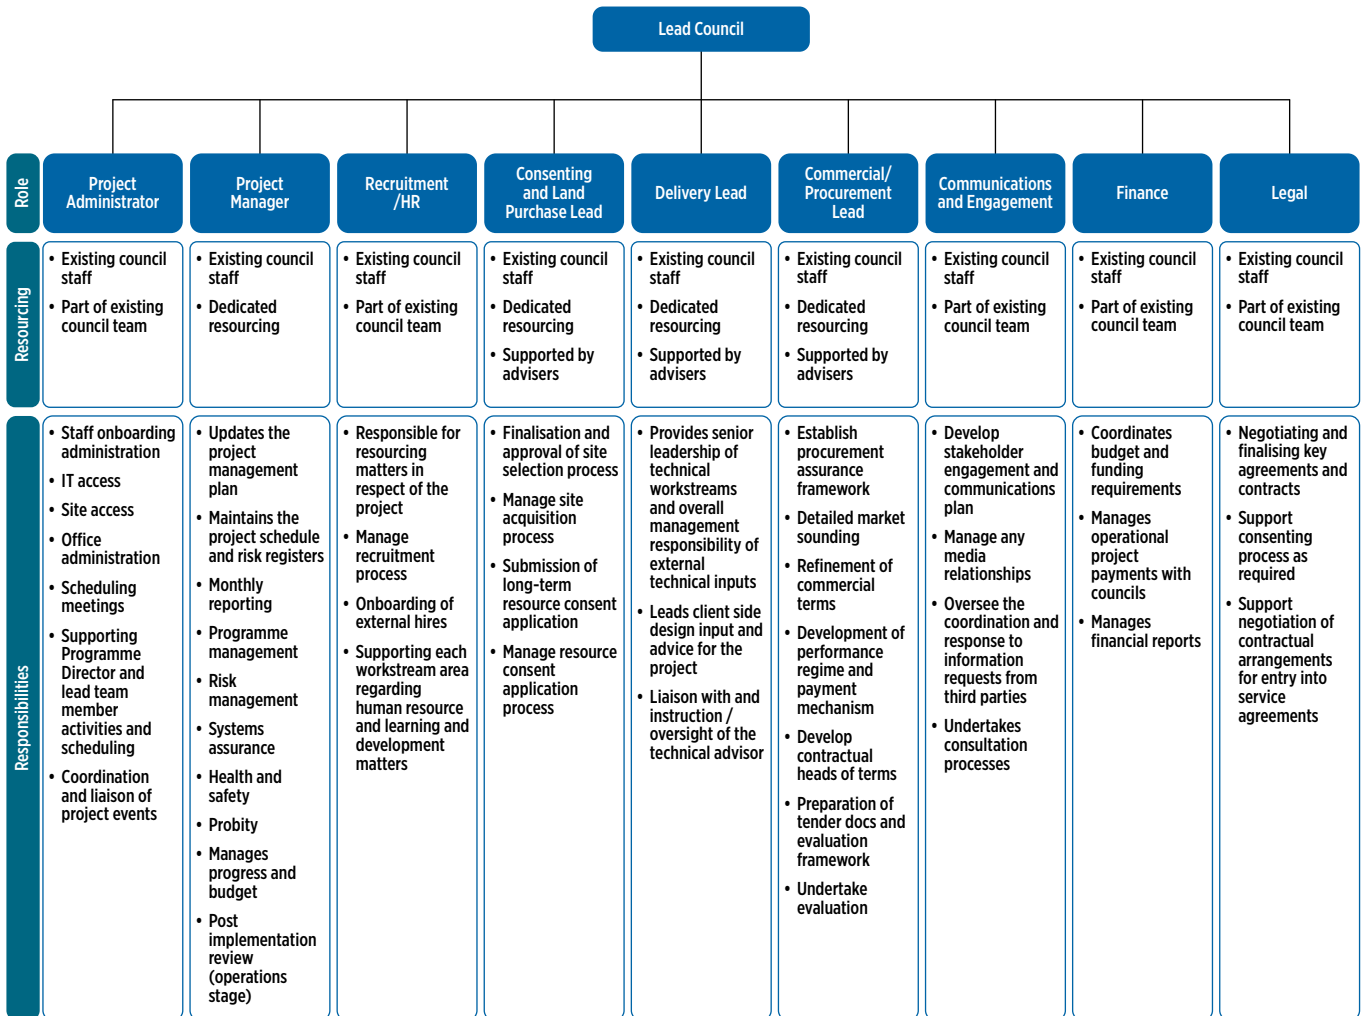


Figure MC - 4: Organisational Structure - Construction phase


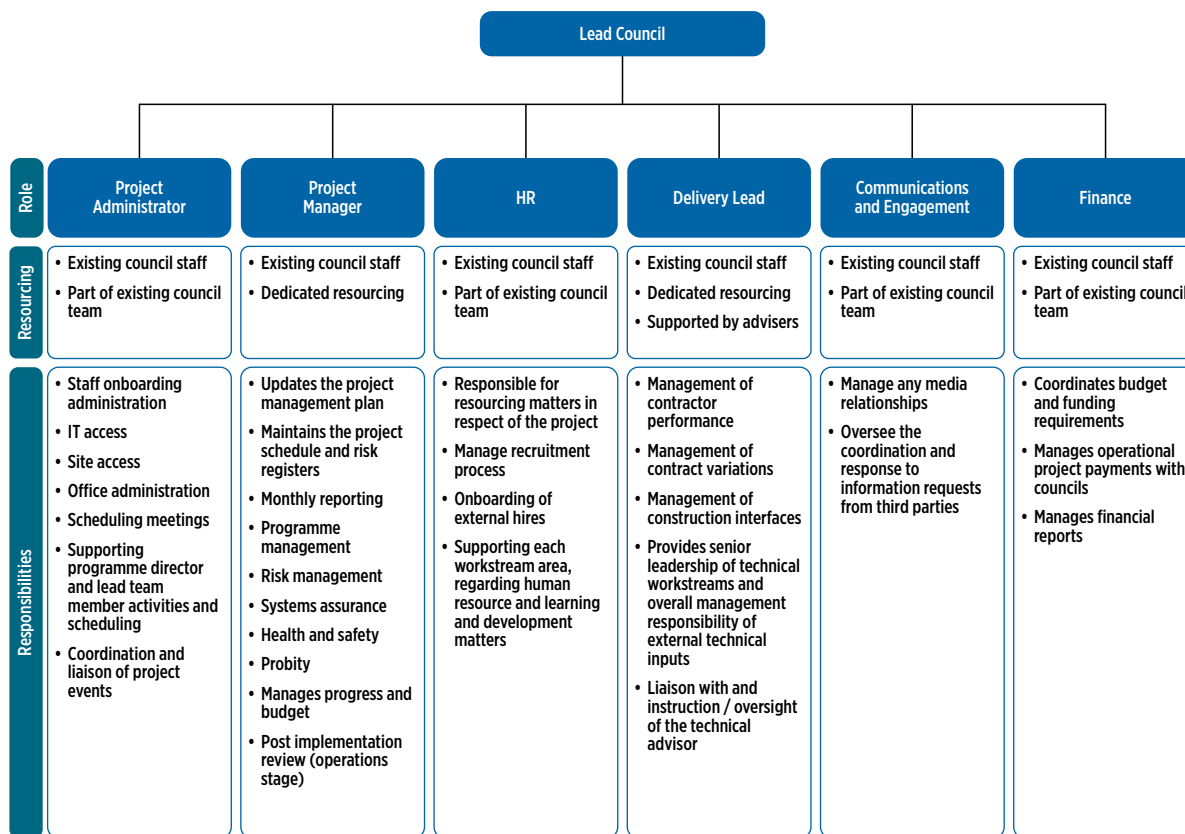


Figure MC - 5: Organisational Structure - Operations phase

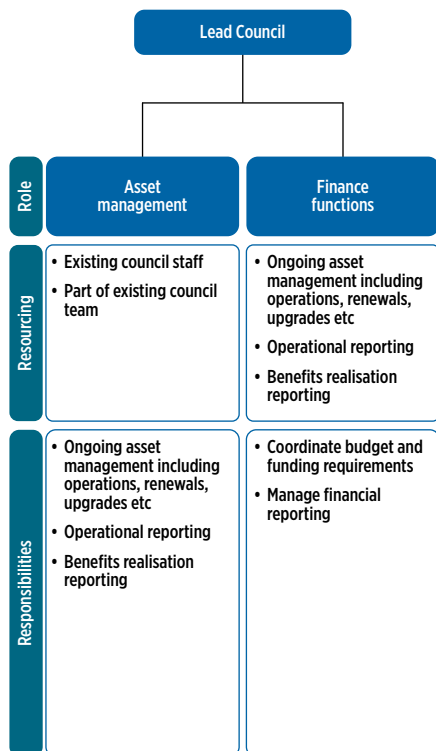

1.2.5 Use of Special Advisors

Where capability does not exist or is not available in-house, some roles may be filled by external contractors. Where additional support is required to supplement existing council resources and expertise, specialist advisors will be used. At a high level, the requirements for contractors and specialist advisors have been outlined in figures [5], [6] and [7]: Organisational structure.

Each project will require varying levels of specialist support expected to cover planning, engineering, commercial, financial and legal expertise. The potential advisory support is outlined below:

Table MC - 7: Advisory support

Advisory Support	Description
Planning	<ul style="list-style-type: none">• Land purchase advice.• Planning and environmental advice.
Engineering	<ul style="list-style-type: none">• Concept design.• Master planning.• Preliminary design.• Detailed design.
Commercial / financial	<ul style="list-style-type: none">• Procurement advice including market sounding, preparation of tender documentation and evaluation framework, development of risk transfer and commercial terms.• Accounting advice.
Legal	<ul style="list-style-type: none">• MoU establishment.• Construction contract review and negotiation.• Cross-boundary servicing agreements.

1.2.6 Personnel Implications


As discussed in Section [1.2.4 Organisation Structure], the two new WWTPs (Southern WWTP and Cambridge WWTP) will require dedicated resourcing of appropriate subject matter experts. This is expected to include council staff with expertise in consenting and planning, procurement and construction management. Where backfill requirements exist, these will be managed in line with the relevant human resources policies at each Lead Council.

Given their relatively small scale, the WWTP upgrades (Te Awamutu, Mātangi and Tauwhare Pā) are expected to be largely managed through existing Lead Council resources i.e. there will be no backfill requirements. The brownfield nature of the upgrades means sufficient expertise will be required to manage the interfaces with the existing operations.

1.2.7 Project Plan and Milestones

A summary of the key milestones for the projects included within the preferred option is presented below:

Figure MC - 6: Key Milestones - Programme

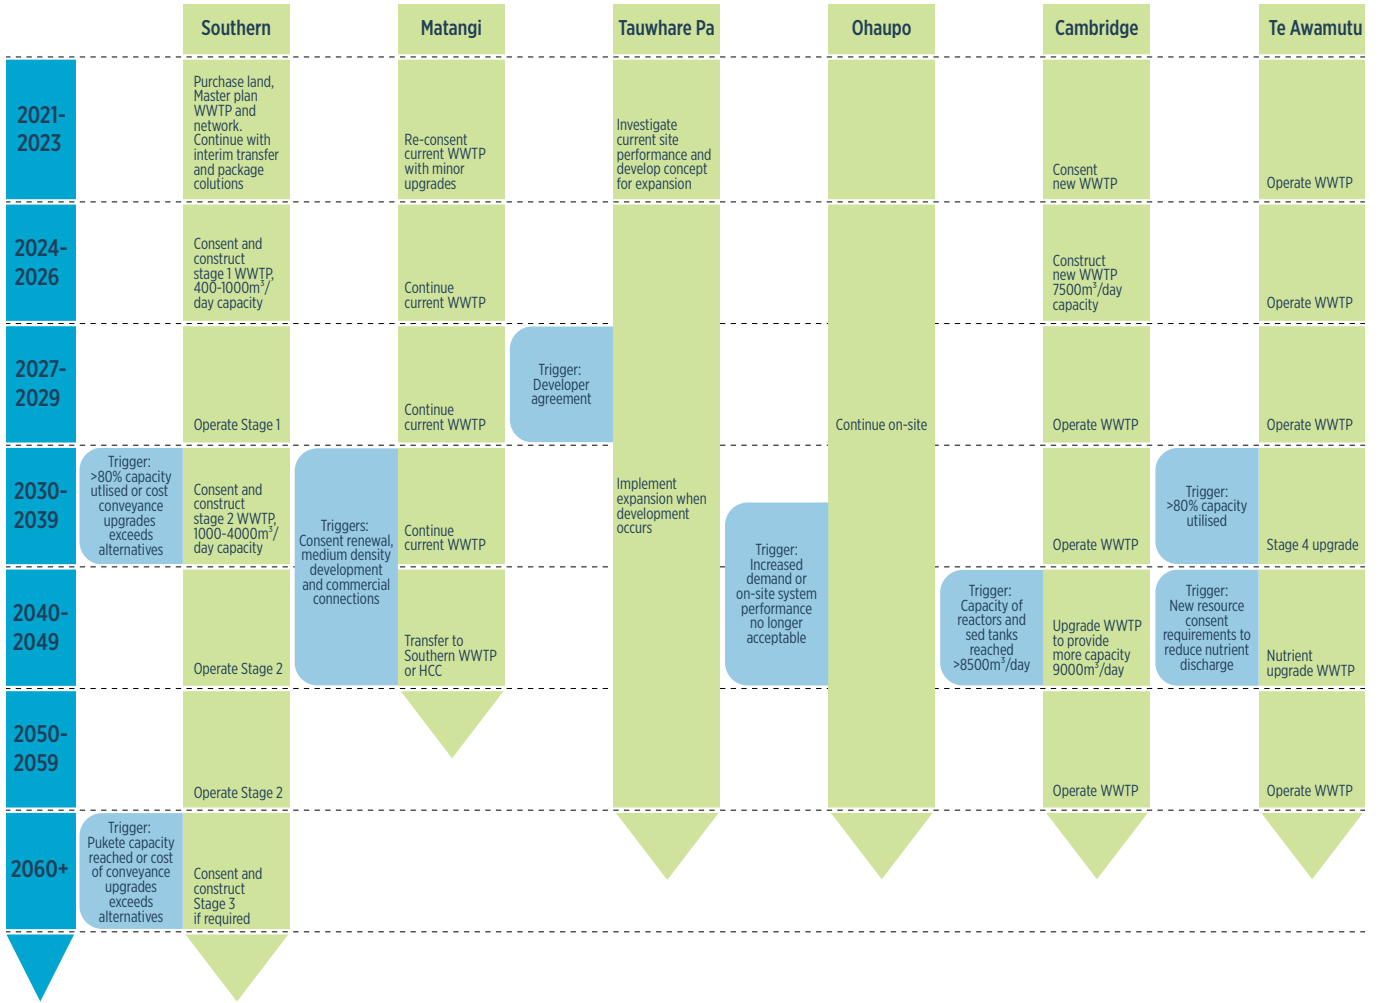

Southern WWTP

The Southern WWTP is expected to be delivered in three key stages with the following staging triggers:


1. Stage one: 400 m³/day - 1,200m³/day capacity (2021-2025). The trigger to move to stage two will occur when >80% of capacity is utilised or the cost of conveyance upgrades within the Hamilton network exceeds the alternatives.
2. Stage two: 1,200m³/day - 15,000m³/day capacity (expected 2030-2039 but driven by growth and demand). The trigger to move to stage three will occur when Pukete WWTP capacity is reached (for existing southern Hamilton flows) or the cost of conveyance upgrades exceeds the alternatives.
3. Stage three: 15,000m³/day + capacity (expected 2060+ but driven by growth and demand in particular from Hamilton).

The high-level Project schedule for the Southern WWTP is provided below:

Table MC - 8: Key Milestones - Southern WWTP

Key Milestones (Stage 1 only)	Start Date	End Date
Pre-implementation activities: land acquisition, preliminary design, consenting and designation processes	November 2021	November 2023 (24 months to complete)
Detailed design includes preparation EOI/RFT	November 2023	May 2024 (7 months to complete)
EOI released (Main plant works and conveyancing)	April 2024 (undertaken in parallel with detailed design)	May 2024 (2 months to complete)
RFT and award - Main plant works	June 2024 (8 months after consent issued - assuming consent issued in October 2023)	September 2024 (Preferred contractor selected 4 months after RFT is released)
RFT and award - Conveyancing	June 2024 (8 months after consent issued - assuming consent issued in October 2023)	September 2024 (Preferred contractor selected 4 months after RFT is released)
Construction	November 2024 (2 months after preferred contractor selected)	November 2025 (1-year construction period - excludes 2 months commissioning period)

Figure MC - 7: Key Milestones - Southern WWTP

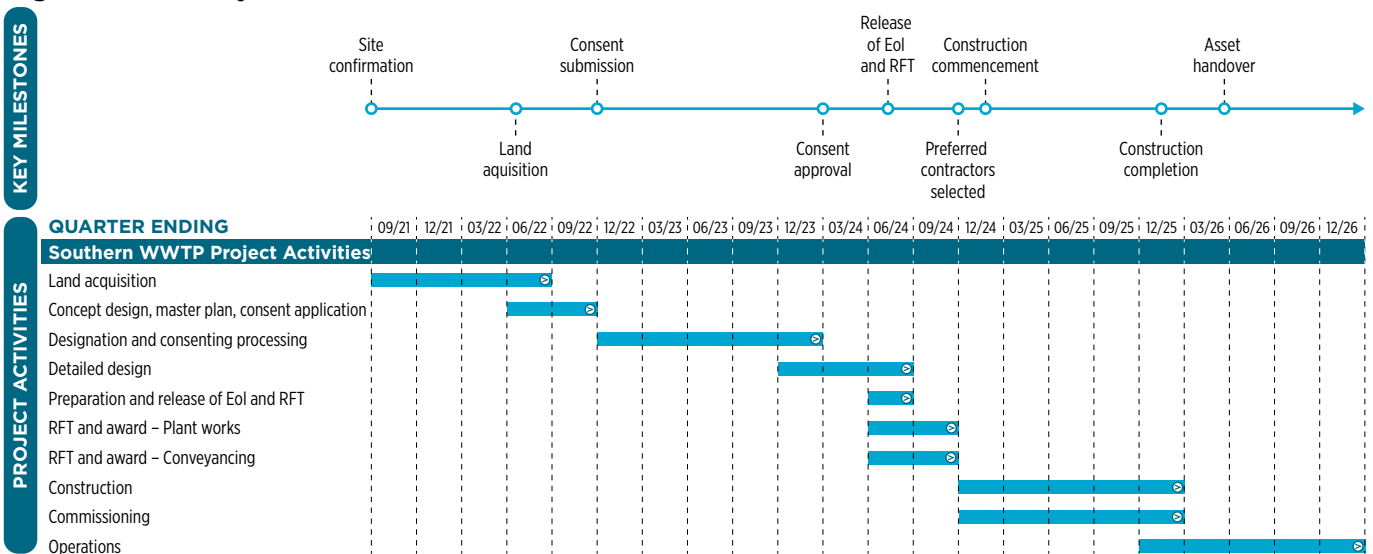

Cambridge WWTP

The Cambridge WWTP will be constructed during 2022-2026 and is expected to be upgraded during 2040-2049 to provide more capacity. Key stages are as follows:


1. Initial construction works: Approximately 7,500 m³/day capacity (2024-2026)
2. Subsequent upgrades: Approximately 9,000 m³/day capacity (expected 2040-2049). Upgrade trigger when >80% of existing capacity is utilised.

The high-level Project schedule for the Cambridge WWTP is provided below:

Table MC - 9: Key Milestones – Cambridge WWTP

Key Project Milestone	Start Date	End Date
Concept design, consent application preparation	June 2021	July 2022
Consent processing	July 2022	December 2022 (5 months)
Preliminary and detailed design	June 2022 (before consent sign off)	May 2023 (12 months to complete)
RFT and award – Enabling works	June 2022	August 2022 (2 -month procurement period)
Construction - Enabling works	August 2022	December 2022 (4-month construction period)
RFT and award – Main plant works	June 2023	October 2023 (4-month procurement period)
Construction - Main plant works	October 2023	August 2025 (22-month construction period)
Commissioning	August 2025	January 2026 (5-month commissioning period)

Figure MC - 8: Key Milestones – Cambridge WWTP

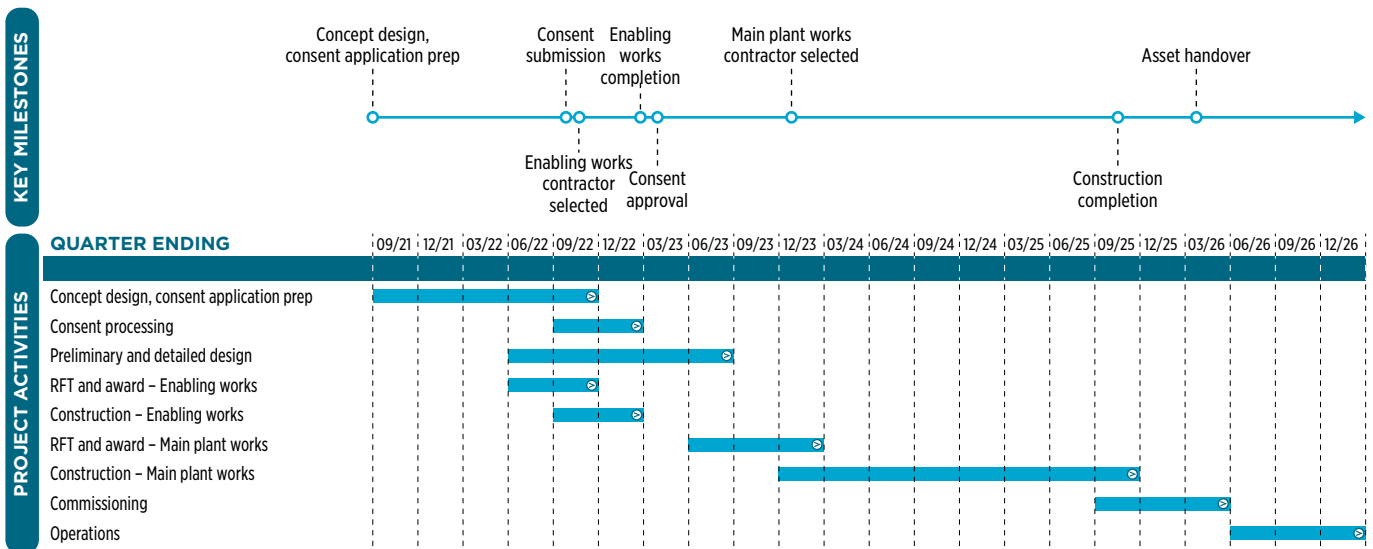

Mātangi Upgrades

Minor upgrades to the Mātangi WWTP will be undertaken during 2021-2023 with the plant expected to transfer to the Southern WWTP or the HCC network in 2040-2049. Should denser residential or commercial development occur in Matangi prior to 2040 (e.g. private plan change), the timing of the upgrades could be reviewed.

Tauwhare Pā Upgrades

The existing Tauwhare Pā WWTP will undergo a performance evaluation with concept for expansion developed over 2021-2023. The intention is to implement expansion when development occurs. The trigger for this will be a developer agreement or the need for improved system performance and reliability.

Ōhaupō

Ōhaupō is expected to continue with household treatment and disposal on site as per the existing arrangements. This will continue until on site environmental performance is no longer acceptable or additional demand dictates the need for centralised treatment.

1.3 Change Management Planning

1.3.1 Overview

Change management planning considers the potential impact on the culture, systems, processes and people from the Programme.

The delivery of the new WWTPs and upgrades that make up the Programme of works are not expected to have a significant change to the culture or systems of any particular council.

The key change will be the need for the Lead Council to provide reporting to the Programme Director and PPG. The purpose of this reporting is to ensure the Programme is delivered in a coordinated way with ongoing visibility provided through the joint governance structure (refer Section [1.2.3 Governance Structure]). The risk of poor integration across the Programme is further discussed in the risk register (refer Appendix P, risk reference 6). Specific reporting processes have been outlined to manage this change e.g. PPG reporting which captures project updates and integration (refer Section [1.4.3 Monitoring and Reporting]).

1.3.2 Project Delivery Change

Capital management and project delivery will utilise the same policies and procedures in place at each Lead Council. These include funding and financing, procurement and project management policies.

It is proposed that Lead Councils employ internal staff to deliver the Projects. Where these resources are not available in-house, recruiting of specialist staff will be required.

1.3.3 Operational Change

Southern WWTP

Stage one of the new Southern WWTP is relatively small compared to HCC's existing plant at Pukete and operationally the scale and technology of the plant will be comparable or more straight forward than existing assets. There is expected to be opportunity for integration with existing resources (technology, staff, processes etc). However, for stage one, new staff will be required to manage the facility and discharge system as well as monitoring and compliance tasks. The proposed organisational structure for the Southern WWTP is discussed under Section [1.2.4 Organisational Structure].

Cambridge WWTP

Operationally, the new Cambridge WWTP will be more complex than existing wastewater assets managed by Waipā DC.

Training of staff will be undertaken as part of the commissioning and handover process. The design team is expected to be involved in this process alongside the contractor and process equipment supplier.

Once complete, Waipā DC staff at the existing Cambridge WWTP are assumed to transfer to the new Cambridge WWTP, noting increased resourcing is expected.

Further detail will be developed as part of Waipā DC's planning for the Cambridge WWTP.

WWTP Upgrades

The scale and technology of the upgrades is comparable to existing assets.

Once the WWTP upgrades are complete, the assets will be operated in the same way as they are currently by the Lead Councils.

1.3.4 Change Management Strategy

Table MC - 10: Change management strategy

Project	Anticipated change and management strategy
Southern WWTP	<ul style="list-style-type: none"> Capital management and project delivery will utilise the same policies and procedures in place at HCC. Accordingly, minimal change from existing practices is anticipated. These include the Procurement Policy and Procedures Manual, Project Management Framework and Risk Management Policy. Operations: There is expected to be opportunity for integration with existing resources (technology, staff, processes etc). However, for stage one, new staff will be required to manage the facility and discharge system as well as monitoring and compliance tasks.
Cambridge WWTP	<ul style="list-style-type: none"> Capital management and project delivery will utilise the same policies and procedures in place at Waipā DC. Accordingly, minimal change from existing practices is anticipated. These include Waipā DC's Procurement Strategy, Project Management Framework Policy and Procedural Policy Manual. Operations: The proposed membrane plant is more sophisticated than the existing pond-based plant at Cambridge and the activated sludge plant at Te Awamutu. It is anticipated that staff will transition from the existing plant at Cambridge to the new plant. However additional resourcing is likely to be required. Training will be managed collectively by the contractor, process equipment supplier and design team.
Te Awamutu	<ul style="list-style-type: none"> The scale and technology of the upgrades will not fundamentally change the nature of operations at Te Awamutu. The level of expertise required will be comparable to the existing plant. The upgrades are expected to be managed within council policies without material change.
Mātangi and Tauwhare Pā	<ul style="list-style-type: none"> The scale and technology of the upgrades are comparable to existing Waikato DC wastewater assets. The upgrades are expected to be managed within council policies without material change.

1.4 Benefits Management Planning

1.4.1 Overview

Benefits management involves the identification, planning, monitoring and review of benefits delivered by the Programme. The strategy, framework and plan for dealing with the management and delivery of benefits are in the BRP attached to this business case as Appendix M.

The proposed approach for managing benefits is for each Lead Council to provide project reporting which is then consolidated at a Programme level. The BRP provides a framework for ongoing assessment against the Te Ture Whaimana objectives and the project KPIs. The BRP structure is intended to be enduring and form part of the business-as-usual approach.

1.4.2 DBC Objectives

The DBC Objectives developed as part of the Strategic Case (Strategic Case Section [3.3.2 Project Objectives]) are outlined below:

1. Before 2050 municipal wastewater discharges are no longer impacting on the ability of people to swim and collect Kai from the river and connected waterways thereby contributing to the restoration and protection of the health and wellbeing of the river.
2. The quality and extent of aquatic and terrestrial habitat and biodiversity in and around water bodies is enhanced through the reduction of wastewater treatment and discharge impacts before 2050.
3. Wastewater treatment solutions contribute to restoring and enhancing cultural connectivity with the river so that, before, 2050 Marae, Hapū and iwi access to the river and other sites of significance for cultural and customary practice within the metro spatial area are no longer impeded by wastewater treatment solutions.
4. Maximise efficient use of resources and resource recovery to contribute to net zero greenhouse gas related emissions from wastewater treatment systems before 2050.
5. The wastewater solution provides sufficient capacity to ensure sustainable growth in the metro spatial area in accordance with growth projection assumptions for the next 100 years.

More specific KPIs were identified in the Strategic Case Section [3.3.3]) for each of the objectives to measure performance. Measurement of the KPIs use the most up-to-date sources and real time data to ensure baselines and targets are accurate and quantifiable.

The DBC Objectives will be considered and embedded into the overall solution as each Project is progressed. This will involve a wider analysis than just implementation of high treatment standards. Consideration will be undertaken as part of implementation, consenting and planning processes for each of the Projects individually and collectively. As per the Waikato and Waipā Rivers Restoration Strategy, some of the potential initiatives to support the objectives could focus on:

- Erosion and sedimentation
- Water quality
- Biodiversity
- Fish
- Access and recreation
- Cultural values.

The costs of any additional restorative investments have not been included in the DBC.

1.4.3 Monitoring and Reporting

Construction Monitoring:

Construction monitoring will depend on each Lead Council's preferred approach, however suggested monthly reporting requirements are outlined below.

During construction, monthly cost and progress reporting will be prepared for each of the Projects by the relevant Project Manager. The monthly reports will include:

- Progress against key milestones and any change to the project schedule.
- Progress against budget.
- Key risks and mitigations.
- Utilisation of contingency.
- Variation history.

The reporting should provide timely sharing of information and ensure risks are escalated as soon as they are identified. The objective of the monthly reporting is to make sure the Lead Council has relevant, accurate and complete information to accurately fulfil its governance obligations.

PPG Reporting:

High level reporting will be prepared for the quarterly PPG meetings. This will summarise the key updates from each of the projects based on construction and/or BRP reporting. The reporting will be received from each of the Lead Councils for their relevant projects and compiled by the Programme Director.

The reporting will provide updates on:

- Key project updates.
- Progress against schedule and budget.
- Project integration.
- Consenting strategy.
- Benefits management.

Project Closure Report and Post Implementation Review

On completion, a project closure report will be drafted by the Project Manager. A post-implementation review will also be undertaken by the respective Lead Council to assess the success of the project, including the business case, planning and delivery phases. This will be undertaken within the first six months after asset acceptance is achieved, to confirm the new WWTPs are operating as intended and delivering the services proposed in the DBC.

Operational Reporting

The Local Government Act 2002 requires that all councils provide annual reporting on the performance of their wastewater systems. The reporting covers key performance metrics including compliance with resource consents, number of wastewater overflows and any public health incidents. This level of reporting will be provided by the Lead Council for each project.

BRP Reporting

The BRP outlines the specific KPIs for each objective and the data sources for monitoring of these KPIs. Many of these sources will be developed as part of the implementation of the Programme. The baseline and target measures will be further developed once the monitoring systems have been established.

Benefits management will be managed by the Lead Council at a project level and reported directly to the Programme Director and PPG. Benefit realisation reviews will be undertaken annually during the life of the assets by the asset management team.

The PPG will be an additional layer of oversight to ensure that the KPIs agreed as part of the DBC are being met across the Programme. The PPG and Project Director can make recommendations to Lead Councils if there are opportunities to enhance the delivery of strategic outcomes or raise objections if the strategic outcomes and 'Best for River' principle are not being followed. If it is deemed appropriate to disband the Governance structure following completion of construction (for all the Projects), consideration would need to be given to the appropriate body to oversee the BRP reporting.

1.5 Risk Management Planning

1.5.1 Risk Recording and Reporting

Risk recording and reporting is an integral part of the Project governance framework. It will enhance the quality of the dialogue amongst stakeholders and support the Lead Councils, the Programme Director and PPG in meeting their responsibilities.

HCC's risk management system has been used to capture programme level and project level risks identified during the DBC process. These risk registers will continue to be updated throughout the initial, construction and operations phases.

Project level risks will be managed by the Lead Council using their existing risk management framework. The risk management framework to be used for the Southern WWTP (HCC) is attached in Appendix N. The risk management framework to be used for Cambridge WWTP (Waipā DC) is attached in Appendix O.

Monthly risk reporting will be received from each Lead Council for their relevant projects and will be compiled by the Programme Director. The Programme Director will compile significant project level risks, alongside risks that are relevant to the wider Programme to highlight the key programme level risks. The existing risk register that has been developed as part of the DBC would be used for managing programme level risks.

1.5.2 Risk Register

The register lists all current risks and the results of their analysis and evaluation. Information on the status of the risk is also included. The risk register will be updated monthly by the Programme Director.

Table MC - 11: Risk register: Top risks

Risk Description	Cause	Controls	Likelihood	Consequence	Residual Risk Rating	Risk Treatment	Action Plan
The recommended DBC projects cannot be funded leading to the project being delayed, not proceeding or lower standards being adopted.	<ul style="list-style-type: none"> - Competing priorities leading to unwillingness to fund the Projects. - Insufficient financial headroom for councils to fund the Projects. - Cost increases or affordability impacting the ability to secure funding or financing. - Lack of integration, coordination and planning at a sub-regional level. 	<ul style="list-style-type: none"> - Staging for the Southern WWTP. - Traditional approach to financing. - Lead council structure agreed in principle and included through MoU. - Funding to commence implementation of projects recommended in the DBC included in LTPs. 	Likely (3)	Catastrophic (5)	Very High Risk (15)	Mitigate	<ul style="list-style-type: none"> - MoU signed by project partners confirming approach to ownership, funding and financing. - Establish governance and delivery structure recommended in the DBC. - Ensure appropriate joint engagement between Councils/Partners. - HCC to enter into service agreement with Waipa DC.
Costs to implement recommended DBC projects are significantly higher than estimates further impacting on affordability and leading to the project being delayed, not proceeding or lower standards being adopted.	Increasing land costs, high contractor demand, limited providers, increasing costs of key materials, supply chain disruption or poor risk allocation in construction contracts.	<ul style="list-style-type: none"> - Monitor market conditions. - Procure works and services as early as possible. - Undertake procurement methodology attracting multiple tenderers. - Sensitivity assessments on inflation. - Recommend immediate initiation of key projects. 	Likely (3)	Catastrophic (5)	Very High Risk (15)	Accept	<ul style="list-style-type: none"> - Complete site selection, land acquisition, consenting and designation early. - Early contractor engagement. - Procure early to reduce escalation risk. - Use procurement methodology that attracts multiple tenderers.
The recommended DBC projects do not meet iwi / mana whenua expectations which may impact ability to implement recommendations, consentability and adversely impact relationships.	<ul style="list-style-type: none"> - Lack of meaningful engagement with relevant groups. - Insufficient resourcing to enable meaningful iwi / mana whenua participation. - Mana whenua/iwi views not reflected in Governance decisions. - Differing priorities/points of view. - Lack of understanding of what outcomes are acceptable to iwi/mana whenua. 	<ul style="list-style-type: none"> - Co-design and development with iwi/mana whenua. - Project based on co-developed approach. - Metro West Project vision includes iwi values in aspirations. 	Likely (3)	Major (4)	Very High Risk (12)	Mitigate	<ul style="list-style-type: none"> - MoU confirms minimum standards and governance. - Establish governance and delivery structure. - Review & implement communications and engagement plans including iwi/mana whenua. - Incorporate co-design into delivery approach.

Risk Description	Cause	Controls	Likelihood	Consequence	Residual Risk Rating	Risk Treatment	Action Plan
Resource consents and designations for recommended wastewater projects cannot be secured or the costs to deliver a consentable solution are prohibitive.	<ul style="list-style-type: none"> - New activity and discharge to the Waikato River (in isolation) is not consistent with Te Ture Whaimana, NPS FM, NES for Human Drinking Water, etc. - Other WWTPs consent renewal timeframes do not align. - Legislative change - Vision and Strategy and legislative change 	<ul style="list-style-type: none"> - Collaborative project approach with Iwi/TLA and Governance Group - Regulator involved in project - Technical teams from other consents leveraged - Consenting Strategy aligned with Vision & Strategy for the river - Identification of alternative pathways Likely (3) 	Likely (3)	Catastrophic (5)	Very High Risk (15)	Mitigate	<ul style="list-style-type: none"> - Secure site for new WWTP - Explore beneficial re-use options - Demonstrate betterment in catchment - Adopt appropriate treatment standards - Develop engagement strategies and ensure consistent messaging
Reform of the Three Waters sector impacts the ability or commitment to implement the DBC programme recommendations.	<ul style="list-style-type: none"> - Potential views all work should pause until sector decisions - If reform occurs, actors involved in delivery may change - MoU and DBC obligations may not carry over 	<ul style="list-style-type: none"> - Preferred options based on 'business as usual' - Programme and delivery structures maintain flexibility - Agreements in MoU and DBC support knowledge transfer 	Likely (3)	Major (4)	Very High Risk (12)	Mitigate	<ul style="list-style-type: none"> - Continue implementing DBC and MoU recommendations - Accelerate implementation of recommended projects
Inability for councils to move to integrated delivery of programme results in uncoordinated delivery of the overall programme results in misalignment of objectives and 'Best for River' principles.	Misalignment of objectives and commitment of resources from Sub-regional Partners.	<ul style="list-style-type: none"> - MoU to include agreement on minimum performance standards and governance - Benefit management and reporting as per DBC - Compliance with consent requirements 	Likely (3)	Major (4)	Very High Risk (12)	Mitigate	<ul style="list-style-type: none"> - Include agreement upfront in MoU - Maintain joint visibility through governance and reporting as per MoU

The mitigations for these top risks demonstrate that the Programme is reliant on the partners continuing to work together constructively, implementing the recommendations in the DBC and entering into the MoU in good faith. Failure to do so would likely result in materialisation of a number of these risks.

The risk register is included as Appendix P to this document. The full document includes the complete list of risks and further information in relation to categorisation, responsible parties, target dates and post action plan target risk ratings.

•

1.6 Next Steps

This DBC seeks formal approval from the Sub-regional Partners to progress the implementation of the preferred option.

The immediate next steps are outlined below:

1. Finalise and enter into the MoU.
2. Establish the proposed governance structure, including the PPG and the Programme Director.
3. Progress with the Project Plans. The initial activities are outlined below:
 - a. Southern WWTP:
 - i. Continue discussions with the Waikato Regional Airport regarding interim arrangements.
 - ii. Finalise the preferred site (October 2021).
 - iii. Acquire the land for the WWTP (April 2022).
 - iv. Begin concept design/master plan/consent application preparation (May 2022).
 - b. Cambridge WWTP:
 - i. Finalise preliminary work including the Procurement Plan and Risk Register (September 2021).
 - ii. Continue progressing the activities that are already underway:
 1. Consenting.
 2. Technical investigations.
 3. Concept engineering.
4. Progress with the proposed project plans. The initial activities are outlined below:
 - c. Southern WWTP:
 - i. Continue discussions with the Waikato Regional Airport regarding interim arrangements.
 - ii. Finalise the preferred site.
 - iii. Acquire the land for the WWTP.
 - iv. Complete plant and discharge master plan and design and consent applications.
 - d. Cambridge WWTP:
 - i. Continue progressing the activities that are already underway:
 1. Consenting.
 2. Technical investigations.
 3. Engineering design and construction.